


1) CARRY TO WITHIN 8' TO 10' OF GROUND ELEVATION.

2) MIN. 2" x 2" CEDAR OR TREATED WOOD MARKER, MARKED (SANITARY-RED, STORM-WHITE), SET VERTICALLY.


3) CAP WITH SOLVENT WELDED CAP OR PLUG.

4) CLASS "X" CONCRETE TO EXTEND MIN. 1.0' BEYOND TEE JOINTS (D.I.P. TEE NOT ENCASED)

5) CLASS II MATERIAL, COMPACTED TO 95% MAXIMUM DENSITY PER CITY OF ANN ARBOR STANDARD SPECIFICATIONS.

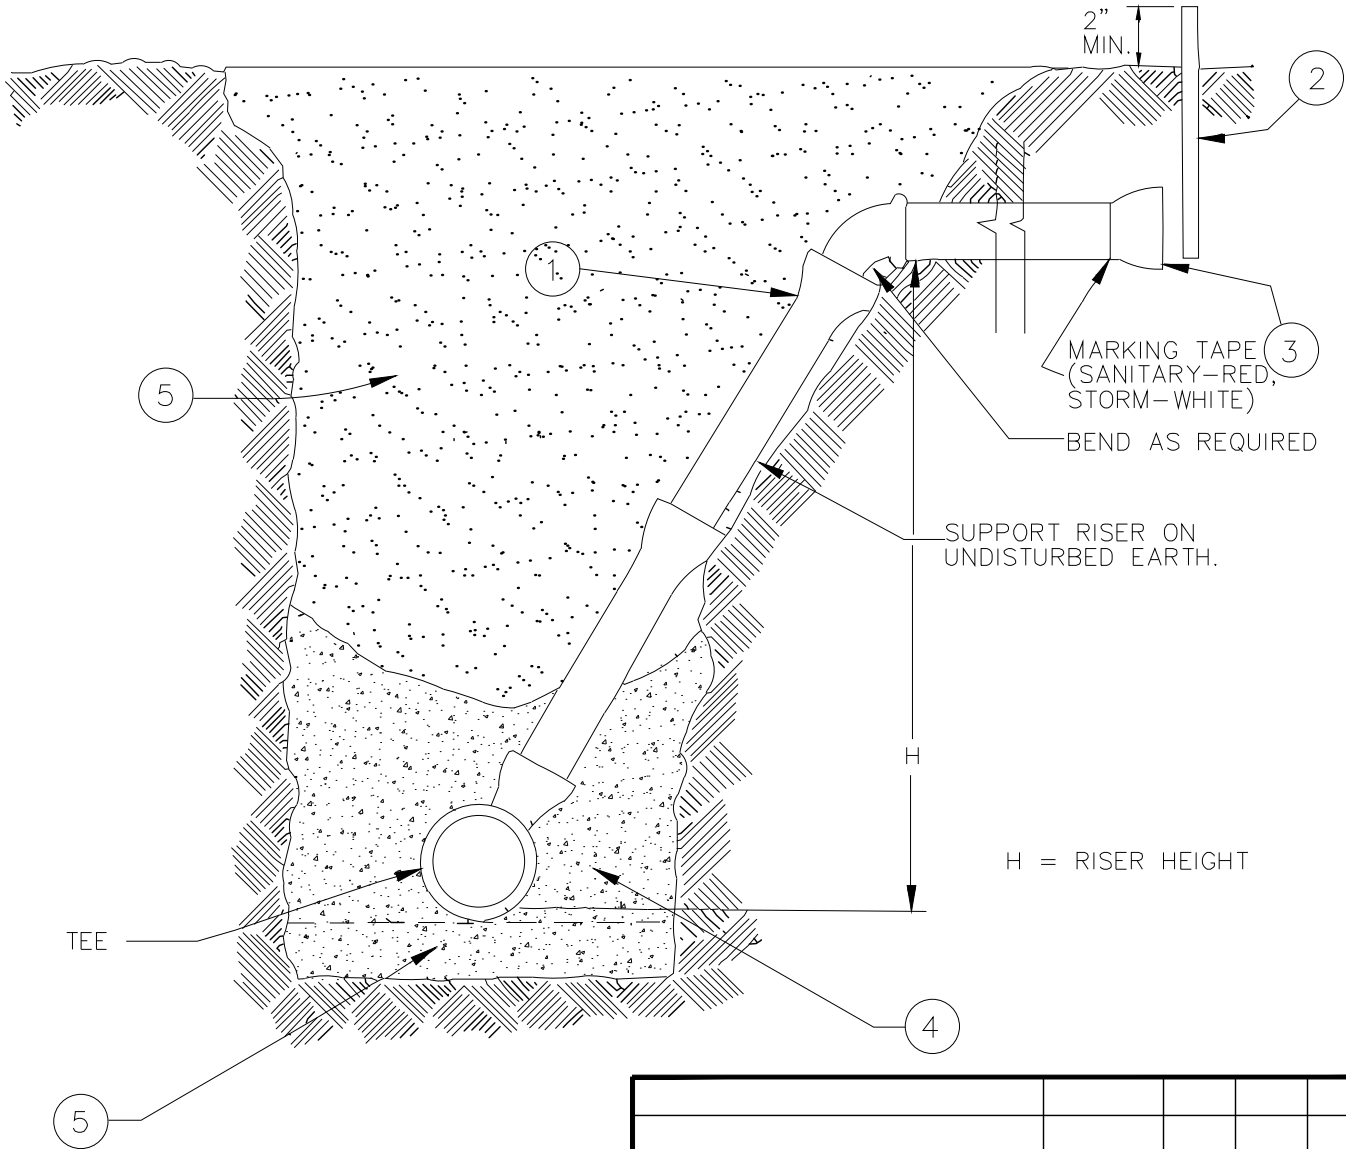

NOTE: A TEE SHALL BE USED AT THE SEWER MAIN IF A RISER IS USED. WYES ARE NOT TO BE USED.

REVISIONS		REV. NO.	DR. BY	CH. BY	DATE
PUBLIC SERVICES DEPARTMENT CITY OF ANN ARBOR					
SANITARY SEWER CONNECTION WITH RISER					
DR. BY	DF	CH. BY	CSS	DRAWING NO.	
SCALE	NONE	DATE	11-6-92	SD-S-7	
INCH	0  1			SHEET NO. ____ OF ____	