


1300T-20AAA BITUMINOUS MATERIAL TO MATCH EXISTING THICKNESS (MIN. 3") PLACED IN LIFTS NOT TO EXCEED 2" IN DEPTH AND COMPACTED TO 97% OF THE MARSHALL CONTROL DENSITY.

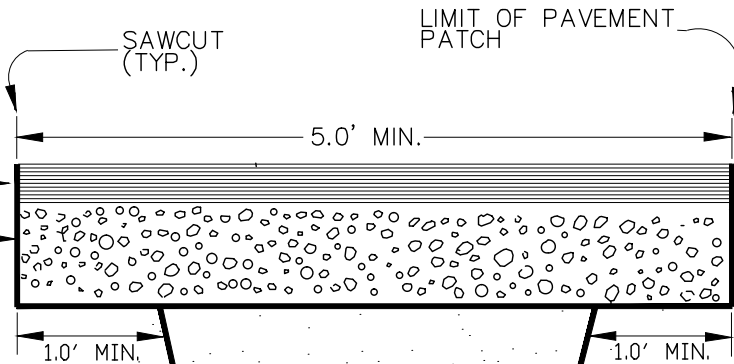

21-AA OR 22-AA TO MATCH EXISTING THICKNESS MIN. 8" COMPACTED TO 98% MAXIMUM DENSITY

CLASS II GRANULAR MATERIAL COMPACTED TO 95% MAXIMUM DENSITY PER CITY OF ANN ARBOR STANDARDS (SEE DIVISION IV REGARDING BACKFILL FOR PVC SEWERS.)


MIN. TRENCH WIDTH PER CITY OF ANN ARBOR STANDARDS

MINIMUM PIPE BEDDING PER CITY OF ANN ARBOR SPECIFICATION (4' MIN.)

NOTE: DENSITY TESTING PER CITY ANN ARBOR SPECIFICATION

NOTE: TRENCH DETAILS SHOW TYPE OF BACKFILL AND SURFACE RESTORATION ONLY.

NOTE: ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. STANDARDS

REVISIONS					REV. NO.	DR. BY	CH. BY	DATE
PUBLIC SERVICES DEPARTMENT CITY OF ANN ARBOR								
UTILITY TRENCH—TYPE I (UNDER BITUMINOUS SURFACE)								
DR. BY	DF	CH. BY	CSS	DRAWING NO.				
SCALE	NONE	DATE	11-6-92	SD-TD-1				
INCH	0  1			SHEET NO. _____ OF _____				