


4" MINIMUM TOPSOIL AND SEED OR SOD AS SPECIFIED, PER CITY OF ANN ARBOR STANDARDS.

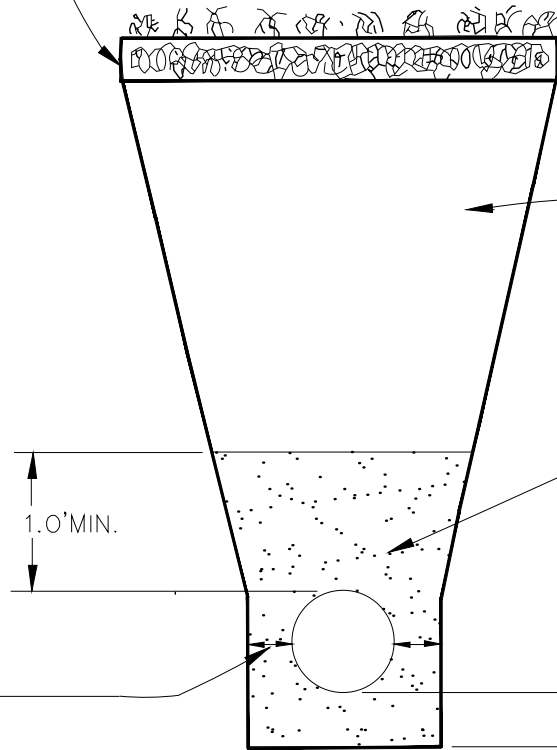

APPROVED NATIVE MATERIAL COMPACTED TO 90% MAXIMUM DENSITY

CLASS II GRANULAR MATERIAL COMPACTED TO 95% MAXIMUM DENSITY PER CITY OF ANN ARBOR STANDARDS. (SEE DIVISION IV REGARDING BACKFILL FOR PVC SEWERS)

1.0' MIN.

MINIMUM TRENCH WIDTH PER CITY OF ANN ARBOR STANDARDS

MINIMUM PIPE BEDDING PER CITY OF ANN ARBOR SPECIFICATIONS(4" MIN.)

NOTE: TRENCH DETAILS SHOW TYPE OF BACKFILL AND SURFACE RESTORATION ONLY.

NOTE: ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. STANDARDS.

NOTE: DENSITY TESTING PER CITY OF ANN ARBOR SPECIFICATIONS.

REVISIONS					REV. NO.	DR. BY	CH. BY	DATE
PUBLIC SERVICES DEPARTMENT CITY OF ANN ARBOR								
UTILITY TRENCH—TYPE V (IN GREENBELT AREA OUTSIDE PAVEMENT INFLUENCE)								
DR. BY	DF	CH. BY	CSS	DRAWING NO.				
SCALE	NONE	DATE	11-6-92	SD-TD-5				
INCH	0 1			SHEET NO. _____ OF _____				