


4" MINIMUM TOPSOIL AND SEED OR SOD AS SPECIFIED, PER CITY OF ANN ARBOR STANDARDS

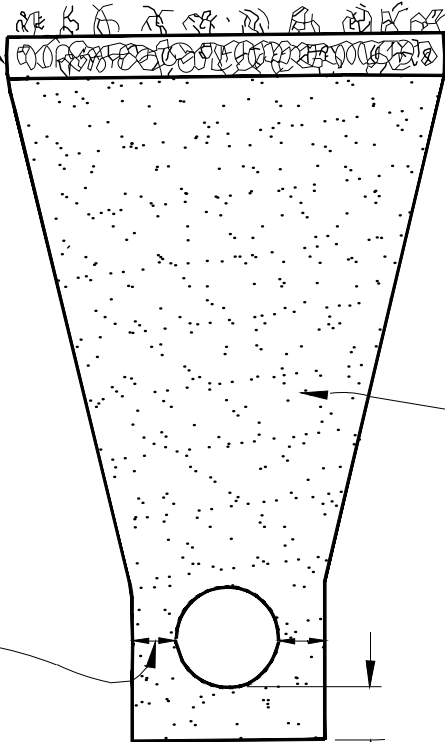

CLASS II GRANULAR MATERIAL., (2NS IF PERFORATED PIPE) COMPACTED TO 95% MAXIMUM DENSITY PER CITY OF ANN ARBOR STANDARDS (SEE DIVISION IV REGARDING BACKFILL FOR PVC SEWERS)


MIN. TRENCH WIDTH PER CITY OF ANN ARBOR STANDARDS.

MINIMUM PIPE BEDDING PER CITY OF ANN ARBOR SPECIFICATIONS(4" MIN.)

NOTE: TRENCH DETAILS SHOW TYPE OF BACKFILL AND SURFACE RESTORATION ONLY.

NOTE: DENSITY TESTING PER CITY OF ANN ARBOR SPECIFICATIONS

NOTE: ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. STANDARDS.

REVISIONS					REV. NO.	DR. BY	CH. BY	DATE
<b>PUBLIC SERVICES DEPARTMENT CITY OF ANN ARBOR</b>								
UTILITY TRENCH—TYPE VI (IN GREENBELT AREA REQUIRING CLASS II BACKFILL)								
DR. BY	DF	CH. BY	CSS	DRAWING NO.				
SCALE	NONE	DATE	11-6-92	SD-TD-6				
INCH	0  1			SHEET NO. _____ OF _____				