


4" MINIMUM TOPSOIL AND SEED OR SOD AS SPECIFIED, PER CITY OF ANN ARBOR STANDARDS

APPROVED NATIVE MATERIAL COMPACTED TO 90% MAXIMUM DENSITY.

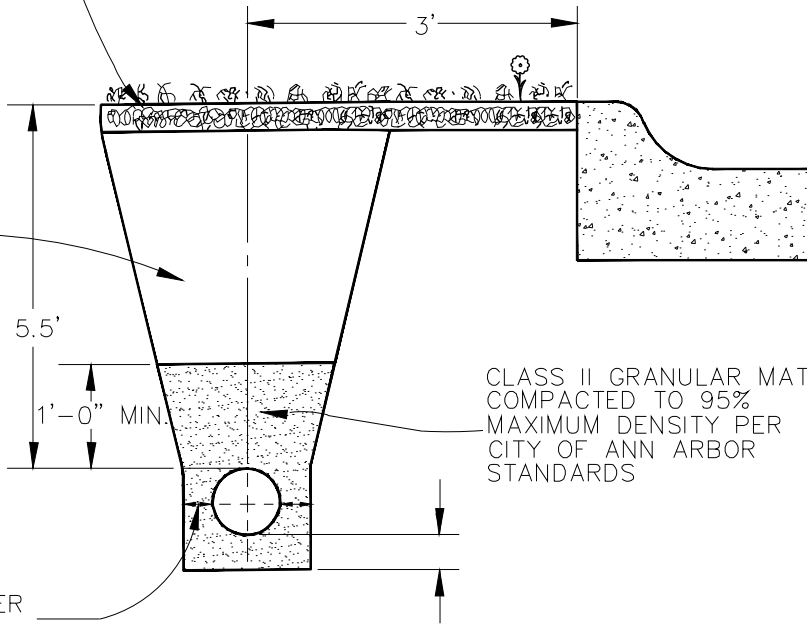

CLASS II GRANULAR MATERIAL COMPACTED TO 95% MAXIMUM DENSITY PER CITY OF ANN ARBOR STANDARDS


MINIMUM PIPE BEDDING PER CITY OF ANN ARBOR SPECIFICATIONS (4" MIN.)

MINIMUM TRENCH WIDTH PER CITY OF ANN ARBOR STANDARDS.

NOTE: ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. STANDARDS.

NOTE: DENSITY TESTING PER CITY OF ANN ARBOR SPECIFICATIONS

NOTE: TRENCH DETAILS SHOW TYPE OF BACKFILL AND SURFACE RESTORATION ONLY.

REVISIONS					REV. NO.	DR. BY	CH. BY	DATE
PUBLIC SERVICES DEPARTMENT CITY OF ANN ARBOR								
UTILITY TRENCH—TYPE VIII (WATERMAIN AT TYPICAL CITY OF ANN ARBOR LOCATION 3' BEHIND B/C)								
DR. BY	DF	CH. BY	CSS	DRAWING NO.				
SCALE	NONE	DATE	11-6-92	SD-TD-8				
INCH	0  1			SHEET NO. ____ OF ____				