

ADDENDUM No. 2

RFP No. 26-17

S Maple, Arbordale St, Sherwood St, and Sherwood Cir Improvements

Due: Tuesday, March 17, 2026 at 11:00 A.M. (local time)

The information contained herein shall take precedence over the original documents and all previous addenda (if any), and is appended thereto. **This Addendum includes 3 pages.**

The Proposer is to acknowledge receipt of this Addendum No. 2 by signing and submitting Attachment B, including all attachments in its Proposal by so indicating in the proposal that the addendum has been received. Proposals submitted without acknowledgement of receipt of this addendum may be considered non-conforming.

The following forms provided within the RFP Document should be included in submitted proposal:

- Attachment B – General Declarations
- Attachment D - Prevailing Wage Declaration of Compliance
- Attachment E - Living Wage Declaration of Compliance
- Attachment G - Vendor Conflict of Interest Disclosure Form
- Attachment H - Non-Discrimination Declaration of Compliance

Proposals that fail to provide these completed forms listed above upon proposal opening may be rejected as non-responsive and may not be considered for award.

I. CORRECTIONS/ADDITIONS/DELETIONS


Changes to the RFP documents which are outlined below are referenced to a page or Section in which they appear conspicuously. Offerors are to take note in its review of the documents and include these changes as they may affect work or details in other areas not specifically referenced here.

Section/Page(s)	Change
Appendix Addition	8" and 10" Cla-Val Check Valve & Vault Details added as Appendix 2


II. QUESTIONS AND ANSWERS

None.

8" Cla-Val Model 586 Check Valve and Vault

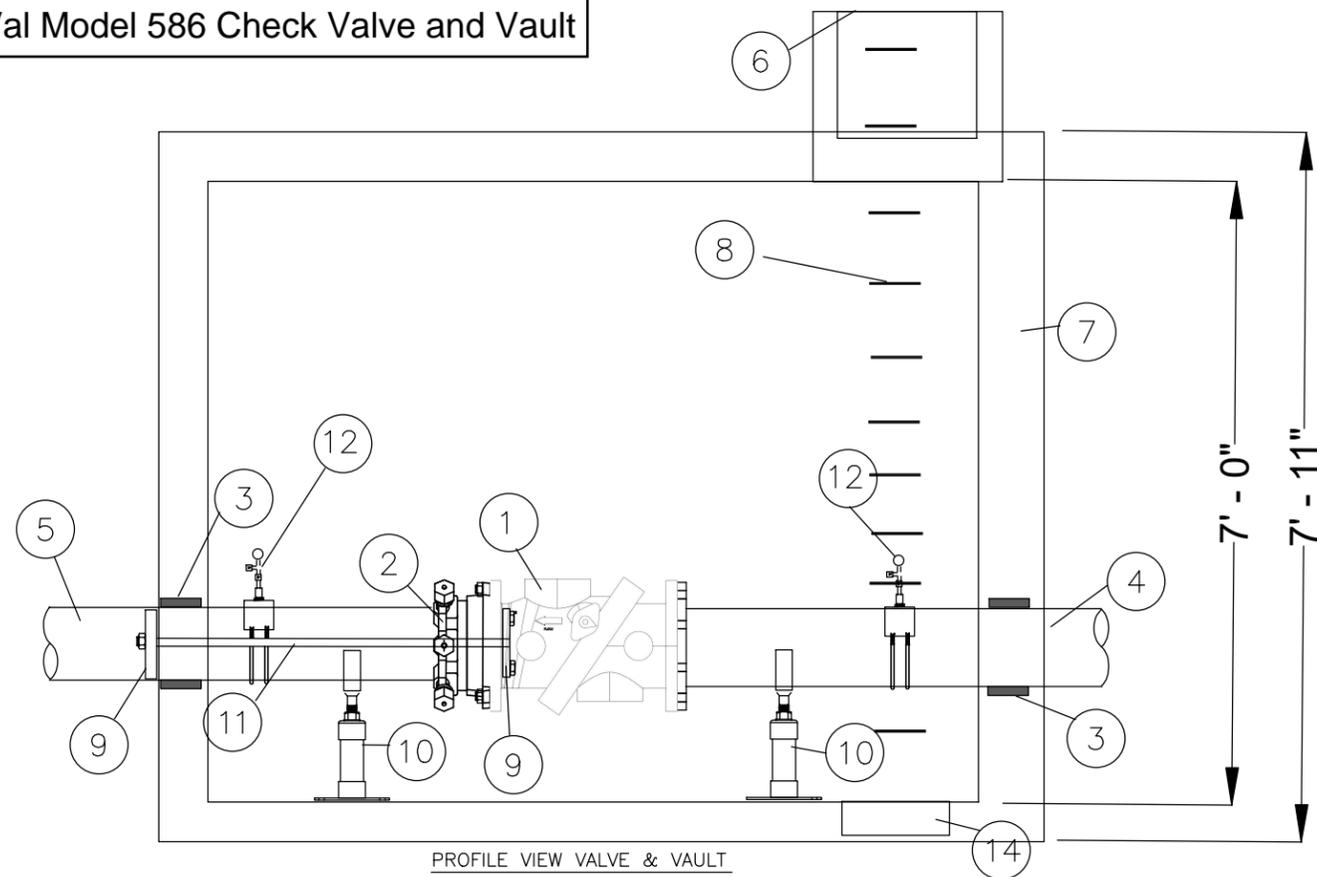


PROFILE VIEW VALVE & VAULT

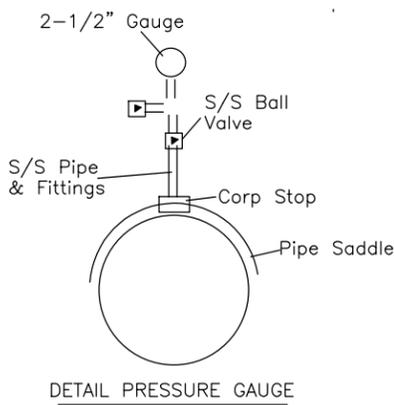


DETAIL PRESSURE GAUGE

BoM = Bill of Materials		
ITEM #	Qty.	DESCRIPTION
1	x1	8" Cla-Val Model 586 Pivoting Disc Check Valve
2	x1	8" Restrained Flange Adapter
3	x2	Pipe Penetration Seal
4	x1	8" Ductile Iron Pipe (inlet)
5	x1	" Ductile Iron Pipe (outlet)
6	x1	ej Ring & Cover Model V2600-5 Assy. 38"dia
7	x1	Precast Concrete Vault
8	x8	STEPS (as needed 12" OC)
9	x2	Thrust Plates
10	x2	S/S Pipe Supports
11	x2	Thrust Rods & Hardware (nuts)
12	x2	Saddel, Corp Stop, Fittings, Ball Valves, gauge (0-100psi)
13	x1	Sump Crock Only (NO Pump)

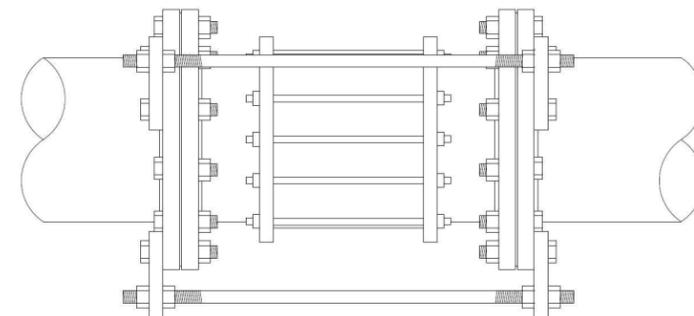


Side View

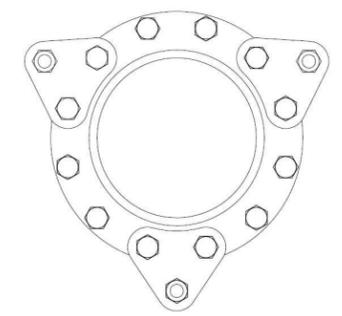


End View

Standon Model TP 102 - TP 130
THRUST RETENTION PLATE SPECIFICATIONS FOR ANSI B16.1 125 FLANGES


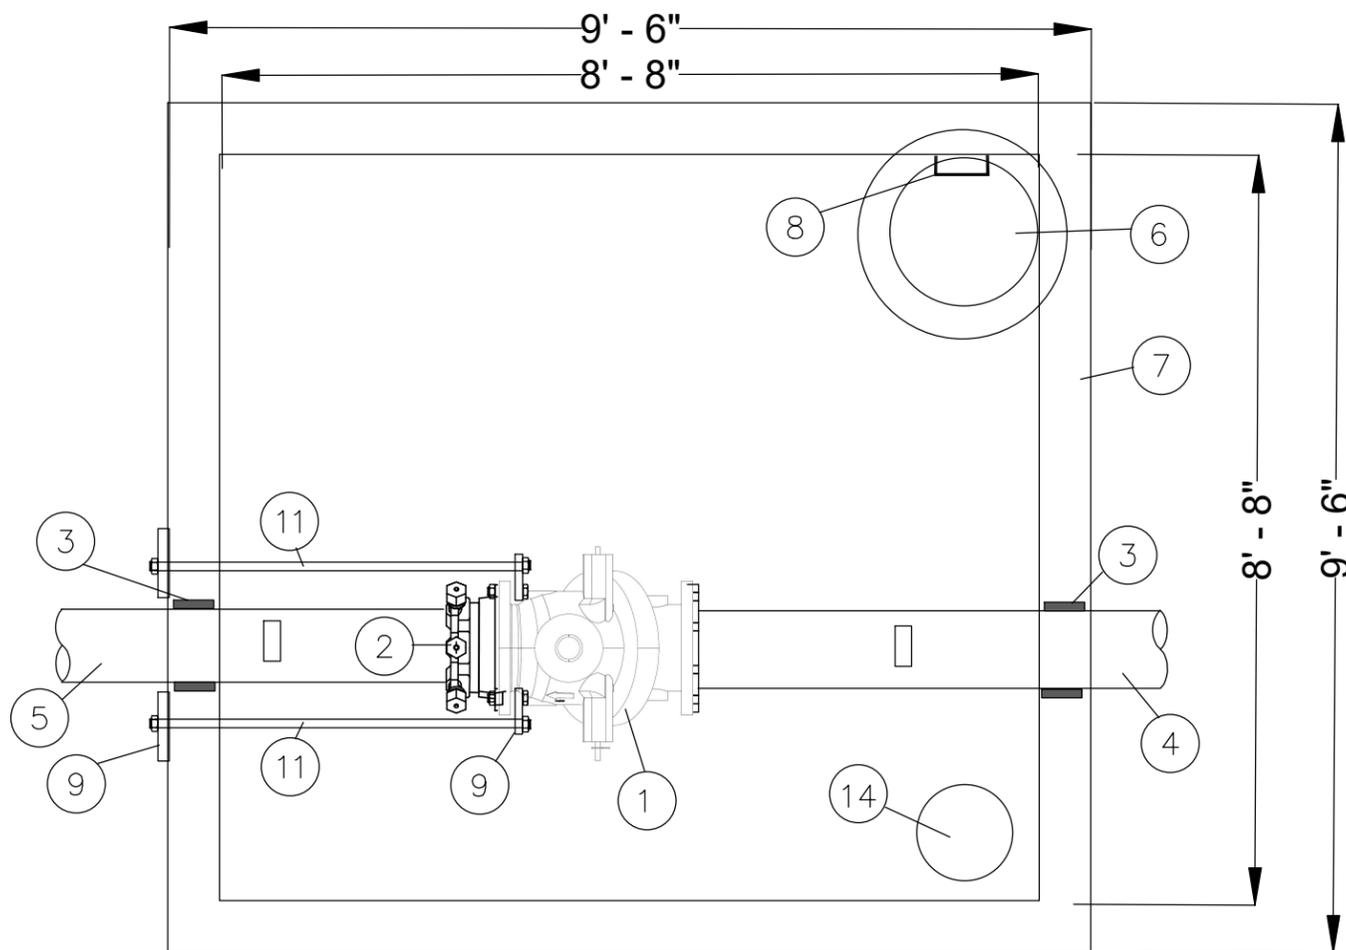


PLAN VIEW VALVE & VAULT

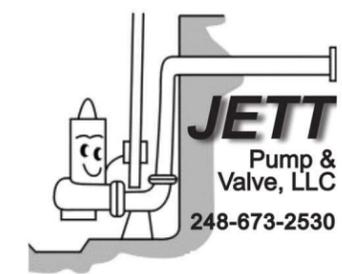


v1.1
Contact:
Matthew Karam
Office: 248-673-2530
e-mail: mkaram@jettump.com

10" Cla-Val Model 586 Check Valve and Vault

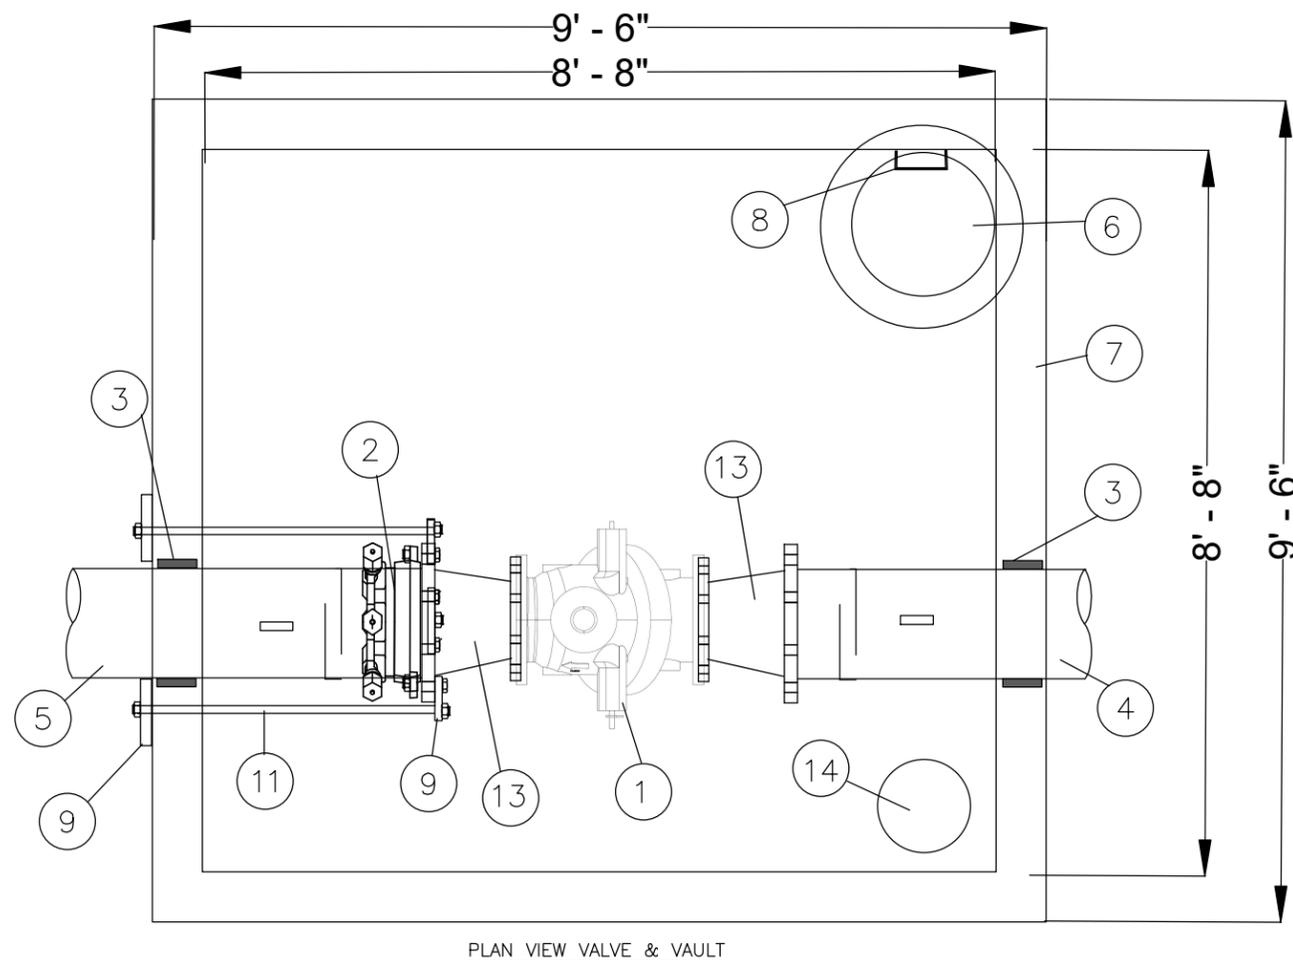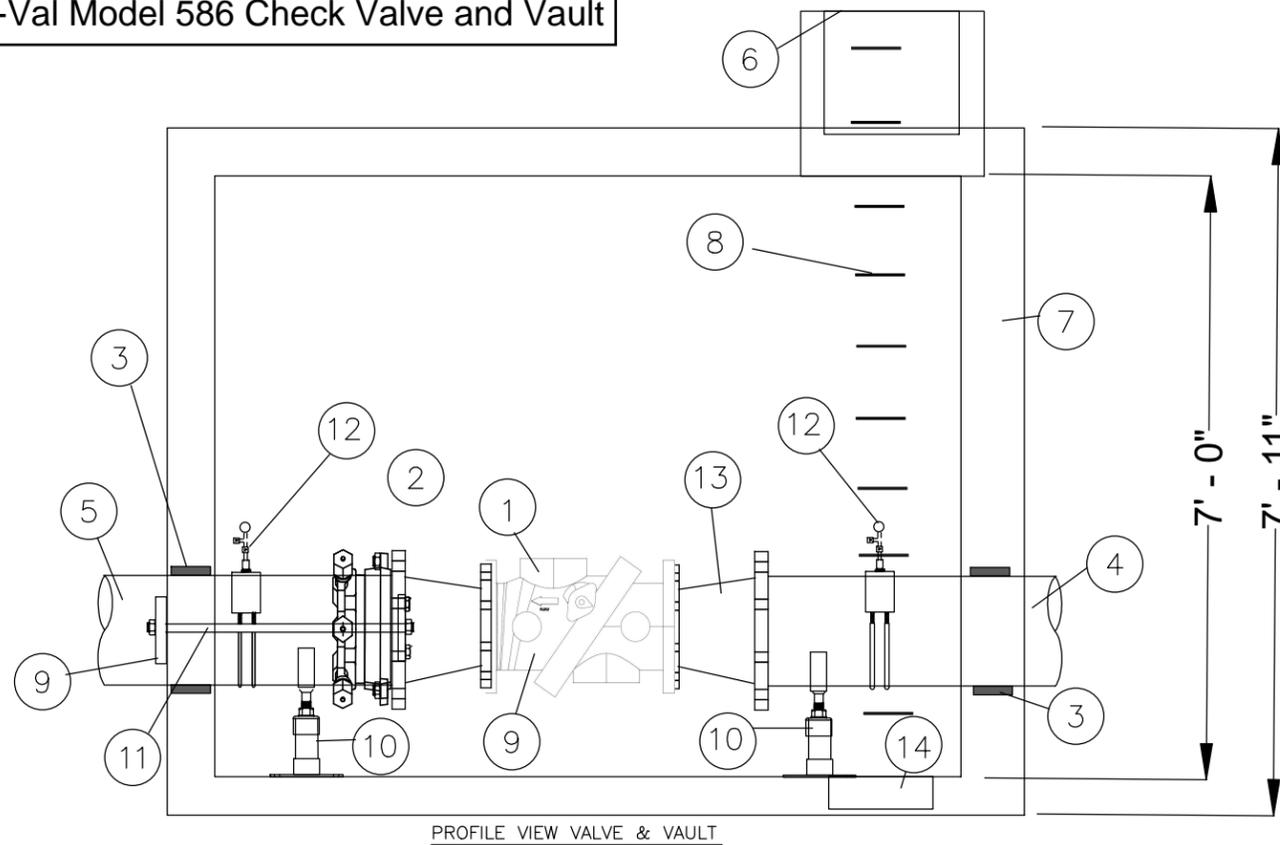

BoM = Bill of Materials

ITEM #	Qty.	DESCRIPTION
1	x1	10" Cla-Val Model 586 Pivoting Disc Check Valve
2	x1	12" Restrained Flange Adapter
3	x2	Pipe Penetration Seal
4	x1	12" Ductile Iron Pipe (inlet)
5	x1	12" Ductile Iron Pipe (outlet)
6	x1	Aluminum Access Hatch 32" x 32"
7	x1	Precast Concrete Vault
8	x8	STEPS (as needed 12" OC)
9	x2	Thrust Plates
10	x2	S/S Pipe Supports
11	x2	Thrust Rods & Hardware (nuts)
12	x2	Saddel, Corp Stop, Fittings, Ball Valves, gauge (0-100psi)
13	x2	12" x 10" Flanged Reducer
14	x1	Sump Crock Only (NO Pump)

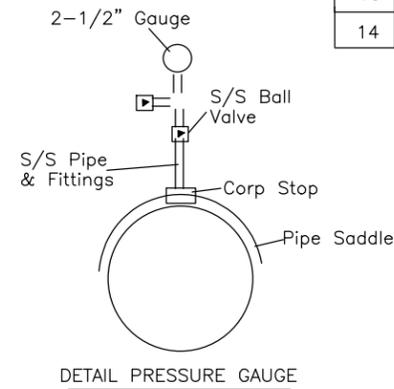

Contact:
 Matthew Karam
 Office: 248-673-2530
 e-mail: mkaram@jettump.com
 v1.1

