	Sheet List Table	
Sheet Number	Sheet Title	
SHEET INDEX		
1 OF 3	SHEET INDEX	
2 OF 3	SHEET INDEX	
3 OF 3	SHEET INDEX	
4 OF 4	SHEET INDEX	
GENERAL UTILITY		
SD-GU-1	STANDARD CASTING SCHEDULE	
SD-GU-2	SPECIAL STRUCTURE COVER WATER	
SD-GU-3	SPECIAL STRUCTURE COVER STORM	
SD-GU-4	SPECIAL STRUCTURE COVER SANITARY	
SD-GU-5A	STRUCTURE COVER ADJUST	
SD-GU-5B	STRUCTURE COVER ADJUST	
SD-GU-6	VALVE AND MONUMENT BOX ADJUSTMENT	
SD-GU-7	MANHOLE AND VALVE MONUMENT BOX LOWERING	
SD-GU-8	STRUCTURE PLATE	
SD-GU-9	UTILITY LOCATION PLAN (66' R.O.W. WITH 24' PAVEMENT)	
SD-GU-10	UTILITY LOCATION PLAN (66' R.O.W. WITH 28' PAVEMENT)	
SD-GU-11	UTILITY LOCATION PLAN (70' R.O.W.)	
SANITARY SEWER		
SD-SN-1	SANITARY MANHOLE	
SD-SN-2	DROP M.H. CONNECTION	
SD-SN-3	SANITARY SEWER CONNECTION WITH RISER	
SD-SN-4	SANITARY LEAD RELOCATION	
SD-SN-5	SANITARY SEWER DEPTH	
WATER		
SD-W-1	FIRE HYDRANT ASSEMBLY	
SD-W-2	THRUST BLOCK	
SD-W-3	PRECAST GATE WELL (WATERMAINS 16 INCH AND SMALLER)	
SD-W-4	PRECAST GATE WELL (BUTTERFLY VALVES)	
SD-W-5	PRECAST GATE WELL FOR TAPPING SLEEVE AND VALVE	
SD-W-6	TYPICAL PIPE CASING DETAIL	
SD-W-7	POLYETHYLENE ENCASEMENT	
SD-W-8	DOMESTIC AND FIRE SERVICE CONFIGURATIONS	
METER		
SD-MT-1	FIRE SERVICE METERING	
SD-MT-2	FIRE SERVICE METERING - FIRE PUMP SYSTEM	
SD-MT-3	ELECTROMAGNETIC METER INSTALLATION	
SD-MT-4	ULTRASONIC METER INSTALLATION 0.75 INCH AND 1 INCH	
SD-MT-5	ULTRASONIC METER INSTALLATION 1.5 INCH AND 2 INCH	



00	09/01/2025	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		1 OF 4

Sheet List Table			
Sheet Number	Sheet Title		
STORM SEWER			
SD-ST-1A	STANDARD STORM MANHOLE (SEPARATE BASE)		
SD-ST-1B	STANDARD STORM MANHOLE (PRECAST AND LEACHING BASES)		
SD-ST-2	PRECAST JUNCTION INLET		
SD-ST-3	PRECAST SINGLE INLET		
SD-ST-4	PRECAST HIGH CAPACITY INLET		
SD-ST-5	BLOCK JUNCTION INLET		
SD-ST-6	BLOCK SINGLE INLET		
SD-ST-7	BLOCK HIGH CAPACITY INLET		
CURB & GUTTER			
SD-CG-1	BARRIER CURB AND GUTTER		
SD-CG-2	MOUNTABLE CURB AND GUTTER FOR ASPHALT STREETS		
SD-CG-3	MOUNTABLE CURB AND GUTTER FOR CONCRETE STREETS		
SD-CG-4	SPILL-OUT BARRIER CURB AND GUTTER		
DRIVEWAY & SIDE	NALK		
SD-DS-1	TYPE M DRIVE APPROACH FOR ASPHALT STREETS WITH BARRIER CURB		
SD-DS-2	MODIFIED M DRIVE APPROACH FOR CONCRETE STREETS WITH BARRIER CURB		
SD-DS-3	TYPE L DRIVE APPROACH FOR STREETS WITH MOUNTABLE CURB		
SD-DS-4	SIDEWALK AND CURB & GUTTER JOINTS		
SD-DS-5	SIDEWALK CROSS SECTION		
SD-DS-6	DRIVEWAY CULVERT		
STREETLIGHTS			
SD-SL-1	STREETLIGHT FOUNDATION		
SD-SL-2	TRAFFIC SIGNAL POLE FOUNDATION		
SD-SL-3	PEDESTRIAN SIGNAL POLE FOUNDATION		
COMMUNICATIONS	S AND ELECTRICAL		
SD-E-1	COMMUNICATIONS HANDHOLE ASSEMBLY		
SD-E-2	CONDUIT PLACEMENT DETAIL		
SD-E-3	ELECTRICAL HANDHOLE ASSEMBLY		
SOIL EROSION			
SD-SESC-1	INLET PROTECTION		
SD-SESC-2	STONE FILTER		
SD-SESC-3	SILT FENCE		
SD-SESC-4	MULCH BLANKET		
SD-SESC-5	MUD MAT		
SD-SESC-6	STANDARD SOIL EROSION AND SEDIMENTATION CONTROL NOTES		
SD-SESC-7	SEQUENCE OF SOIL EROSION CONTROL MEASURES		



00	09/01/2025	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	2 OF 4

	Sheet List Table	
Sheet Number	Sheet Title	
LANDSCAPING		
SD-L-1	TREE PLANTING	
SD-L-2	TREE STAKING	
SD-L-3	TREE PROTECTION	
SD-L-4	TREE TUNNELLING	
TRENCH		
SD-TD-1	UTILITY TRENCH - TYPE 1	
SD-TD-2	UTILITY TRENCH - TYPE 2	
SD-TD-3	UTILITY TRENCH - TYPE 3	
SD-TD-4.1	UTILITY TRENCH SURFACE RESTORATION	
SD-TD-4.2	UTILITY TRENCH SURFACE RESTORATION	
SD-TD-5	TYPICAL EDGE DRAIN TRENCH	
SD-TD-6	HMA REPAIR OF CONCRETE PAVEMENT	
SOLID WASTE		
SD-SW-1	SINGLE BIN ENCLOSURE	
SD-SW-2	DOUBLE BIN ENCLOSURE	
SD-SW-3	STANDARD BIN ENCLOSURE LAYOUTS	
SD-SW-4	SWEPT PATH REQUIREMENTS FOR FRONT LOAD SOLID WASTE VEHICLE	
SD-SW-5	SOLID WASTE VEHICLE TURN-AROUND	
SD-SW-6A	SOLID WASTE GENERAL NOTES	
SD-SW-6B	SOLID WASTE GENERAL NOTES	
MISCELLANEOUS		
SD-M-1	MAILBOX NEWSPAPER TUBE INSTALLATION AND RELOCATION	
SD-M-2	VERTICAL CONTROL MONUMENT	
SD-M-3	STEEL PIPE BOLLARD	
SD-M-4	CHAIN LINK FENCE	
SD-M-5	STEP CHAIN LINK FENCE	
SD-M-6	URBAN GUARDRAIL LOCATION	
TEMPORARY PEDE	ESTRIAN FACILITIES	
SD-TPR-1	DETOUR 1	
SD-TPR-2	DETOUR 2	
SD-TPR-3	BYPASS A	
SD-TPR-4	BYPASS B	
SD-TPR-5	BYPASS C	
SD-TPR-6	TEMPORARY RAMPS	
SD-TPR-7	WALKWAY DEVICES 1	
SD-TPR-8	WALKWAY DEVICES 2	



L				
	00	09/01/2025	A2D	SSORT
	REV. NO.	DATE	DRAWN BY	CHECKED BY

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		3 OF 4

Sheet List Table				
Sheet Number	Sheet Title			
RAISED VERTICAL	DEVICES			
SD-VT-1	SPEED HUMP			
SD-VT-2	SPEED HUMP SECTION B-B & DETAIL 1			
SD-VT-3	SPEED TABLE			
SD-VT-4	SPEED TABLE SECTION B-B & DETAIL 1			
SD-VT-5	SPEED HUMP & SPEED TABLE SECTION A-A			
SD-VT-6	RAISED CROSSWALK			
SD-VT-7	RAISED CROSS WALK SECTION A-A			
DDA				
SD-DDA-1	DDA SIDEWALK CROSS SECTION			
SD-DDA-2	DDA SIDEWALK AND AMENITY ZONE PLAN VIEW			
SD-DDA-3	DDA CONCRETE SIDEWALK			
SD-DDA-4	PAVER SECTION 1 - PAVERS ABOVE INTEGRAL CONCRETE SLAB			
SD-DDA-5	DDA PAVER SECTION 2 - POROUS PAVERS AT PLANTER AND TREE GRATE			
SD-DDA-6	DDA PAVER SECTION 3 - POROUS PAVERS ADJ. TO CONCRETE SIDEWALK			
SD-DDA-7	DDA PAVER SECTION 4 - POROUS PAVERS ADJ. TO CONCRETE CURB			
SD-DDA-8	DDA PAVER SECTION 5 - POROUS PAVERS AT PLANTER			
SD-DDA-9	DA CONCRETE CURB			
SD-DDA-10	DDA BIKE HOOP SURFACE MOUNTED			
SD-DDA-11	DDA RAISED PLANTER WITH CURB			
SD-DDA-12	DDA TREE PIT WITH GRATE			
SD-DDA-13	DDA TREE GRATE DETAIL			
SD-DDA-14	DDA TREE GRATE FRAME INSTALLATION			
SD-DDA-15	DDA PLANTING ZONE BETWEEN TREE PITS			
SD-DDA-16	DDA VEGETATED SWALE AND RAIN GARDEN			
SD-DDA-17	DDA LIGHT POLE FOUNDATION			
SD-DDA-18	DDA BENCH DETAIL			
SD-DDA-19	VAULT PREPARATION			
SD-DDA-20	VAULT OPENING 4 OR LESS			
SD-DDA-21	VAULT OPENING GREATER THAN 4			



L				
	00	09/01/2025	A2D	SSORT
	REV. NO.	DATE	DRAWN BY	CHECKED BY

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	4 OF 4

TYPE OF CASTING	MDOT DESIGNATION	EJ CASTING NO.	NEENAH CASTING NO.
MANHOLE AND GATE WELL FRAME AND COVER	Q/B	1040Z W/ TYPE A COVER*	R-1642 W/ TYPE C COVER*
BARRIER CURB INLET FRAME AND COVER	К	7045Z W/ TYPE M1 GRATE	R-3031-B W/ TYPE S GRATE
BARRIER CURB LOW POINT INLET FRAME AND COVER	К	7035Z W/ TYPE M2 GRATE	N/A
GUTTER INLET FRAME AND COVER	R	5080Z W/ TYPE 5000M2 GRATE	R-3448C, W/ TYPE S GRATE
HIGH CAPACITY INLET FRAME AND COVER		7034Z W/ TYPE M GRATE	N/A
MOUNTABLE CURB INLET ASSEMBLY		7065	N/A
YARD DRAIN (BEE HIVE) FRAME AND COVER	G	1040Z, TYPE 02 GRATE	R-2560-E1
WATER VALVE BOX ASSEMBLY IN PAVEMENT		8560	N/A
MONUMENT BOX ASSEMBLY		8360	N/A
ADA COMPLIANT		5000Z4 W/ TYPE M5 GRATE	

*EACH COVER SHALL HAVE "SANITARY", "STORM", OR "WATER" CAST IN THE SURFACE, WHICHEVER IS APPLICABLE. SANITARY SEWER COVERS SHALL BE GASKETED IN FLOOD PRONE AREAS AS SHOWN ON THE PLANS OR AS DIRECTED BY THE PSAA. FRAMES AND COVERS MUST HAVE MACHINED BEARING SURFACES.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


	00	10/17/2024	A2D	SSORT
REV.	. NO.	DATE	DRAWN BY	CHECKED BY


STANDARD CASTING SCHEDULE

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-1

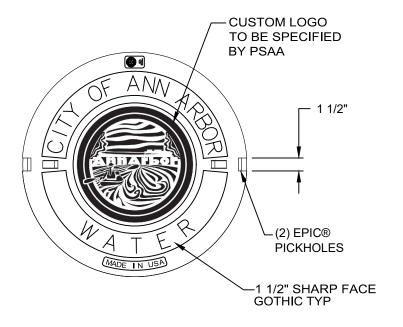



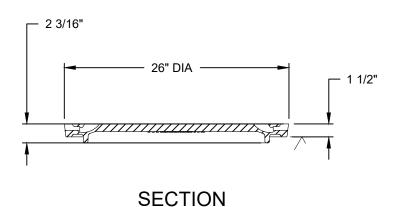



EPIC® DETAIL

EJ PRODUCT #001040570





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


REV. NO.	DATE	DRAWN BY	CHECKED BY


SPECIAL STRUCTURE COVER WATER

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-2

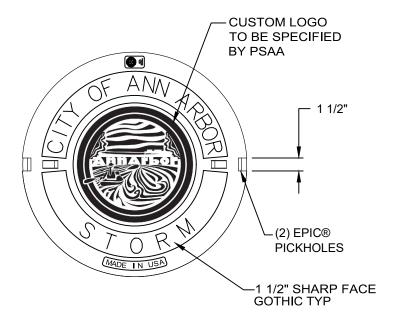



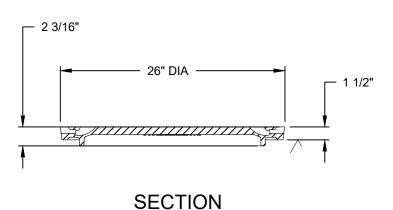



EPIC® DETAIL

EJ PRODUCT #001040571





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY


SPECIAL STRUCTURE COVER STORM


DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-3

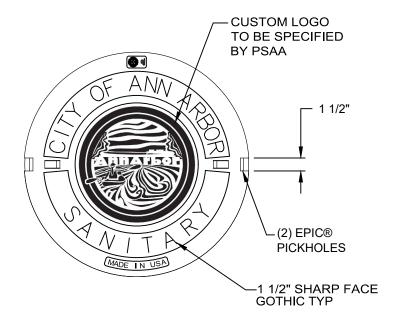



BOTTOM VIEW

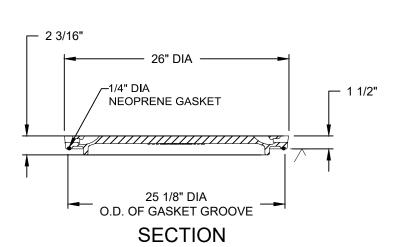





EPIC® DETAIL

EJ PRODUCT #001040572




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV	. NO.	DATE	DRAWN BY	CHECKED BY

SPECIAL STRUCTURE COVER SANITARY

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-4

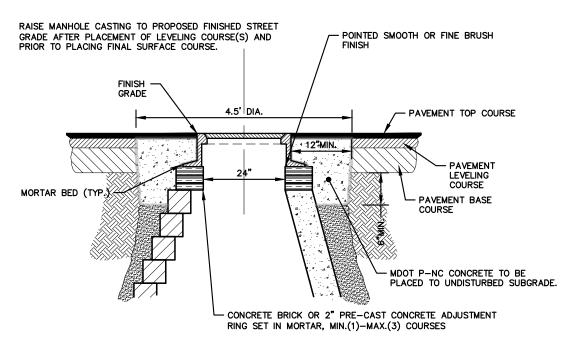

- IF MANHOLE WILL BE PLACED IN GRAVEL ROAD, CASTING TO BE SET 6" TO 8" BELOW ROADWAY GRADE. ALL CONSTRUCTION METHODS SHALL REMAIN AS SHOWN ABOVE.
- P-NC CONCRETE MIXTURE SHALL CONTAIN 658 POUNDS PER CUBIC YARD (7 SACKS) OF CEMENT WHEN THE FORECASTED AIR TEMPERATURE IS ABOVE 59°F AND 752 POUNDS PER CUBIC YARD (8 SACKS) OF CONCRETE WHEN THE FORECASTED AIR TEMPERATURE IS 59°F OR LESS.
- 3. CONSTRUCT EPOXY COATED LANE TIES TO ANCHOR THE CONCRETE TO ADJACENT COMPOSITE PAVEMENT OR CONCRETE SURFACE COURSE, AS NECESSARY.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


01 09/01/2025		A2D	SSORT
00	8/20/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

STRUCTURE COVER ADJUST

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-5A

PLAN VIEW

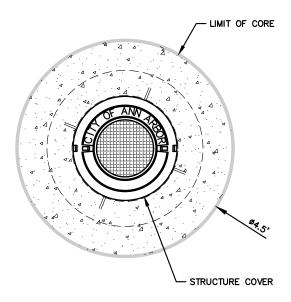

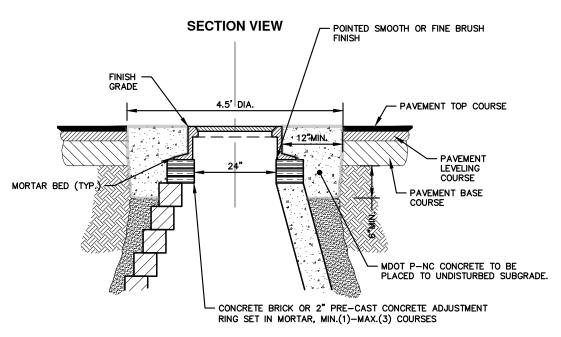

NOTES:

- IF MANHOLE WILL BE PLACED IN GRAVEL ROAD, CASTING TO BE SET 6" TO 8" BELOW ROADWAY GRADE. ALL CONSTRUCTION METHODS SHALL REMAIN AS SHOWN ABOVE.
- P-NC CONCRETE MIXTURE SHALL CONTAIN 658 POUNDS PER CUBIC YARD (7 SACKS) OF CEMENT WHEN THE FORECASTED AIR TEMPERATURE IS ABOVE 59°F AND 752 POUNDS PER CUBIC YARD (8 SACKS) OF CONCRETE WHEN THE FORECASTED AIR TEMPERATURE IS 59°F OR LESS.
- 3. CONSTRUCT EPOXY COATED LANE TIES TO ANCHOR THE CONCRETE TO ADJACENT COMPOSITE PAVEMENT OR CONCRETE SURFACE COURSE, AS NECESSARY.



CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


01 09/01/2025		A2D	SSORT
00	8/20/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

STRUCTURE COVER ADJUST

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-5B

WATER OR GAS VALVE BOX ADJUSTMENT

MONUMENT BOX ADJUSTMENT

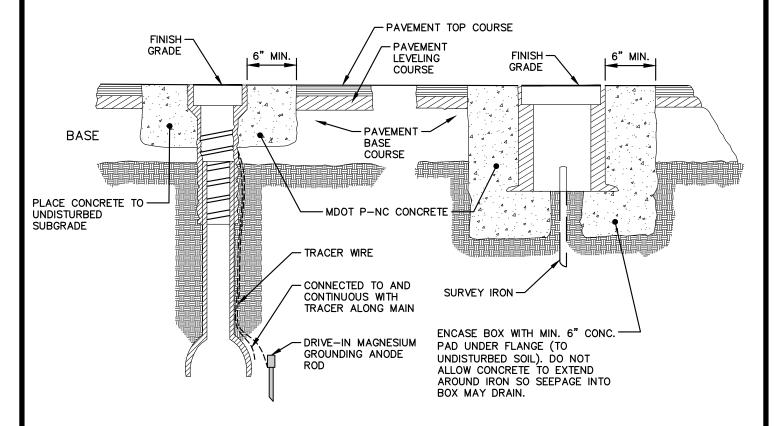

NOTES:

- 1. GAS VALVE BOXES TO BE ADJUSTED BY THE GAS COMPANY.
- 2. PLACE CENTER OF [MONUMENT] BOX OVER SURVEY IRON.
- 3. RAISE CASTINGS TO PROPOSED FINISH GRADE AFTER PLACEMENT OF FINAL SURFACE COURSE.
- 4. WHERE SERVICE VALVES ARE LOCATED WITHIN A PARKING LOT OR UNDER PAVED AREA, A CITY STANDARD GATE BOX COVER SHALL BE USED OVER THE CURB STOP, REGARDLESS OF THE SERVICE MATERIAL.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


02	12/30/2024	A2D	SSORT
01	8/20/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

VALVE AND MONUMENT BOX ADJUSTMENT

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-6

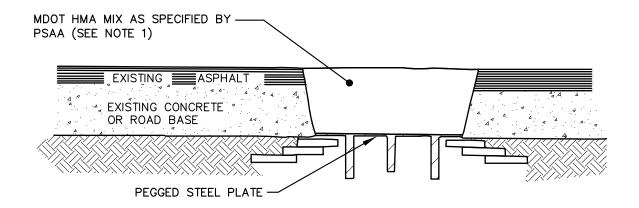

MANHOLE LOWERING DETAIL

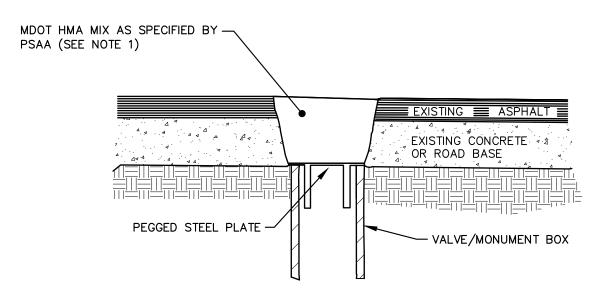

VALVE BOX/MONUMENT BOX LOWERING DETAIL (SEE NOTE 3)

NOTES:

- 1. IF TRAFFIC IS TO BE MAINTAINED ON THE ROADWAY BEFORE OR AFTER THE COLD MILLING OPERATION, THE STRUCTURE SHALL BE LOWERED TO THE EXTENT THAT A MINIMUM OF THREE(3) INCHES ASPHALT MATERIAL MOOT HMA MIX AS SPECIFIED BY PSAA. OR ENGINEER APPROVED EQUAL, REMAINS TO SUPPORT TRAFFIC.
- 2. IF THE ROADWAY BEING MILLED IS CLOSED TO TRAFFIC, THE STRUCTURE SHALL BE LOWERED SUCH THAT THE STEEL PLATE IS A MINIMUM OF FOUR(4) INCHES BELOW THE PROPOSED ROAD GRADE AND THE RESULTING VOID SHALL BE FILLED WITH MDOT HMA MIX AS SPECIFIED BY PSAA OR ENGINEER APPROVED EQUAL.
- 3. WHERE A MONUMENT IS TO BE LOWERED, THE CONTRACTOR SHALL GIVE THE ENGINEER A MINIMUM OF 48 HOURS WRITTEN NOTICE SO THAT THE MONUMENT CAN BE PROPERLY WITNESSED OR PROTECTED. FAILURE TO DO SO SHALL RESULT IN THE ENGINEER. REPLACING SAID MONUMENT AT THE CONTRACTORS EXPENSE.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV	. NO.	DATE	DRAWN BY	CHECKED BY


MANHOLE AND VALVE MONUMENT BOX LOWERING

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-7

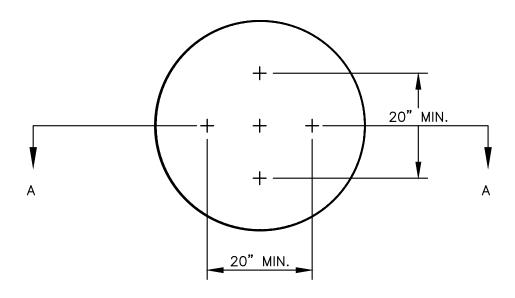

NOTE: PLATE MAY BE CIRCULAR, SQUARE OR RECTANGULAR

SECTION A - A

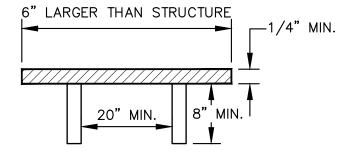

1/4" MIN. THICKNESS AND SUFFICIENT TO CARRY THE CONSTRUCTION LOAD.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

STRUCTURE PLATE

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-GU-8

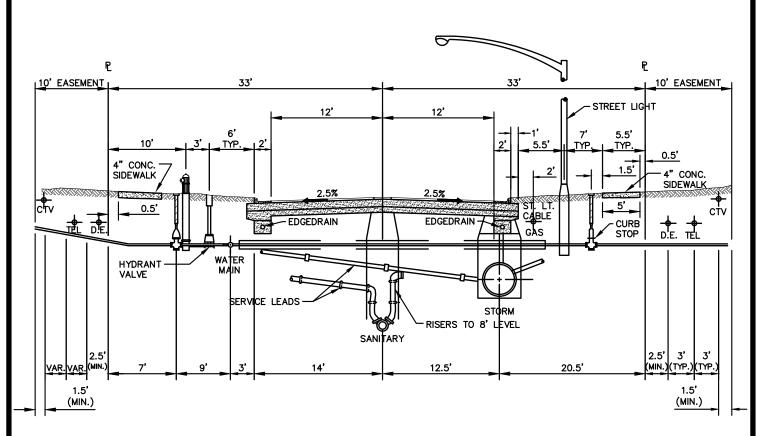

24 FT. RESIDENTIAL STREET LOOKING NORTH OR EAST




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

UTILITY LOCATION PLAN (66' R.O.W. WITH 24' PAVEMENT)

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-9

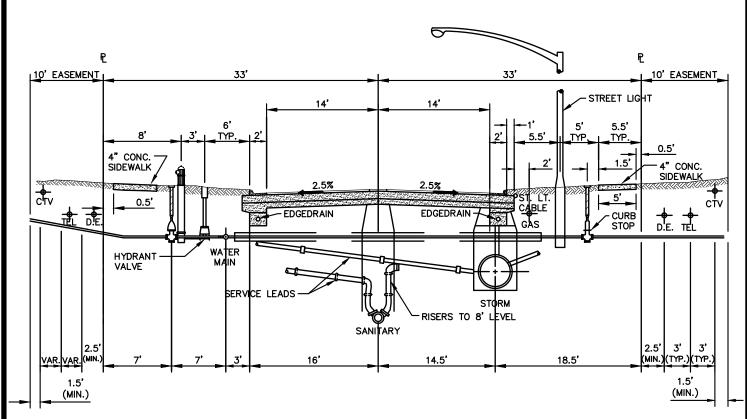

28 FT. RESIDENTIAL STREET LOOKING NORTH OR EAST




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

I				
	REV. NO.	DATE	DRAWN BY	CHECKED BY

UTILITY LOCATION PLAN (66' R.O.W. WITH 28' PAVEMENT)

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-GU-10

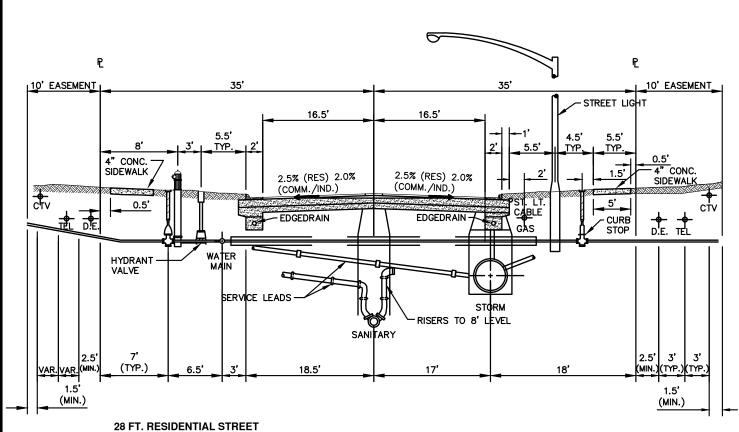

28 FT. RESIDENTIAL STREET LOOKING NORTH OR EAST




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

UTILITY LOCATION PLAN (70' R.O.W.)

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-GU-11

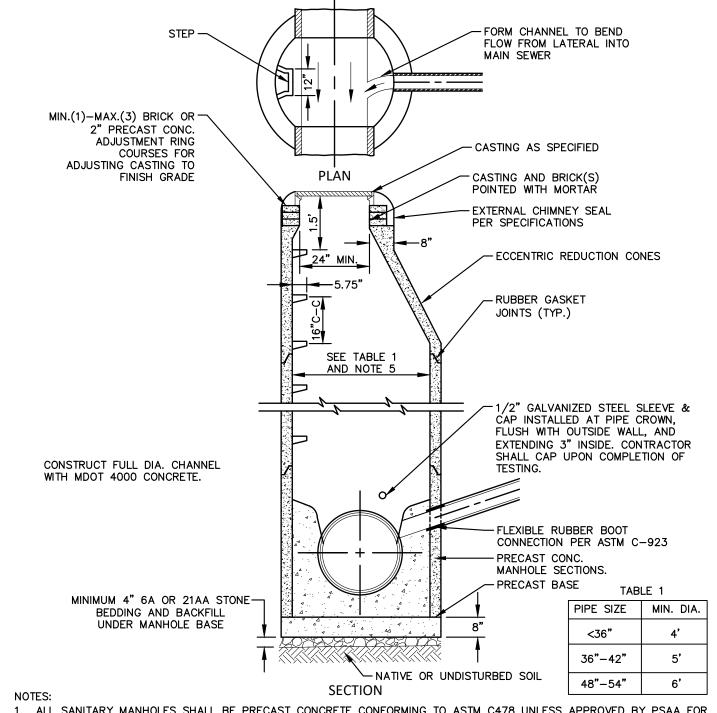


- 1. ALL SANITARY MANHOLES SHALL BE PRECAST CONCRETE CONFORMING TO ASTM C478 UNLESS APPROVED BY PSAA FOR SHALLOW APPLICATION.
- 2. ALL MANHOLES MUST HAVE ECCENTRIC CONES.
- ALL SANITARY SEWER OPENINGS SHALL BE PRECAST WITH RUBBER BOOT CONNECTIONS CONFORMING TO ASTM C923.
- 4. ALL JOINTS SHALL CONFORM TO ASTM C443.
- 5. MINIMUM MANHOLE DIAMETER SHOWN IN TABLE 1 SHALL BE INCREASED AS NEEDED BASED ON NUMBER OF PIPES AND ANGLE BETWEEN PIPES WITH 12" MIN. BETWEEN OPENINGS.
- 6. NO OPENINGS SHALL BE MADE IN PRECAST UNITS WHICH WOULD LEAVE LESS THAN 18 INCHES OF UNDISTURBED CIRCUMFERENTIAL WALL LENGTH, OR WHICH WOULD REMOVE MORE THAN 40% OF THE CIRCUMFERENCE ALONG ANY HORIZONTAL PLANE.



	REV. NO.	DATE	DRAWN BY	CHECKED BY
1				

SANITARY MANHOLE

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SN-1

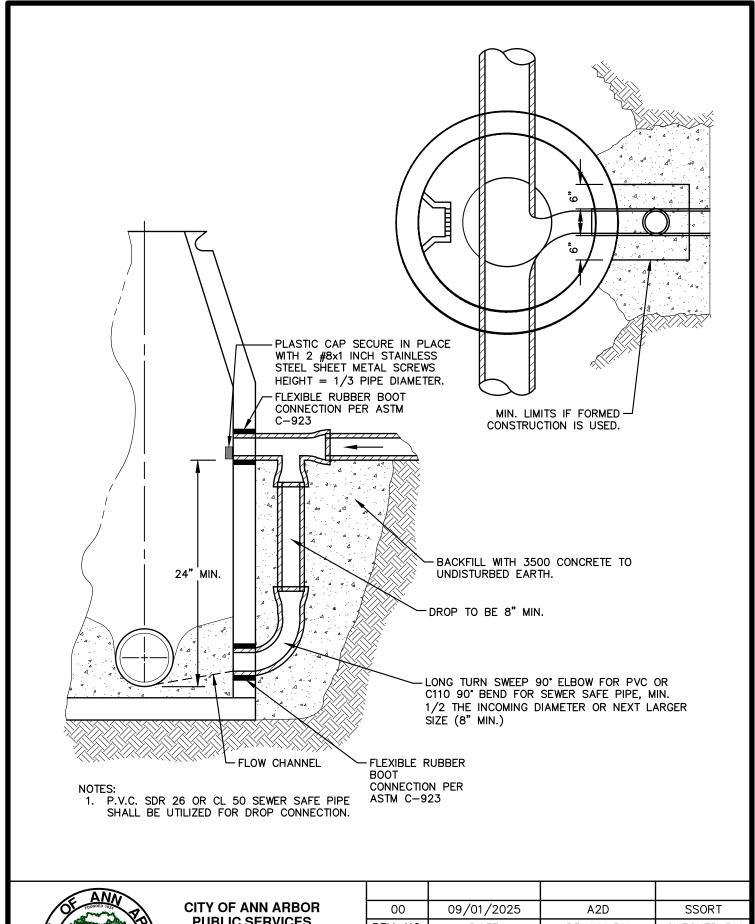




00	09/01/2025	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

DROP M.H. CONNECTION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SN-2

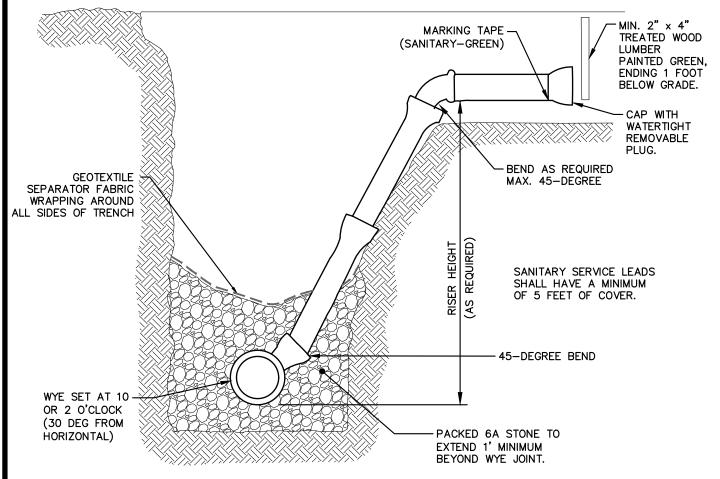

RISERS AND BUILDING LEADS

- A) RISERS SHALL BE INSTALLED WHERE THE SEWER IS MORE THAN 12 FEET BELOW THE ESTABLISHED GRADE OR FUTURE GRADE AND CARRIED TO BETWEEN 9 AND 10 FEET OF THE ESTABLISHED GRADE OR FUTURE GRADE, UNLESS OTHERWISE DETERMINED BY THE PSAA.
- B) RISER OPENINGS SHALL BE CLOSED WITH A STOPPER, AS RECOMMENDED BY THE MANUFACTURER, TO MAKE A WATERTIGHT CLOSURE.
- C) BUILDING LEADS SHALL CONFORM TO ARTICLE 2 (SANITARY), SECTION I.L (SANITARY SERVICE LEADS) AND DEPTH REQUIREMENTS PER SECTION I.G (DEPTH AND COVER) OF THAT ARTICLE.
- D) EACH BUILDING LEAD SHALL BE CLOSED WITH A STOPPER, AS RECOMMENDED BY THE MANUFACTURER, TO MAKE A WATERTIGHT CLOSURE.
- E) UNLESS OTHERWISE DETERMINED BY THE PSAA, PRIOR TO THE BACKFILLING OF A WYE, RISER, OR BUILDING LEAD, A 2-INCH \times 2-INCH (MINIMUM CROSS SECTION) WOODEN MARKER SHALL BE PLACED AT A POINT IMMEDIATELY IN FRONT OF THE SERVICE CONNECTION TO 1 FOOT BELOW THE FINISH GROUND SURFACE. DO NOT REST THE MARKER ON ANY PORTION OF THE SERVICE CONNECTION OR STOPPER.





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

SANITARY SEWER CONNECTION WITH RISER

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SN-3

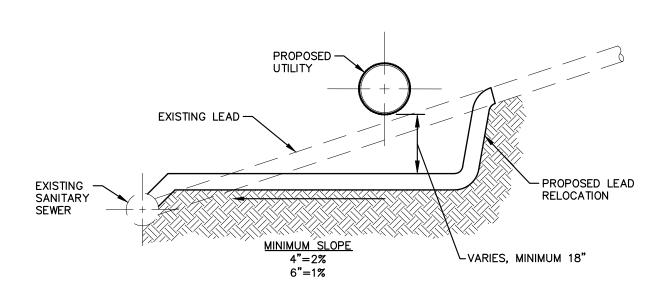

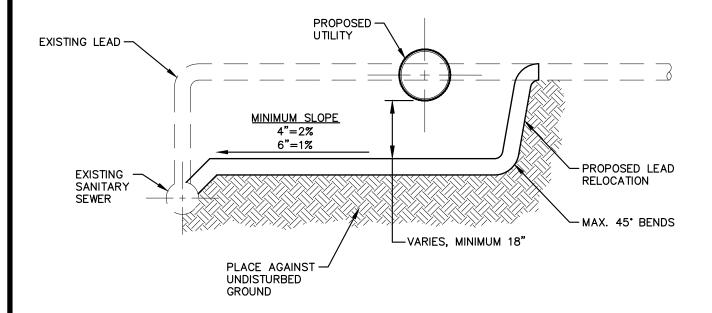





REV. NO.	DATE	DRAWN BY	CHECKED BY

SANITARY LEAD RELOCATION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SN-4

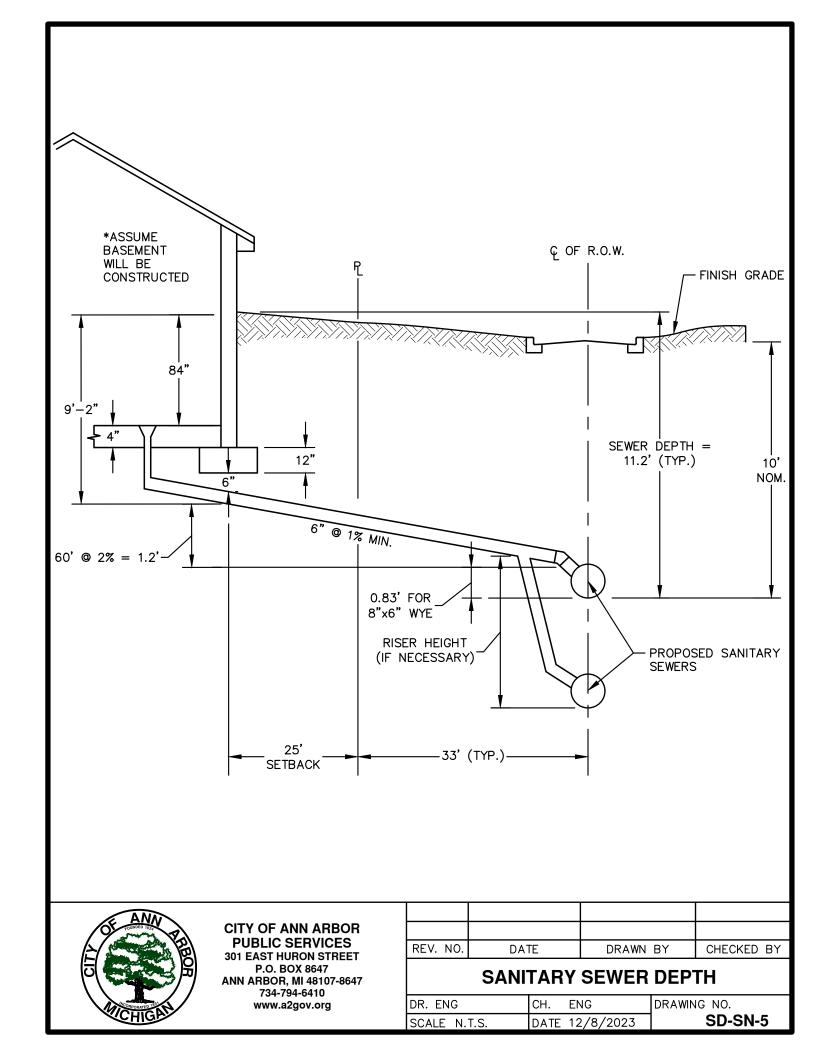

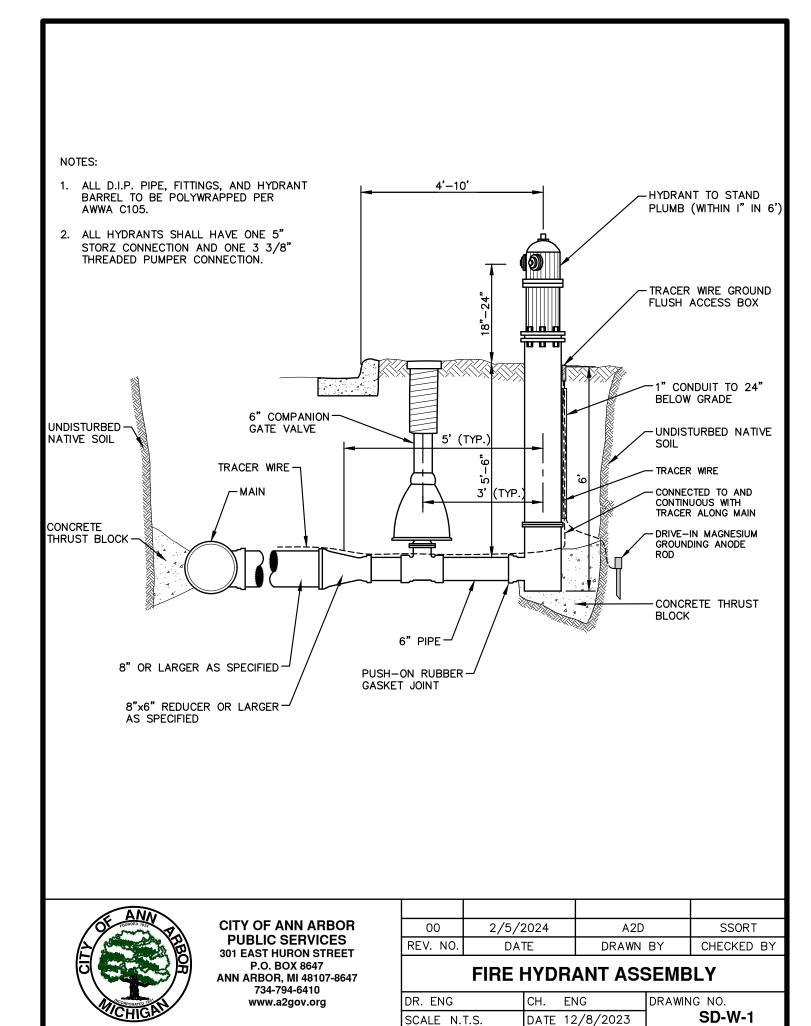

MINIMUM STANDARDS

THE MDOT GRADE 3500 OR P-NC CONCRETE AT THE FITTING FACE SHALL EXTEND TO WITHIN 2" OF THE BELL AND SHALL EXTEND FROM THE FITTING FACE A MINIMUM OF 2' TO THE UNDISTURBED SOLID GROUND.


THE DIMENSIONS OF THE THRUST BLOCK AT THE FACE OF THE UNDISTURBED SOLID GROUND SHALL BE AS SHOWN IN THE TABLE BELOW.

IF THERE ISN'T SUFFICIENT SPACE FOR THE INSTALLATION OF THE THRUST BLOCK WITHOUT INTERFERENCE WITH OTHER SERVICES, ANOTHER ARRANGEMENT SATISFACTORY TO THE ENGINEER SHALL BE USED.

FITTINGS	PL	UG		BENDS								
I.D.		EE DSS	9	0.	4	5°	22	2 <u>1</u> °	11	<u>1</u> °	HYDF	RANT
INCHES	W	Н	W	Н	W	Τ	W	Ι	W	I	W	Η
4	1.0	1.0	1.0	1.0	1.0	1.0						
6	2.0	1.5	2.0	2.0	2.0	1.0	1.0	1.0	1.0	1.0	2.0	1.5
8	2.5	2.0	3.5	2.0	2.0	2.0	2.0	1.0	1.0	1.0	2.5	2.0
12	3.5	3.0	5.5	3.0	3.5	2.5	2.0	2.0	2.0	1.0		
16	6.0	3.5	6.0	4.0	5.0	3.0	3.5	2.5	2.0	2.0		

FOR FITTING SIZES LARGER THAN 16", THRUST BLOCK DIMENSIONS SHALL BE AS SPECIFIED BY ENGINEER.

W = WIDTH IN FEETH = HEIGHT IN FEET

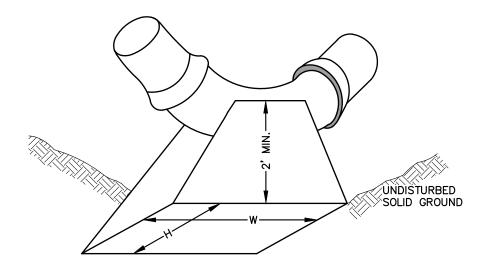

NOTE:

THESE ARE MINIMUM STANDARDS. WHERE SOIL CONDITIONS DICTATE, ADJUSTMENTS IN SIZE SHALL BE MADE AS DIRECTED BY THE PUBLIC SERVICES AREA ADMINISTRATOR.





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

THRUST BLOCK

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-W-2

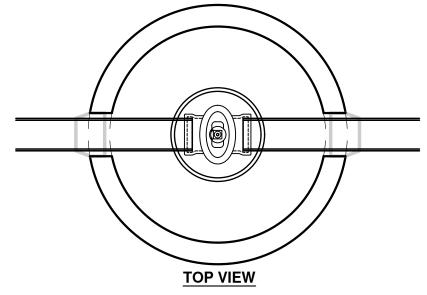

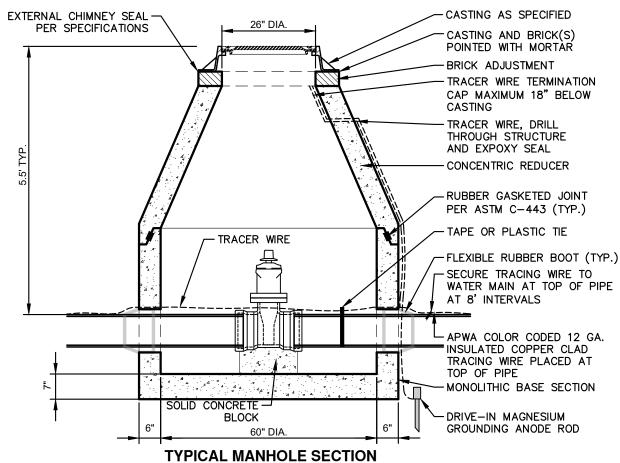

- 1. PRECAST MANHOLE PER ASTM C-478.
- 2. REINFORCING IN WALLS TO BE ONE LAYER OF 2" X 8" W3/W2.9 WELDED WIRE MESH. CIRCUMFERENTIAL REINFORCEMENT = 0.18 SQ. IN./VERT. FT.
- 3. BASE SLAB TO BE REINFORCED WITH ONE LAYER OF #4 REBAR AT 12" C-C, E.W. AREA/STEEL = .20 SQ. IN./FT E.W.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

	01	09/01/2025	A2D	SSORT
	00	10/17/2024	A2D	SSORT
R	EV. NO.	DATE	DRAWN BY	CHECKED BY

PRECAST GATE WELL (WATERMAINS 16 INCH AND SMALLER)

DR. ENG	CH.	ENG	DRAWING N	١٥.
SCALE N.T.S.	DATE	12/8/2023	9	SD-W-3

- 1. ALL LIFT HOLES AND JOINTS SHALL BE MORTARED BOTH INSIDE AND OUTSIDE
- 2. ALL JOINTS SHALL BE MADE WATER TIGHT WITH RUBBER GASKET JOINTS
- 3. MANHOLE SECTIONS SHALL MEET ASTM C-478
- 4. CONE TO BE ECCENTRIC TYPE
- 5. FOR PIPE SIZES LARGE THAN 24", DIAMETER OF MANHOLE AS DIRECTED BY ENGINEER

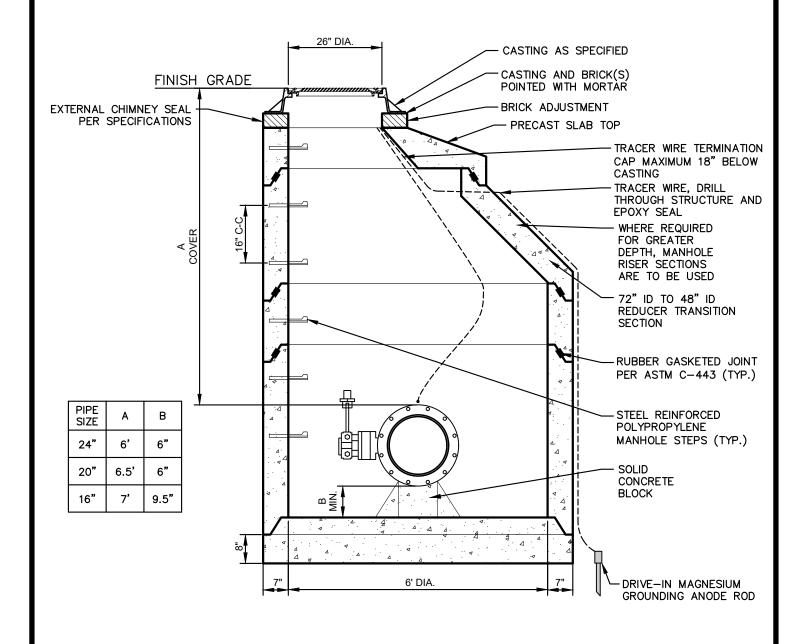




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY
		=	

PRECAST GATE WELL (BUTTERFLY VALVES)

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-W-4

- 1. ALL LIFT HOLES AND JOINTS SHALL BE MORTARED BOTH INSIDE AND OUTSIDE
- 2. ALL JOINTS SHALL BE MADE WATER TIGHT WITH RUBBER GASKET JOINTS
- 3. NO STEPS ARE PERMITTED
- 4. MANHOLE SECTIONS SHALL MEET ASTM C-478
- 5. CONE TO BE ECCENTRIC TYPE
- 6. DETAIL APPLIES TO PIPE DIAMETERS UP TO 16"

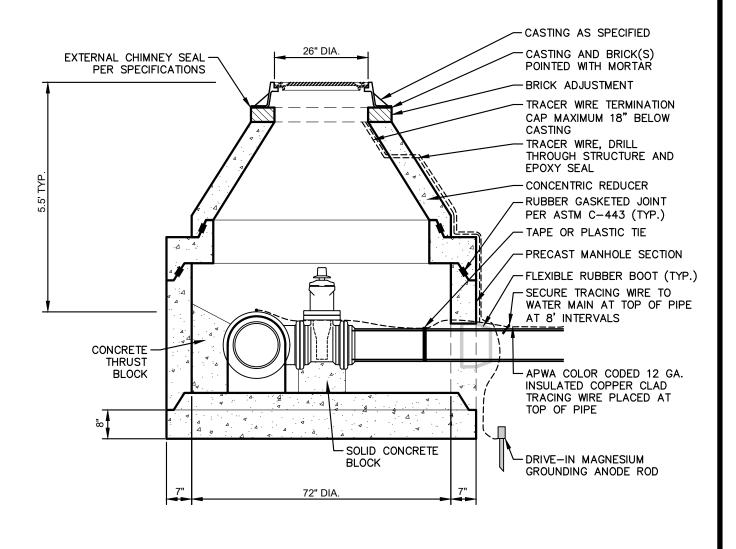




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

01	09/01/2025	A2D	SSORT
00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

PRECAST GATE WELL FOR TAPPING SLEEVE AND VALVE

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-W-5

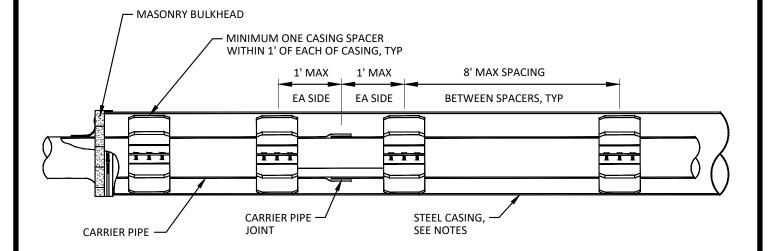

- 1. THE AREA BETWEEN THE CASING PIPE AND WATER MAIN SHALL BE LEFT OPEN EXCEPT FOR SOLID BRICK MASONRY BULKHEAD AT EACH END, AND MANUFACTURED SPACERS WHEN REQUIRED.
- 2. EACH JOINT OF CASING PIPE SHALL BE WELDED TOGETHER ALONG ENTIRE CIRCUMFERENCE OF PIPE.
- 3. MANUFACTURED SPACERS SHALL BE USED.
- 4. WOOD BLOCK SPACERS ARE NOT ALLOWED.
- 5. BORING SHALL BE AT 90 DEGREES TO ALL CROSSINGS UNLESS OTHERWISE APPROVED. THE BORING OF THE HOLE AND INSTALLATION OF THE CASING PIPE SHALL BE SIMULTANEOUS. BORE HOLE DIAMETER SHALL ESSENTIALLY BE THE SAME AS THE OUTSIDE DIAMETER OF THE CASING PIPE TO BE INSTALLED.
- 6. STEEL PIPE CASING SHALL BE SMOOTH STEEL PIPE FABRICATED IN SECTIONS IN ACCORDANCE WITH ASTM A53, TYPE E OR S, GRADE B OR ASTM A139, GRADE B. LENGTHS OF CASING PIPE SHALL BE AS LONG AS PRACTICAL FOR SITE CONDITIONS.
- 7. JOINTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM. JOINTS BETWEEN SECTIONS SHALL BE COMPLETELY WELDED TO THE PRECEDING SECTIONS. PRIOR TO WELDING JOINTS, THE CONTRACTOR SHALL ENSURE THAT BOTH ENDS OF THE CASING SECTIONS BEING WELDED ARE SQUARE.
- 8. STEEL PIPE CASING SIZE AND WALL THICKNESS SHALL BE AS SPECIFIED IN ARTICLE I OF THESE STANDARDS. VERIFY CASING SIZES PRIOR TO ORDERING AND SIZING CASING INSULATORS.
- 9. CASING SPACERS SHALL BE RESTRAINED-TYPE BOLTED SPACERS AND SHALL HAVE A MAXIMUM SPACING AS SHOWN, OR AS RECOMMENDED BY MANUFACTURER, WHICHEVER IS CLOSER.
- 10. REFER TO ARTICLE 1, XXVI CASING PIPE, FOR PIPE SIZES.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

TYPICAL PIPE CASING DETAIL

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-W-6

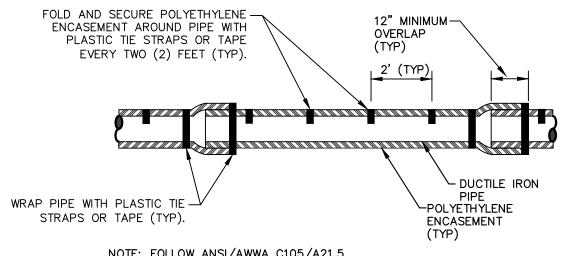


NOTE: FOLLOW ANSI/AWWA C105/A21.5 FOR CONSTRUCTION AND INSTALLATION METHODS. USE MODIFIED METHOD A

> APPLIES TO: POLYETHYLENE WRAPPED D.I. WATERMAIN

SEE PLANS FOR LOCATIONS

POLYETHYLENE ENCASEMENT (DRY INSTALLATION)

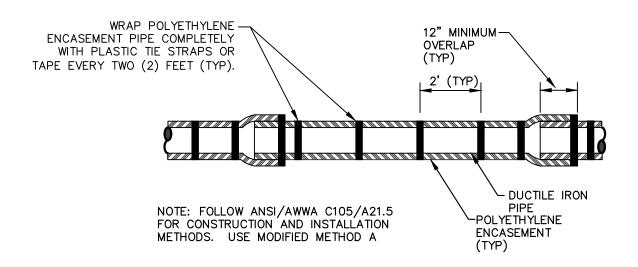

APPLIES TO: POLYETHYLENE WRAPPED D.I. WATERMAIN SEE PLANS FOR LOCATIONS

POLYETHYLENE ENCASEMENT (WET INSTALLATION)



CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

POLYETHYLENE ENCASEMENT

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-W-7



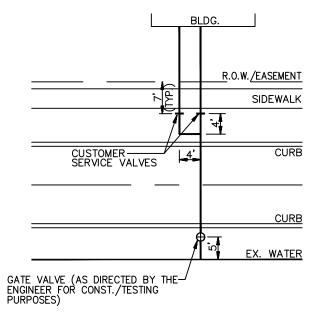


FIGURE 4 CONFIGURATION



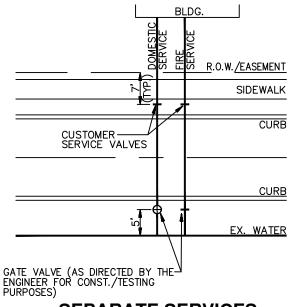

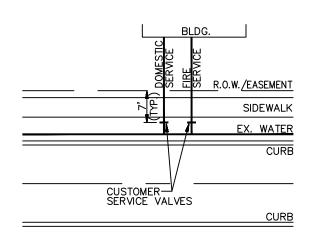

SEPARATE SERVICES SHORT SIDE

NOTE:

- 1. CITY WILL MAINTAIN LEAD UNDER ROAD UP TO AND INCLUDING THE CUSTOMER SERVICE VALVE LOCATION.
- FOR 13D SPRINKLER SYSTEMS, AS APPROVED BY PLANNING AND DEVELOPMENT SERVICES UNIT, A COMBINATION FIRE AND DOMESTIC LEAD IS PERMITTED.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DOMESTIC AND FIRE SERVICE CONFIGURATIONS

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-W-8

- TESTABLE BACK FLOW PREVENTER WITH DETECTOR FLOW METER (RPZ OR DOUBLE CHECK VALVE DEPENDING ON HAZARD LEVEL) — AS DETERMINED BY THE CITY
- 2. GATE VALVE
- 3. 3/4" METER
- 4. 3/4" THREADED PLUG
- 5. BALL VALVE
- 6. BALL VALVE WITH 5/8" MALE THREADED HOSE BIBB CONNECTION
- 7. TEE AND CAP WITH BALL VALVE (FUTURE TESTING PORT)

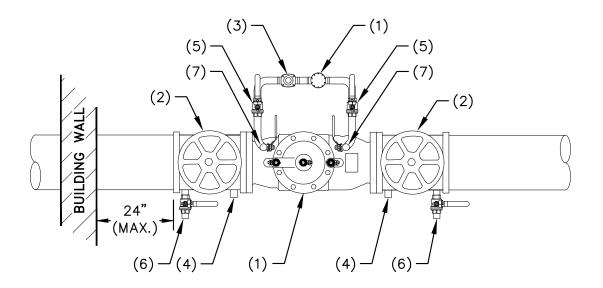




00	09/01/2025	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

FIRE SERVICE METERING

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-MT-1

- TESTABLE BACK FLOW PREVENTER WITH DETECTOR FLOW METER (RPZ OR DOUBLE CHECK VALVE DEPENDING ON HAZARD LEVEL) – AS DETERMINED BY THE CITY
- 2. GATE VALVE
- 3. 3/4" METER
- 4. 3/4" THREADED PLUG
- 5. BALL VALVE
- 6. BALL VALVE WITH 5/8" MALE THREADED HOSE BIBB CONNECTION
- 7. TEE AND CAP WITH BALL VALVE (FUTURE TESTING PORT)
- 8. FIRE PUMP
- 9. JOCKEY PUMP

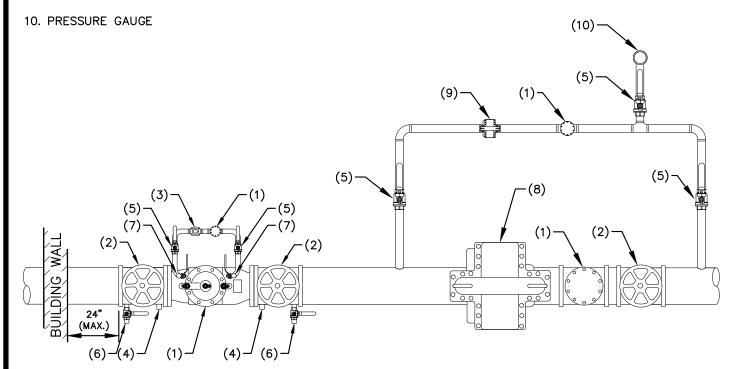






00	09/01/2025	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

FIRE SERVICE METERING - FIRE PUMP SYSTEM

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-MT-2

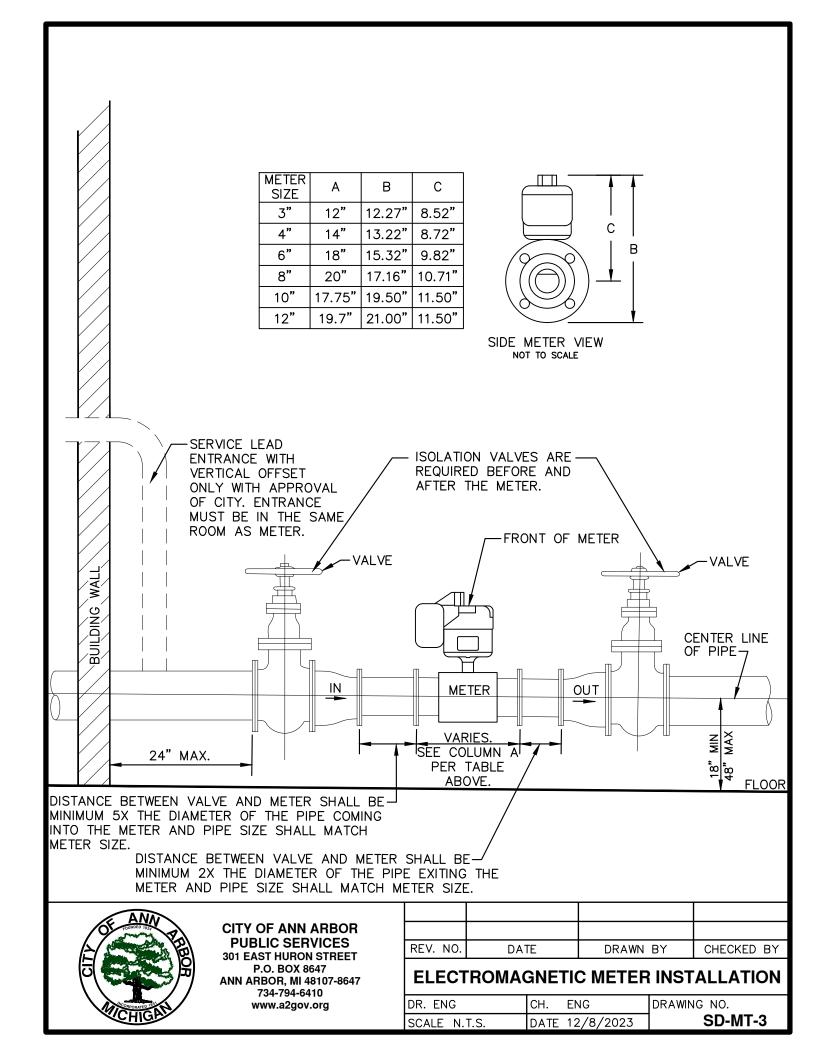

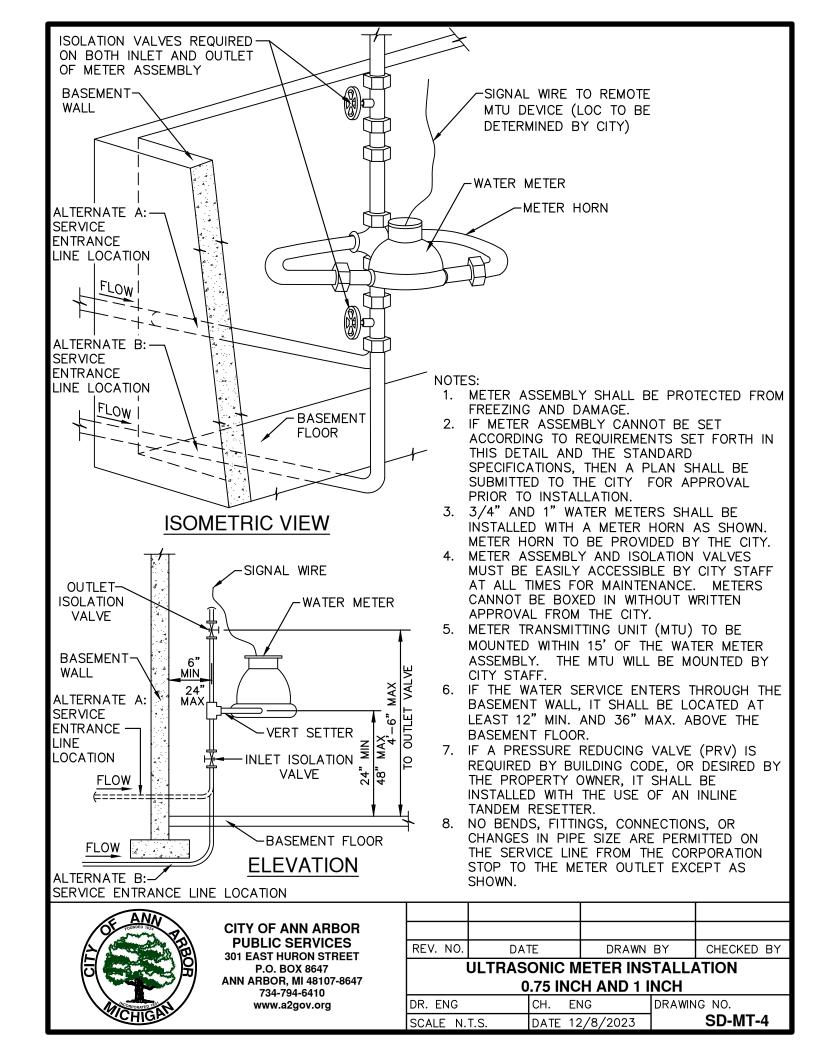

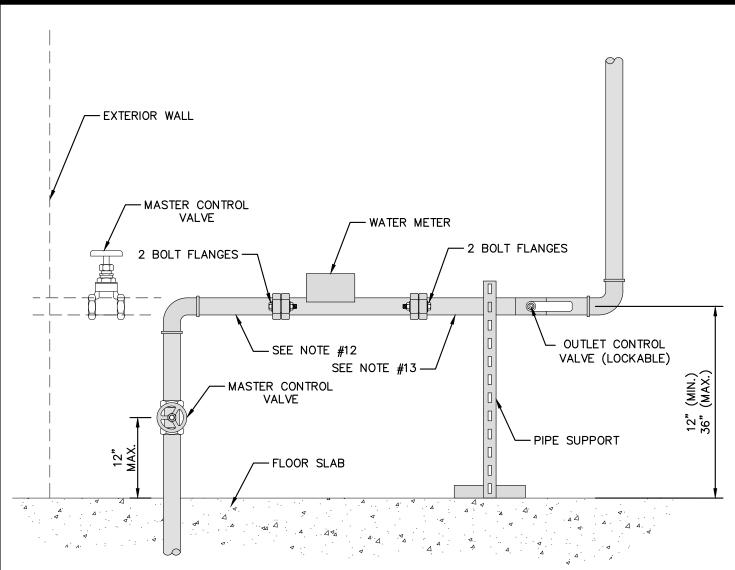

- 1. PIPING ADJACENT TO THE METER SPACE MUST BE ON A HORIZONTAL PLANE.
- METER SETTINGS ARE TO BE CONSTRUCTED BY THE CONSUMER.
- 3. MINIMUM DISTANCE FROM THE CENTERLINE OF PIPING ADJACENT TO METER SPACER IS TO BE 18" FROM ANY ENTRANCE OR OUTSIDE WALL.
- 4. METER SUPPORT AS REQUIRED (IE. QLINE).
- 5. A LOCKABLE BALL VALVE SHALL BE INSTALLED AFTER THE FIRE BRANCH AND AFTER ANY BY-PASS BRANCH AT VALVE.
- METER ASSEMBLY SHALL BE PROTECTED FROM FREEZING AND DAMAGE.
- 7. IF METER ASSEMBLY CANNOT BE SET ACCORDING TO REQUIREMENTS SET FORTH IN THIS DETAIL AND THE STANDARD SPECIFICATIONS, THEN A PLAN SHALL BE SUBMITTED TO THE CITY FOR APPROVAL PRIOR TO INSTALLATION.
- 8. METER ASSEMBLY AND ISOLATION VALVES MUST BE EASILY ACCESSIBLE BY CITY STAFF AT ALL TIMES FOR MAINTENANCE. METERS CANNOT BE BOXED IN WITHOUT WRITTEN APPROVAL FROM THE CITY.
- METER TRANSMITTING UNIT (MTU) TO BE MOUNTED WITHIN 15' OF THE WATER METER ASSEMBLY. THE MTU WILL BE MOUNTED BY CITY STAFF.
- 10. IF THE WATER SERVICE ENTERS THROUGH THE BASEMENT WALL, IT SHALL BE LOCATED AT LEAST 12" MIN. AND 36" MAX. ABOVE THE BASEMENT FLOOR.
- 11. NO BENDS, FITTINGS, CONNECTIONS, OR CHANGES IN PIPE SIZE ARE PERMITTED ON THE SERVICE LINE FROM THE CORPORATION STOP TO THE METER OUTLET EXCEPT AS SHOWN.
- 12. DISTANCE BETWEEN ANY FITTING AND METER SHALL BE MINIMUM 5X THE DIAMETER OF THE PIPE COMING INTO THE METER AND PIPE SIZE SHALL MATCH METER SIZE.
- 13. DISTANCE BETWEEN ANY FITTING AND METER SHALL BE MINIMUM 2X THE DIAMETER OF THE PIPE EXITING THE METER AND PIPE SIZE SHALL MATCH METER SIZE.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY
	ULTRASONIC I	METER INSTALI	LATION
	1 5 INCH AND 2 INCH		

 1.5 INCH AND 2 INCH

 DR. ENG
 CH. ENG
 DRAWING NO.

 SCALE N.T.S.
 DATE 12/8/2023
 SD-MT-5

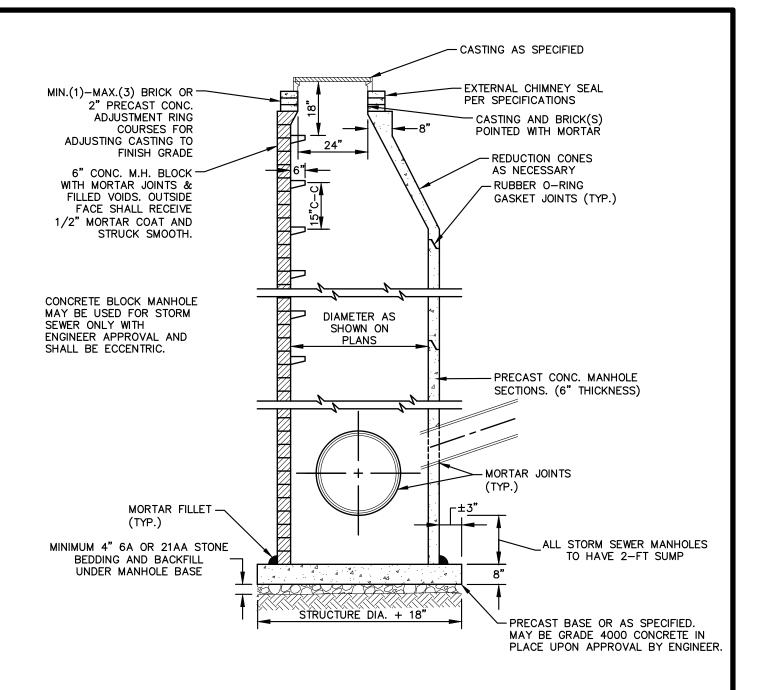

- 1. ALL STORM MANHOLES MAY BE PRECAST CONCRETE OR MANHOLE BLOCK.
- 2. ALL MANHOLES MUST HAVE ECCENTRIC CONES.
- 3. ALL MANHOLE SECTIONS SHALL BE REINFORCED PER ASTM-185.
- 4. 2' SUMP REQUIRED ON ALL DRAINAGE STRUCTURES.
- 5. IF A FLAT TOP IS REQUIRED, THEN IT SHALL BE REINFORCED IN BOTH DIRECTIONS TO MEET ASTM C-615.





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

STANDARD STORM MANHOLE				
1	REV. NO.	DATE	DRAWN BY	CHECKED BY
	00	12/30/2024	A2D	SSORT

STANDARD STORM MANHOLE (SEPARATE BASE)

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-ST-1A

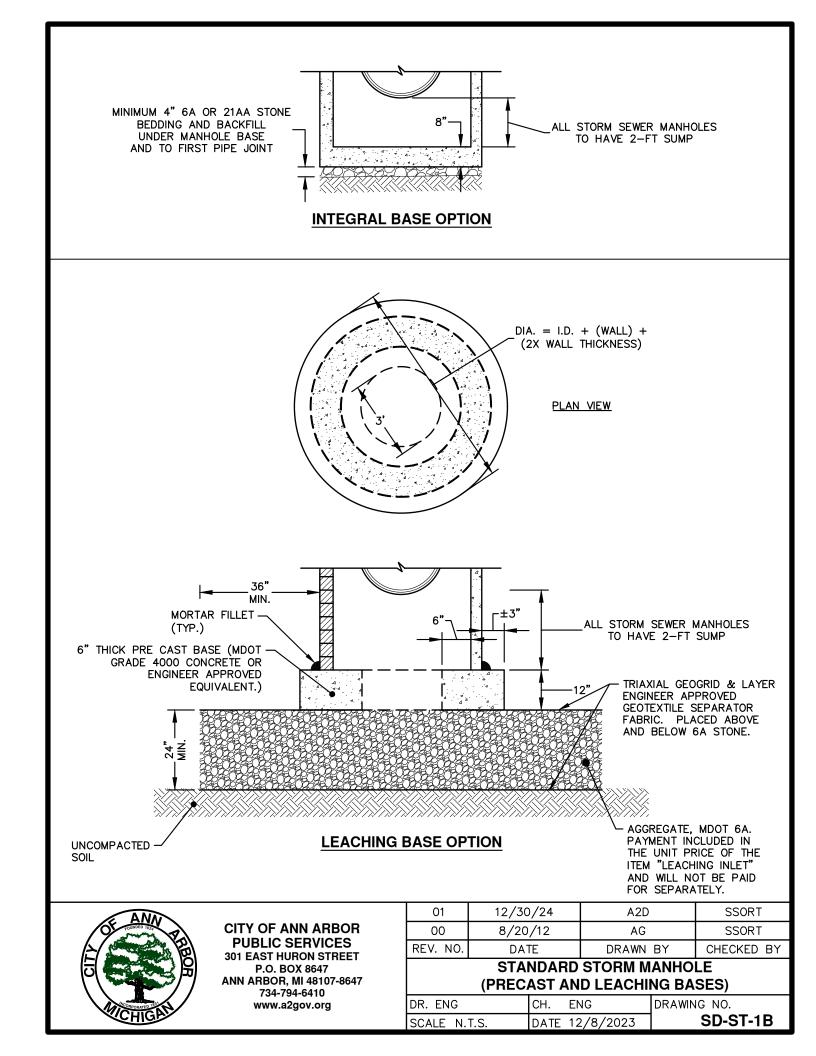

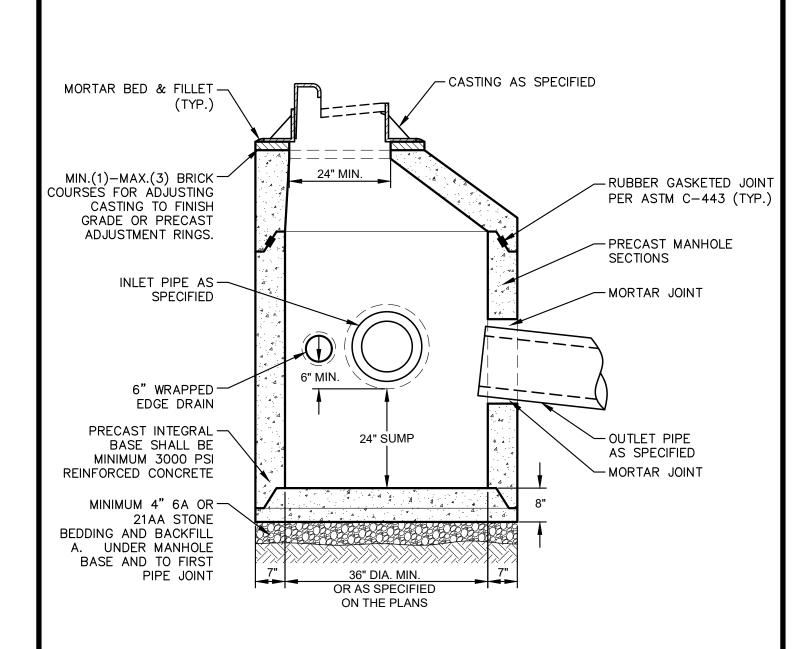

1. FRONT EDGE OF INLET CASTING SHALL BE FLUSH WITH FRONT EDGE OF GUTTER (EDGE-OF-METAL)




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	12/30/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

PRECAST JUNCTION INLET

DR. ENG	сн.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-ST-2

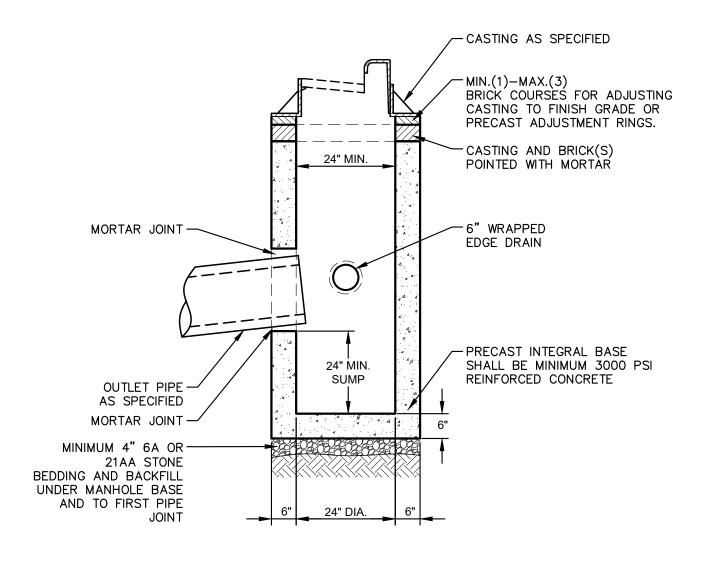

- 1. MAY BE USED WITH SINGLE OUTLET PIPE AND SINGLE INLET PIPE.
- 2. FRONT EDGE OF INLET CASTING SHALL BE FLUSH WITH FRONT EDGE OF GUTTER (EDGE-OF-METAL)




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

PRECAST SINGLE INLET

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-ST-3

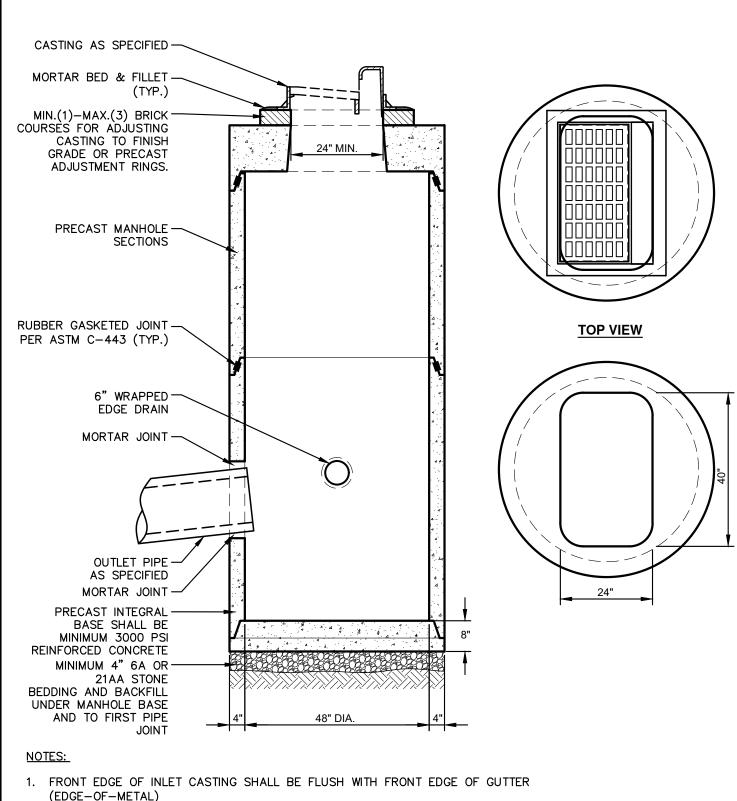

(EDGE-OF-METAL)




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	12/30/24	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

PRECAST HIGH CAPACITY INLET

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-ST-4

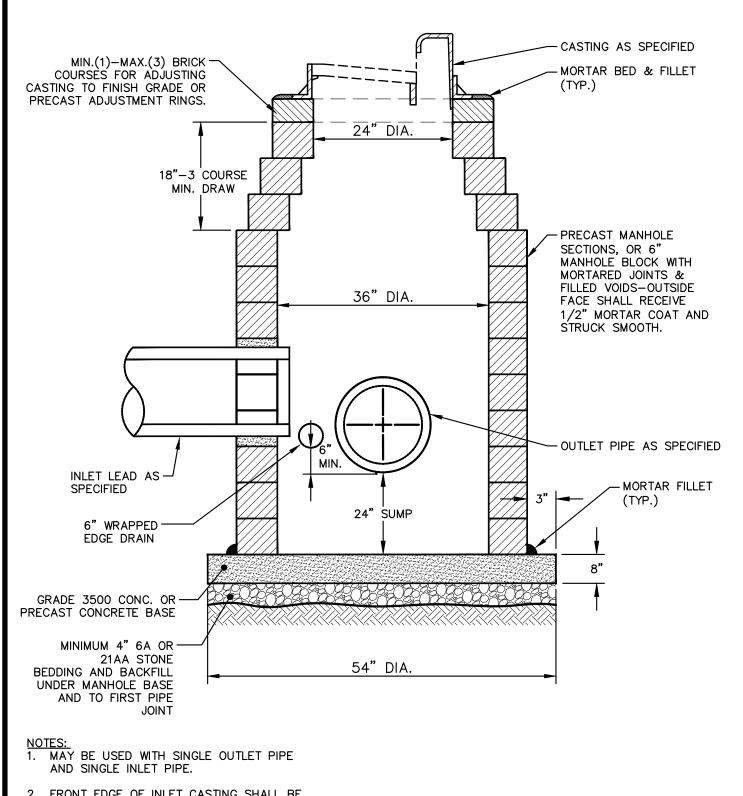

 FRONT EDGE OF INLET CASTING SHALL BE FLUSH WITH FRONT EDGE OF GUTTER (EDGE—OF—METAL)




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	12/30/24	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

BLOCK JUNCTION INLET

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-ST-5

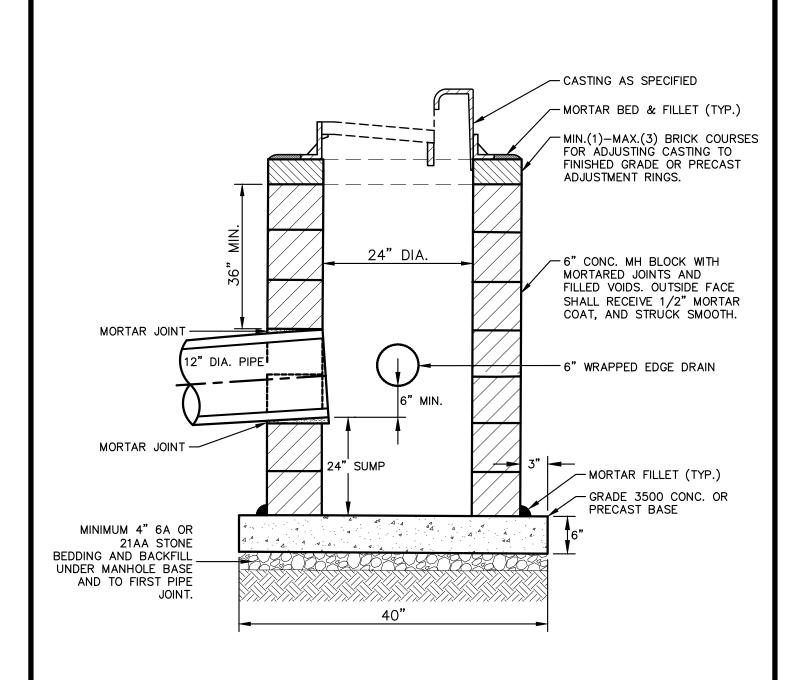

- MAY BE USED WITH ONLY SINGLE OUTLET PIPE, AND NO INLET PIPE
- 2. FRONT EDGE OF INLET CASTING SHALL BE FLUSH WITH FRONT EDGE OF GUTTER (EDGE-OF-METAL)




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	12/30/24	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

BLOCK SINGLE INLET

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-ST-6

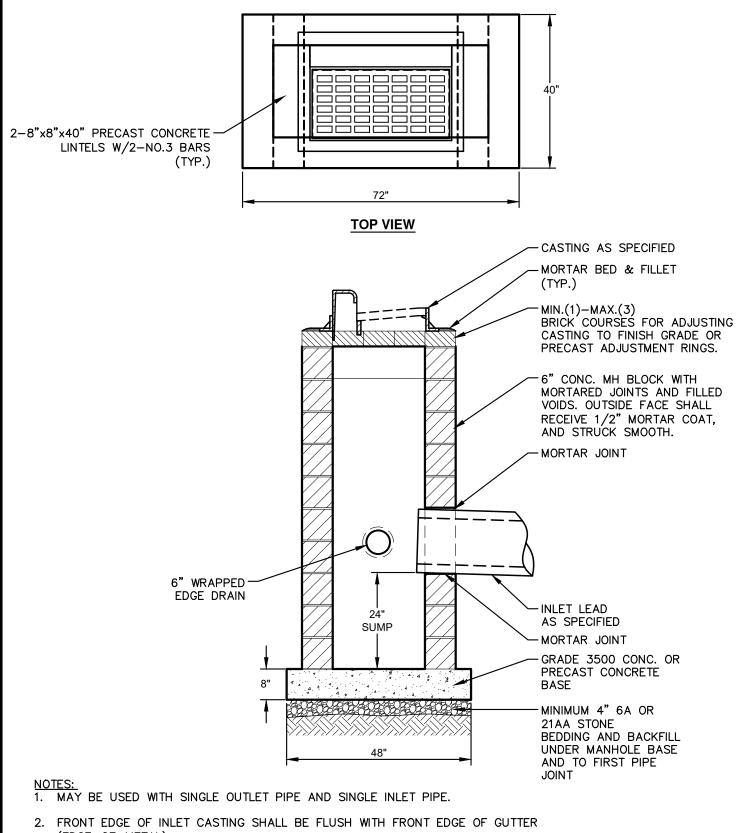

(EDGE-OF-METAL)




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

BLOCK HIGH CAPACITY INLET

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-ST-7

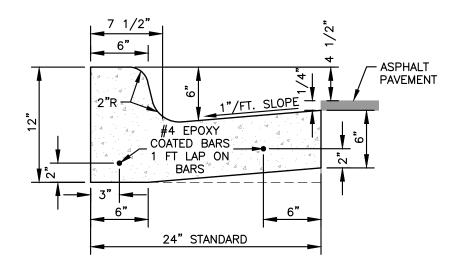

- 1. BARRIER CURB AND GUTTER ON ASPHALT STREETS SHALL CONFORM TO THIS DETAIL.
- 2. BARRIER CURB AND GUTTER ON CONCRETE STREETS SHALL CONFORM TO MDOT CURB AND GUTTER DETAIL F3.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

BARRIER CURB AND GUTTER

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-CG-1

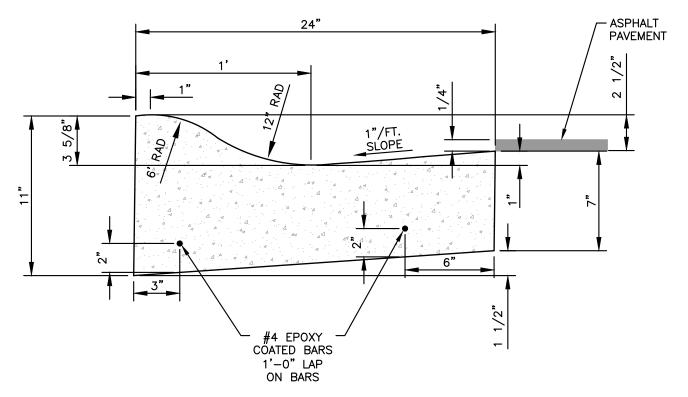

- 1. FRONT EDGE OF INLET CASTINGS SHALL BE FLUSH WITH FRONT EDGE OF GUTTER (EDGE-OF-METAL).
- 2. THIS DETAIL SHALL BE USED FOR MOUNTABLE CURB AND GUTTER ON ASPHALT STREETS. SEE SD-CG-3 FOR MOUNTABLE CURB AND GUTTER ON CONCRETE STREETS.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

MOUNTABLE CURB AND GUTTER FOR ASPHALT STREETS

1 STOREST TIME TO THE ETG				
DR. ENG	CH.	ENG	DRAWING NO.	
SCALE N.T.S.	DATE	12/8/2023	SD-CG-2	

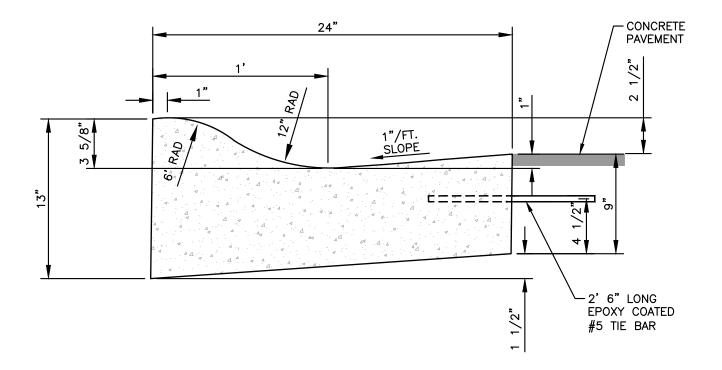

- 1. FRONT EDGE OF INLET CASTINGS SHALL BE FLUSH WITH FRONT EDGE OF GUTTER (EDGE-OF-METAL).
- 2. THIS DETAIL SHALL BE USED FOR MOUNTABLE CURB AND GUTTER ON CONCRETE STREETS. SEE SD-CG-2 FOR MOUNTABLE CURB AND GUTTER ON ASPHALT STREETS.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

			<u></u>
REV. NO.	DATE	DRAWN BY	CHECKED BY

MOUNTABLE CURB AND GUTTER FOR CONCRETE STREETS

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-CG-3

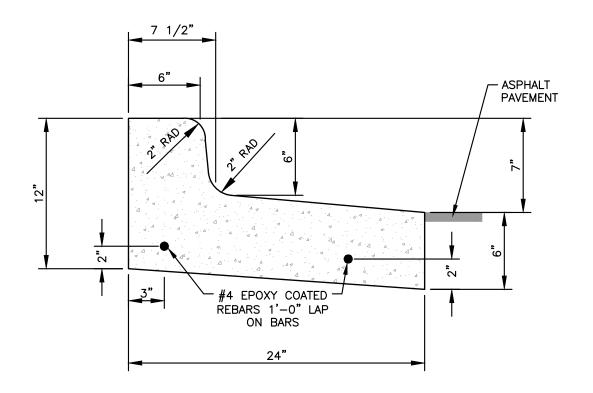




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

SPILL-OUT BARRIER CURB AND GUTTER

DR. ENG CH.	ENG	DRAWING NO.
SCALE N.T.S. DAT	E 12/8/2023	SD-CG-4

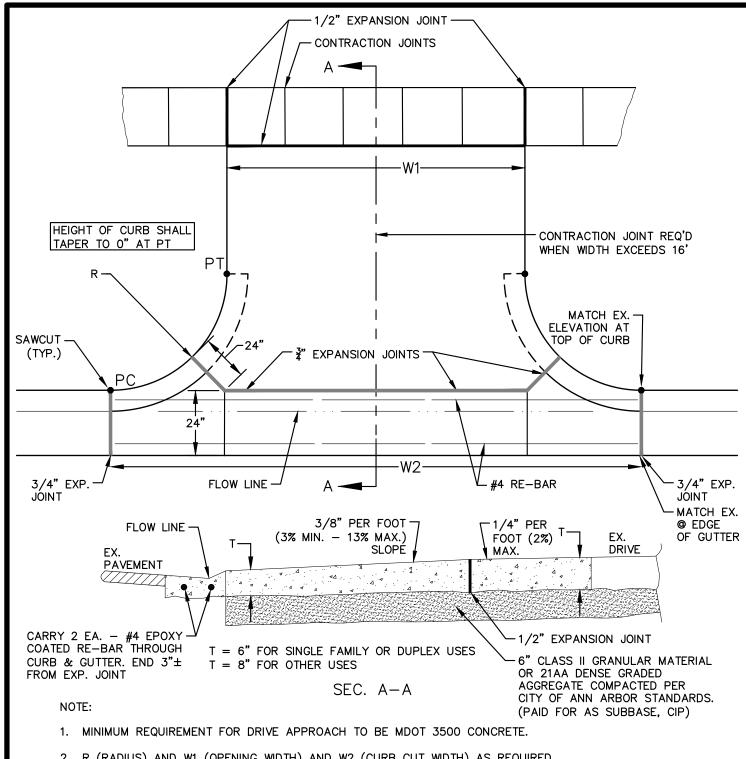

- 2. R (RADIUS) AND W1 (OPENING WIDTH) AND W2 (CURB CUT WIDTH) AS REQUIRED PER TABLE A, ARTICLE 6 OF CITY STANDARDS
- 3. IF GUTTER IS OVERLAID, GUTTER OF THE APPROACH SHALL BE AT SAME ELEVATION AS EXISTING CONCRETE GUTTER AND ASPHALT WEDGE SHALL BE PLACED IN THE APPROACH.





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	09/01/2025	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

TYPE M DRIVE APPROACH FOR ASPHALT STREETS WITH BARRIER CURB

OTTREETE WITTER			
DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DS-1

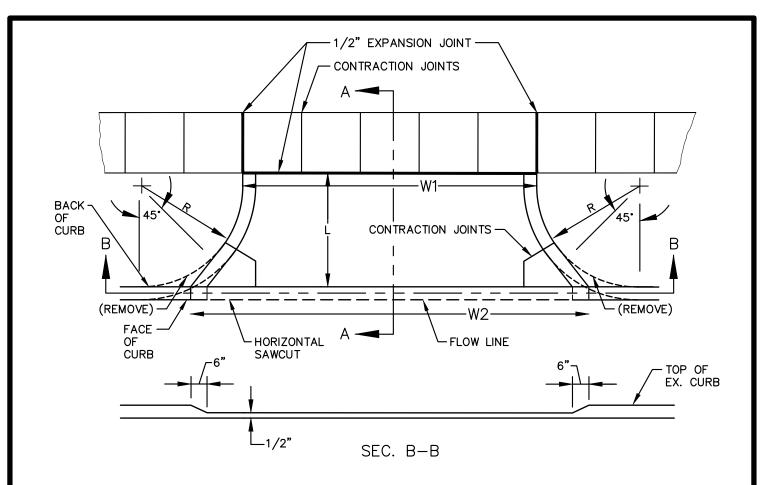

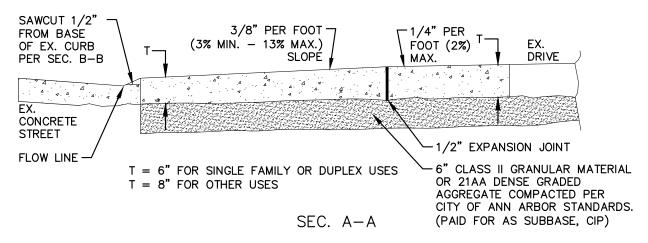

- 1. MINIMUM REQUIREMENT FOR DRIVE APPROACH TO BE MDOT 3500 CONCRETE.
- 2. R (RADIUS) AND W1 (OPENING WIDTH) AND W2 (CURB CUT WIDTH) AS REQUIRED PER TABLE A, ARTICLE 6 OF CITY STANDARDS





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

	REV. NO.	DATE	DRAWN BY	CHECKED BY
1	MACRIE	ED M DDIVE AT	DDO A OLL FOR	AANADETE

MODIFIED M DRIVE APPROACH FOR CONCRETE STREETS WITH BARRIER CURB

5	LII COIID		
DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DS-2

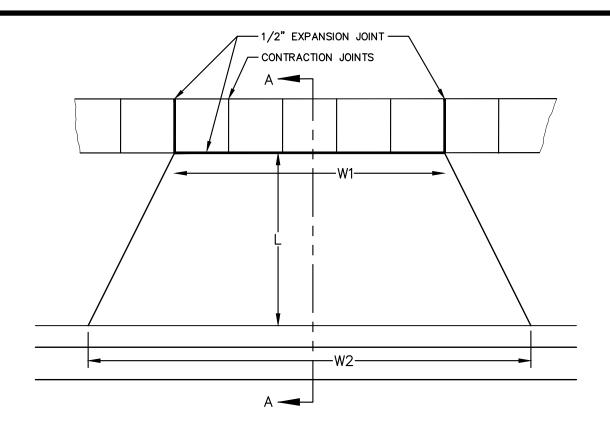

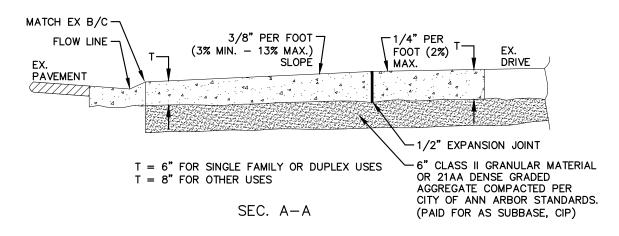

- 1. MINIMUM REQUIREMENT FOR DRIVE APPROACH TO BE MDOT 3500 CONCRETE.
- 2. R (RADIUS) AND W1 (OPENING WIDTH) AND W2 (CURB CUT WIDTH) AS REQUIRED PER TABLE A, ARTICLE 6 OF CITY STANDARDS
- 3. IF GUTTER IS OVERLAID, GUTTER OF THE APPROACH SHALL BE AT SAME ELEVATION AS EXISTING CONCRETE GUTTER AND ASPHALT WEDGE SHALL BE PLACED IN THE APPROACH.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY
	TYPE L DRIVI	E APPROACH F	OR

TYPE L DRIVE APPROACH FOR STREETS WITH MOUNTABLE CURB

• • • • • • • • • • • • • • • • • • • •			
DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DS-3

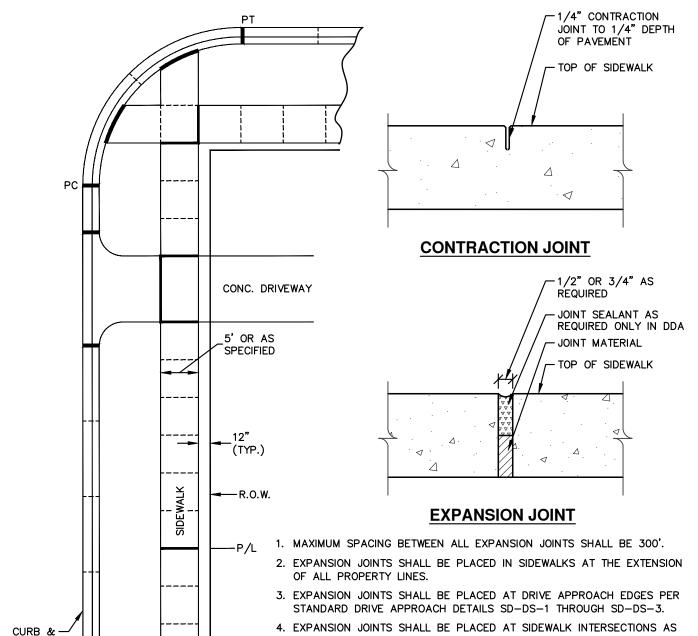

LEGEND:

GUTTER

CONTRACTION JOINTS

1/2" EXPANSION JOINTS •

3/4" EXPANSION JOINTS =

- SHOWN.
- 5. EXPANSION JOINTS SHALL BE PLACED IN CURB AND GUTTER AT PC AND PT OF INTERSECTION RADII.
- 6. WHEN SIDEWALK IS AGAINST THE BACK-OF-CURB, AN EXPANSION JOINT SHALL BE PROVIDED ALONG THE CURB.
- 7. CONTRACTION JOINT SPACING FOR CURB AND CURB SHALL BE 10' STANDARD AND 8' MINIMUM.
- 8. CONTRACTION JOINTS FOR SIDEWALKS SHALL BE PLACED AT ALL SLAB ENDS (5' TYPICAL, 3' MINIMUM TO 7' MAXIMUM).
- 9. DESIGN MAY UTILIZE TOOLED OR SAW-CUT CONTRACTION JOINT. PLANS MUST INDICATE SELECTION OF JOINT TYPE. PROJECT MUST HAVE EITHER JOINT TYPE, BUT NOT BOTH.
- 10. IF THE SIDEWALK IS 8" OR THICKER, THEN THE JOINTS NEED TO BE HAND TOOLED AND SAW-CUT.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

L				
	00	09/01/2025	A2D	SSORT
	REV. NO.	DATE	DRAWN BY	CHECKED BY

SIDEWALK AND CURB & GUTTER JOINTS

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-DS-4

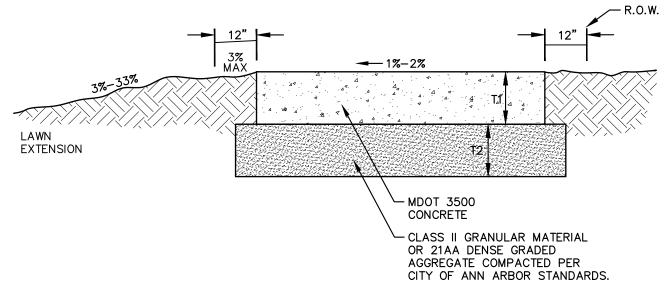

GENERAL NOTE:

SIDEWALKS IN THE DDA SHALL BE CONSTRUCTED PER DETAILS SD-DDA-1 THROUGH SD-DDA-8.

NOTES:

- 1. STANDARD SIDEWALK WIDTH SHALL BE 5'.
- 2. STANDARD SLAB LENGTH SHALL BE 5'.
- 3. MINIMUM SLAB LENGTH SHALL BE 3' AND MAXIMUM 7'.
- 4. MINIMUM SIDEWALK THICKNESS (T1) SHALL BE 4".
- 5. SIDEWALK THICKNESS (T1) SHALL BE INCREASED AT DRIVE APPROACHES TO 6" FOR SINGLE OR DUPLEX USES AND TO 8" FOR ALL OTHER USES.
- 6. MINIMUM BASE THICKNESS (T2) SHALL BE 4".
- 7. MINIMUM BASE THICKNESS (T2) SHALL BE INCREASED TO 6" AT DRIVE APPROACHES.
- NATIVE MATERIAL IS ACCEPTABLE FOR SIDEWALK REPLACEMENT IF BASE IS STABLE AND FREE OF ORGANIC OR DELETERIOUS MATERIALS.
- 9. SIDEWALK RAMPS SHALL BE CONSTRUCTED AT STREET INTERSECTIONS AS DIRECTED AND SHALL COMPLY WITH THE REQUIREMENTS OF MDOT DETAIL R-28 (LATEST VERSION).
- 10. If SIDEWALKS ARE APPROVED TO MEANDER WITHIN THE RIGHT-OF-WAY TO PROTECT AND SAVE TREES, SLOPES, ETC., CURVES IN THE SIDEWALK SHALL HAVE A MINIMUM 5' RADIUS, WITH A MINIMUM 3' LAWN EXTENSION.
- 11. EXPANSION AND CONTRACTION JOINTS SHALL BE PROVIDED PER STANDARD DETAIL SD-DS-4.





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

SIDEWALK CROSS SECTION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DS-5

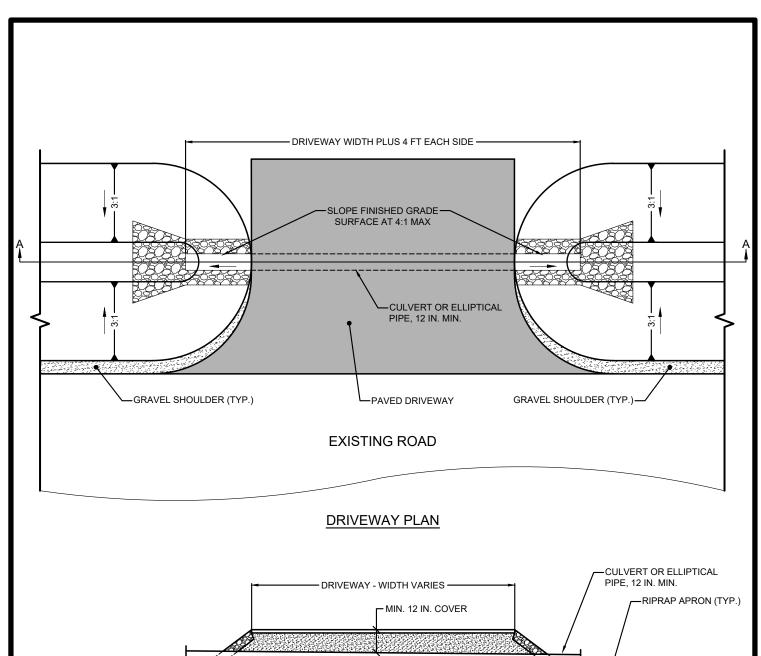

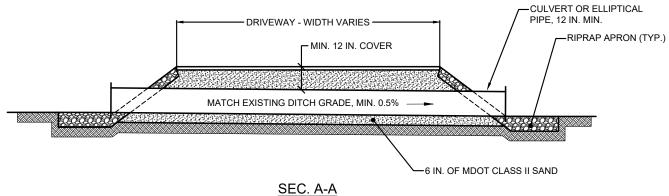




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	DATE	DRAWN BY	CHECKED BY
REV. NO.	DATE	DRAWN BY	CHECKED BY

DRIVEWAY CULVERT

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	3/26/2025	SD-DS-6

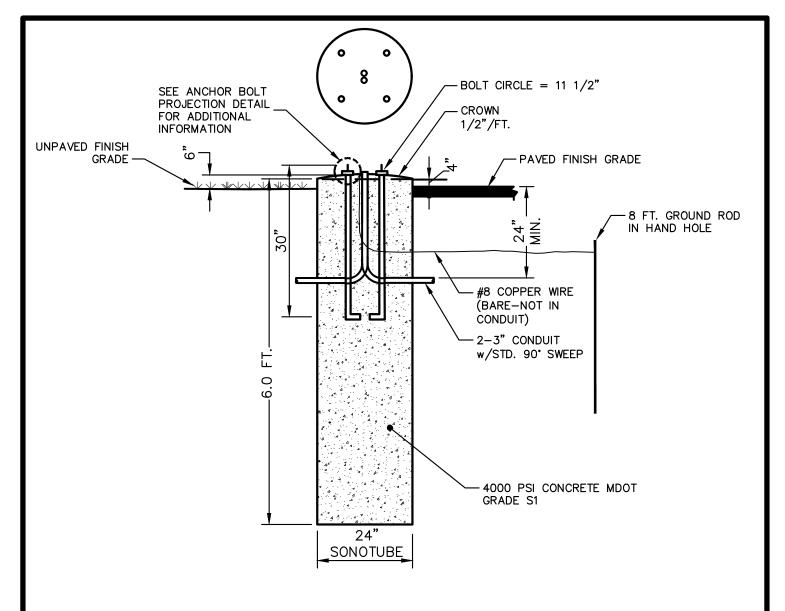

- 1. HOLE TO BE AUGERED. MINIMIZE DISTURBANCE OF IN-SITU SOILS DURING AUGERING.
- 2. CONTRACTOR TO PROVIDE PREFABRICATED ANCHOR BOLT BUILD-UP.
- 3. THE CITY WILL INSPECT THE AUGERED HOLE AND THE ANCHOR BOLT BUILD-UP AND PROVIDE WRITTEN APPROVAL PRIOR TO THE PLACEMENT OF CONCRETE.
- 4. NO WATER IS TO BE IN HOLE AT TIME OF CONCRETE PLACEMENT.
- 5. CONCRETE SHALL BE VIBRATED DURING PLACEMENT.
- 6. CONTRACTOR WILL PROVIDE NECESSARY CONDUIT FOR CONDUCTOR ENTRY.
- 7. COPPER CLAD GROUND ROD (1 REQUIRED) TO BE 5/8" DIA. x 8'-0".
- 8. CONDUIT TO EXTEND 1-2" ABOVE BASE. CABLES TO EXTEND 6" OUTSIDE OF HAND HOLE.
- 9. GROUND CABLE SHALL BE #8 SOFT BARE COPPER WIRE WELDED TO GROUND ROD WITH 24" SLACK ABOVE FOUNDATION TOP. THE NEUTRAL AT THE POLE IS TO BE CONNECTED TO THIS GROUND CABLE.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

STREETLIGHT FOUNDATION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SL-1

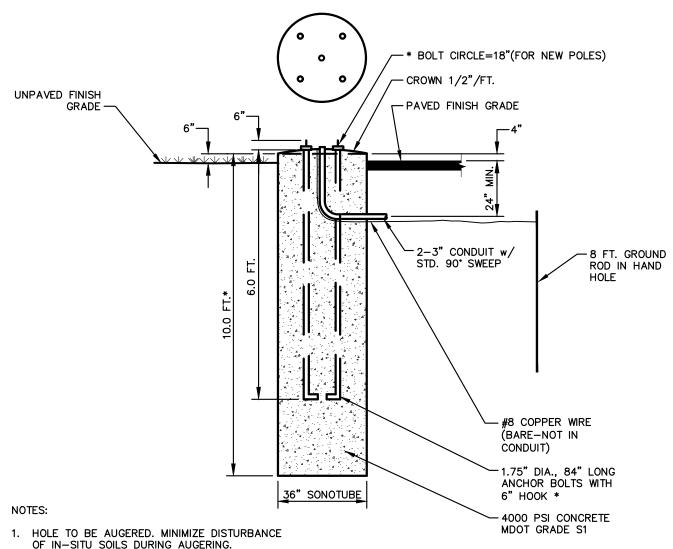

- OF IN-SITU SOILS DURING AUGERING.
- 2. CONTRACTOR TO PROVIDE PREFABRICATED ANCHOR BOLT BUILD-UP.
- 3. THE CITY WILL INSPECT THE AUGERED HOLE AND THE ANCHOR BOLT BUILD-UP AND PROVIDE WRITTEN APPROVAL PRIOR TO THE PLACEMENT OF CONCRETE.
- NO WATER IS TO BE IN HOLE AT TIME OF CONCRETE PLACEMENT.
- 5. CONCRETE SHALL BE VIBRATED DURING PLACEMENT.
- 6. CONTRACTOR WILL PROVIDE NECESSARY CONDUIT FOR CABLE ENTRY. THE CONDUIT WILL NOT BE PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THIS ITEM OF WORK.

UNLESS OTHERWISE NOTED ON THE PLANS OR CONTRACT DOCUMENTS




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

TRAFFIC SIGNAL POLE FOUNDATION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SL-2

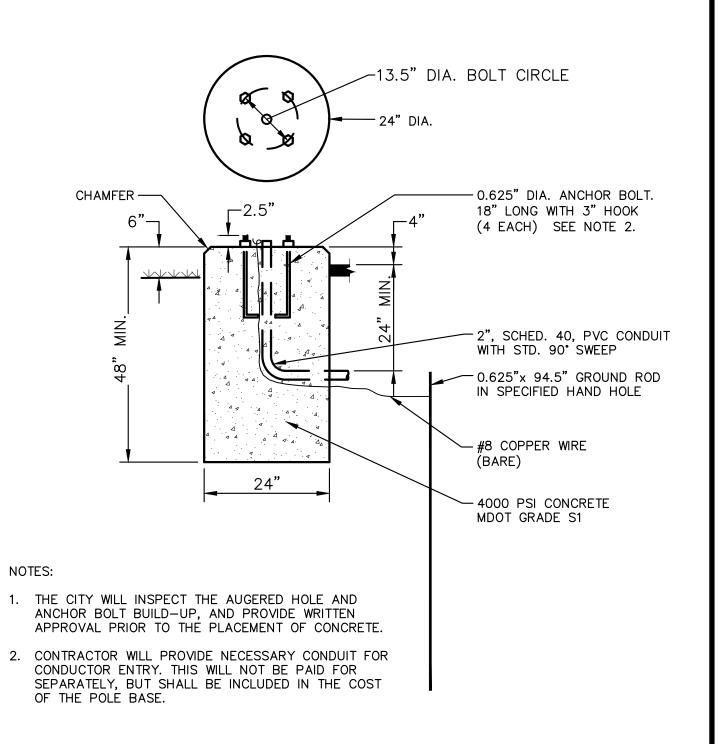




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

PEDESTRIAN SIGNAL POLE FOUNDATION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SL-3

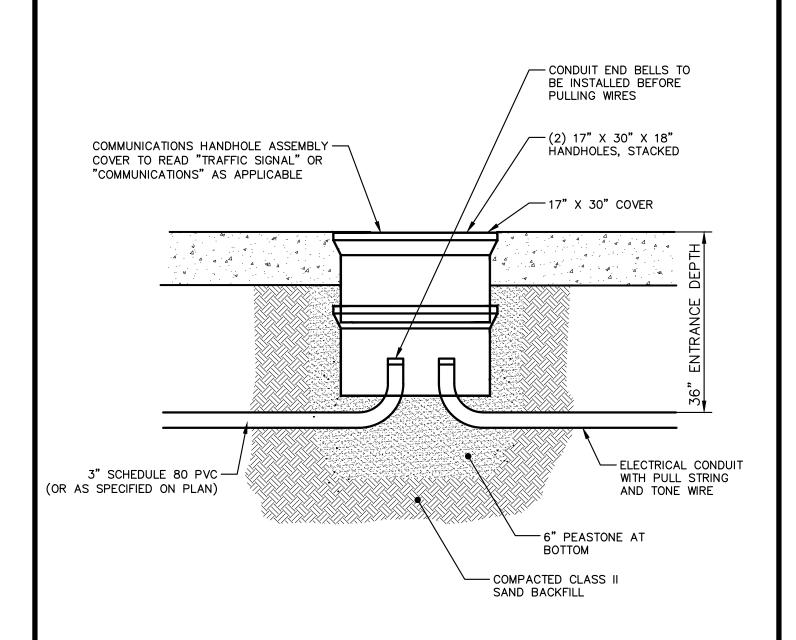

INSTALLATION NOTE:

THE CONDUIT SHALL BE LOWERED TO A MINIMUM ENTRANCE DEPTH OF 36" BELOW TOP OF THE HANDLE OVER A DISTANCE OF 10 FT. ON EACH SIDE OF THE HANDHOLE ASSEMBLY

IF THE CONDUIT HAS TO ENTER THE HANDHOLE AT A DEPTH GREATER THAN 36" DEEP DUE TO CONFLICT, THEN 90 DEGREE SWEEPS SHALL BE PROVIDED."

BACKFILL CONDUIT AND HANDHOLE W/CLASS II SAND. IF PLACED IN GREENBELT, PLACE 4" OF TOP SOIL.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

COMMUNICATIONS HANDHOLE ASSEMBLY

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-E-1

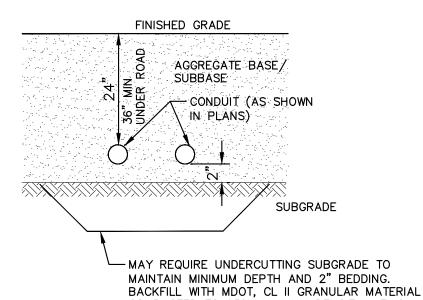

SEPARATELY.

COMPACTED TO 95% MAXIMUM DENSITY. THIS WORK SHALL BE INCLUDED IN COST OF CONDUIT IF REQUIRED AND WILL NOT BE PAID FOR




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

CONDUIT PLACEMENT DETAIL

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-E-2

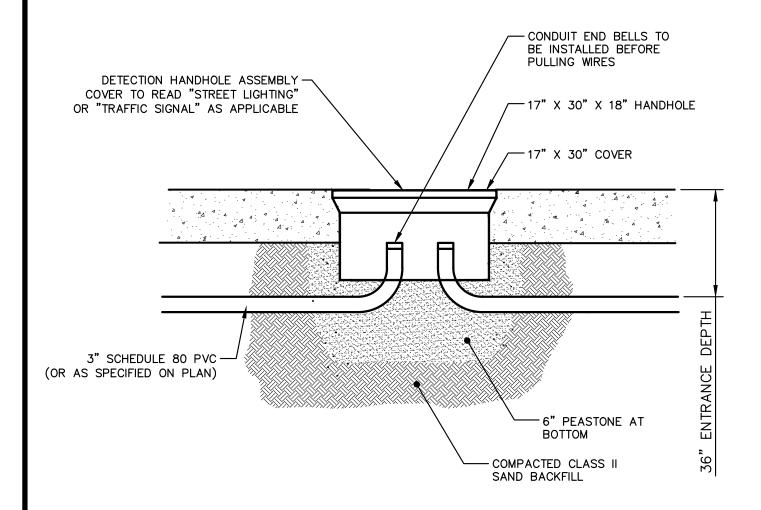

INSTALLATION NOTE:

THE CONDUIT SHALL BE LOWERED TO A MINIMUM ENTRANCE DEPTH OF 36" BELOW TOP OF THE HANDLE OVER A DISTANCE OF 10 FT. ON EACH SIDE OF THE HANDHOLE ASSEMBLY

IF THE CONDUIT HAS TO ENTER THE HANDHOLE AT A DEPTH GREATER THAN 36" DEEP DUE TO CONFLICT, THEN 90 DEGREE SWEEPS SHALL BE PROVIDED."

BACKFILL CONDUIT AND HANDHOLE W/CLASS II SAND. IF PLACED IN GREENBELT, PLACE 4" OF TOP SOIL.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

	REV. NO.	DATE	DRAWN BY	CHECKED BY
1				

ELECTRICAL HANDHOLE ASSEMBLY

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-E-3

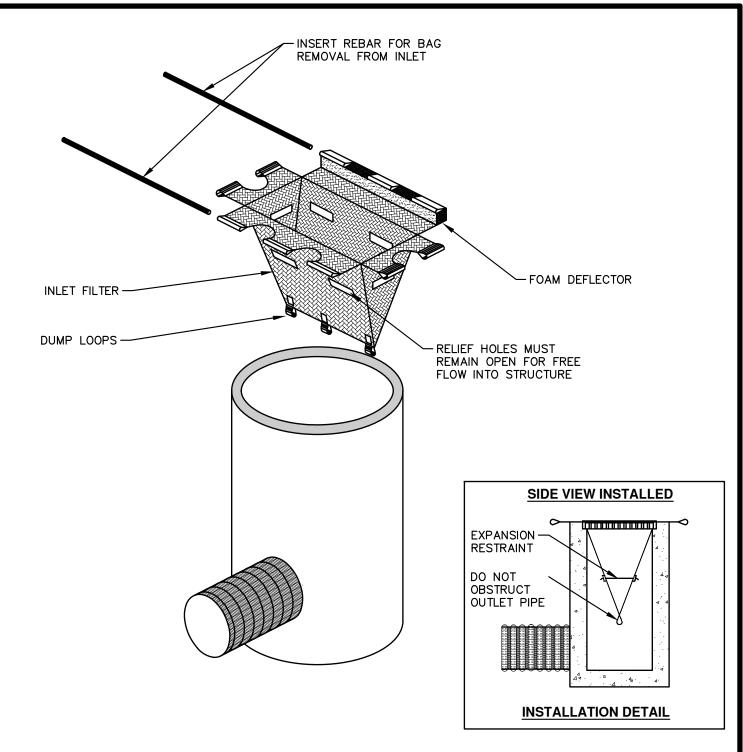

- 1. SIZE AND SHAPE OF INLET FILTER SHALL MATCH THE STRUCTURE.
- 2. WHERE CONDITIONS WARRANT, THE FILTER SHALL BE MADE WITH AN OIL—ABSORBENT FILTER WITH A WOVEN PILLOW INSERT.





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

INLET PROTECTION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SESC-1

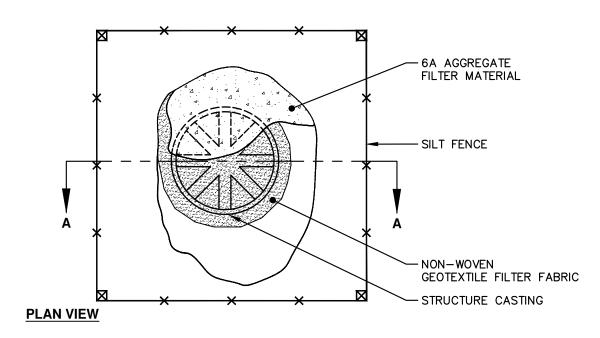

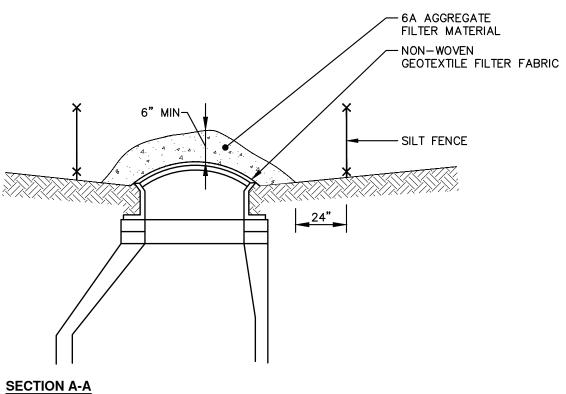





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO. DATE DRAWN BY	CHECKED BY


STONE FILTER

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SESC-2

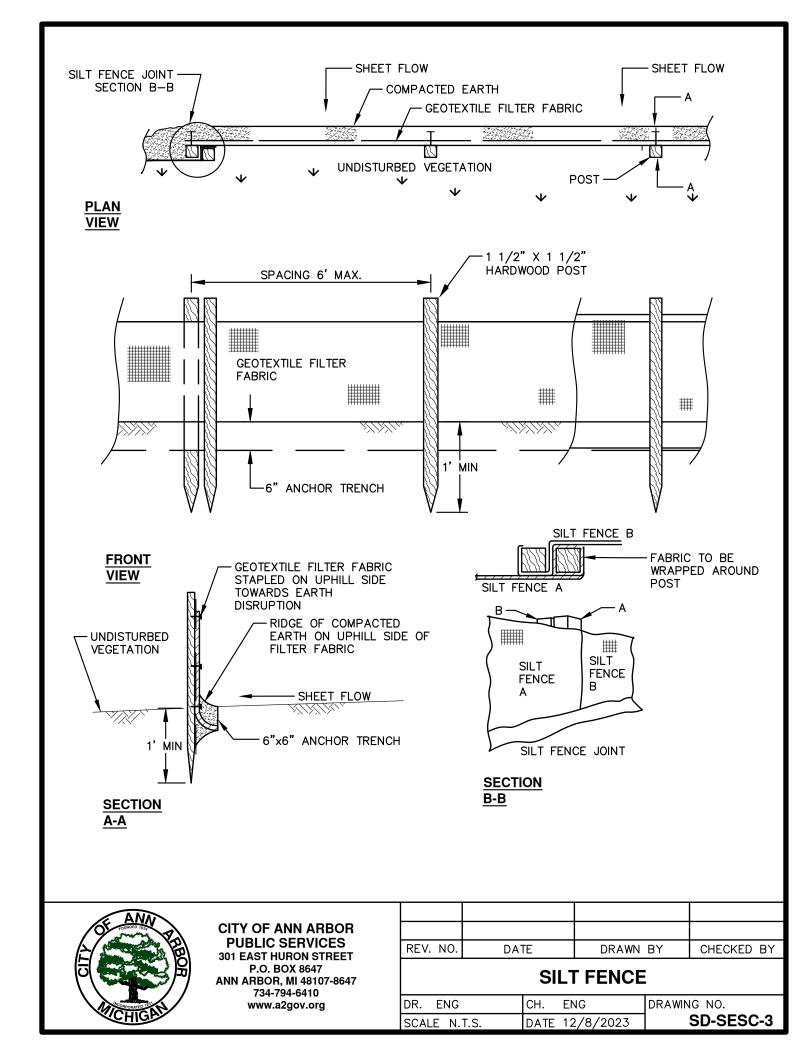




ANCHOR SLOT BURY UPHILL END IN TRENCH 6" DEEP AND STAKE* 12" O.C.




LONGITUDINAL OVERLAP OVERLAP EDGES 6" AND STAKE* 12" O.C.

*BIODEGRADABLE STAKES ARE TO BE USED TO ANCHOR MATTING TO THE GROUND. MINIMUM STAKE LENGTH SHALL BE 6".



TERMINAL FOLD TURN END UNDER 6" AND STAKE* 12" O.C.

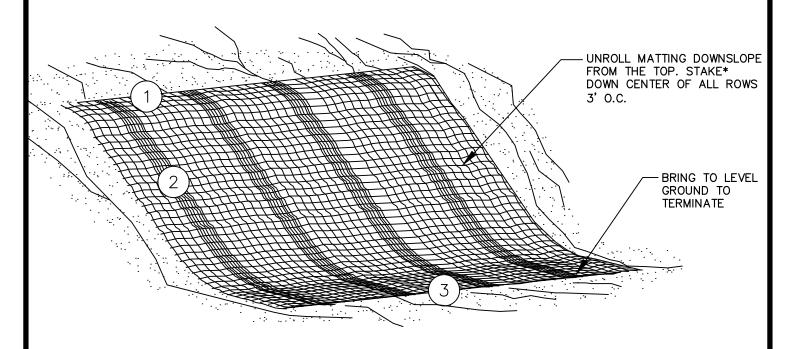

NOTE:

PROVIDE EROSION CONTROL MATTING ON ALL DISTURBED AREAS TO BE PERMANENTLY RESTORED WITH GRASS AND AS DIRECTED BY THE ENGINEER. SEE LANDSCAPE PLANS FOR MORE DETAILS. MATERIAL SHALL BE RAPIDLY BIODEGRADABLE. USE OF PLASTIC MATERIALS IS SPECIFICALLY PROHIBITED.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

MULCH BLANKET

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SESC-4

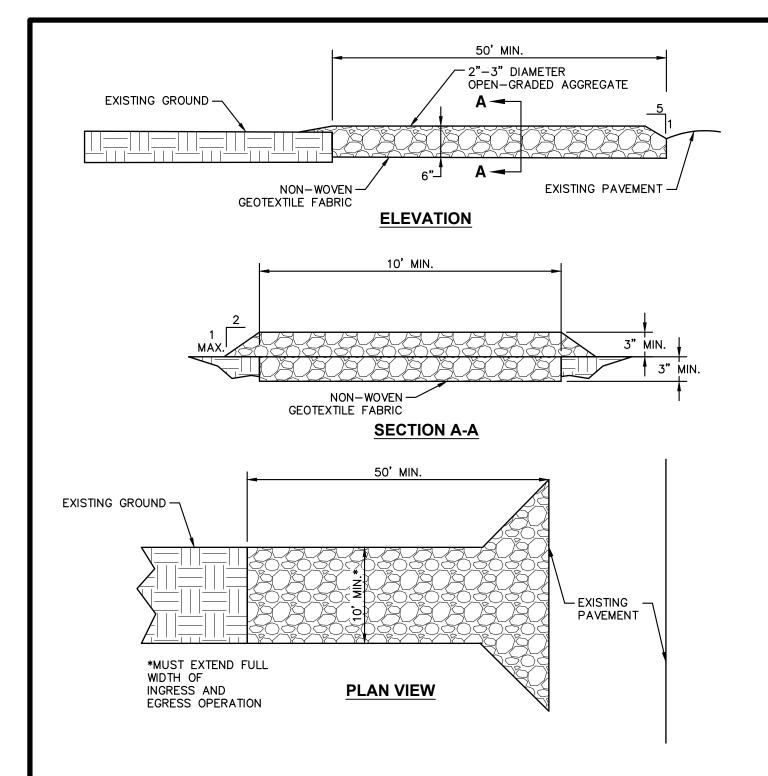

ADDITIONAL WIDTH AT CONNECTION TO EXISTING PAVEMENT SHALL BE AS NEEDED TO ACCOMMODATE VEHICLE TURNING.



CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY
	ML	JD MAT	

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SESC-5

NOTIFY THE CITY OF ANN ARBOR SOIL EROSION CONTROL OFFICE 48 HOURS PRIOR TO BEGINNING WORK ON THE PROJECT. PHONE: 734-794-6265.

- 1. THE CONTRACTOR SHALL IMPLEMENT AND MAINTAIN THE SOIL EROSION CONTROL MEASURES AS SHOWN ON THE PLANS AND AS DIRECTED BY THE ENGINEER AT ALL TIMES DURING CONSTRUCTION. ANY MODIFICATIONS OR ADDITIONS TO THE SOIL EROSION CONTROL MEASURES DUE TO CONSTRUCTION OR CHANGED CONDITIONS SHALL BE AS DIRECTED AND APPROVED BY THE ENGINEER.
- 2. ALL SOIL EROSION AND SEDIMENTATION CONTROL WORK SHALL CONFORM TO THE PERMIT REQUIREMENTS OF THE CITY OF ANN ARBOR, CHAPTER 55 ANN ARBOR UNIFIED DEVELOPMENT CODE, CITY OF ANN ARBOR STANDARDS DIVISION VII, THE LAWS OF THE STATE OF MICHIGAN, AND THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.
- 3. DAILY, OR AFTER ANY STORM EVENT, INSPECTIONS OF EROSION CONTROL MEASURES SHALL BE MADE BY THE CONTRACTOR. PERIODIC INSPECTIONS MAY BE MADE BY THE ENGINEER TO DETERMINE THE EFFECTIVENESS OF EROSION AND SEDIMENTATION CONTROL MEASURES. ANY NECESSARY CORRECTIONS SHALL BE MADE WITHOUT DELAY, AND WITHOUT ADDITIONAL COST TO THE CITY OF ANN ARBOR.
- 4. EROSION AND SEDIMENTATION FROM WORK ON THE SITE SHALL BE CONTAINED ON THE SITE AND NOT BE ALLOWED TO COLLECT ON ANY OFF-SITE AREAS, ROADWAYS OR WATERWAYS.
- 5. ALL MUD/SOIL TRACKED ONTO ROADWAYS FROM THE SITE DUE TO CONSTRUCTION, SHALL BE PROMPTLY REMOVED BY THE CONTRACTOR. IF SO ORDERED, THE CONTRACTOR SHALL PROVIDE AND OPERATE A VACUUM—TYPE STREET SWEEPER, AT NO ADDITIONAL COST TO THE CITY OF ANN ARBOR.
- 6. RESTORATION OF ALL DISTURBED AREAS, INCLUDING PLACEMENT OF TOPSOIL, SEED, FERTILIZER AND MULCH AND/OR SOD SHALL BE PERFORMED WITHIN FIVE (5) DAYS OF THE COMPLETION OF FINAL GRADE EXCEPT WHERE TEMPORARY SEEDING OR AN ANCHORED MULCH BLANKET ARE SET FORTH AS TEMPORARY MEASURES PER THE APPROVED SEQUENCE OF SOIL EROSION MEASURES.
- 7. CONSTRUCTION OPERATIONS SHALL BE SCHEDULED AND PERFORMED SO THAT PREVENTATIVE SOIL EROSION CONTROL MEASURES ARE IN PLACE PRIOR TO EXCAVATION IN CRITICAL AREAS AND TEMPORARY STABILIZATION MEASURES ARE IN PLACE IMMEDIATELY FOLLOWING BACKFILLING OPERATIONS.
- 8. SPECIAL PRECAUTIONS WILL BE TAKEN IN THE USE OF CONSTRUCTION EQUIPMENT TO PREVENT SITUATIONS THAT PROMOTE EROSION.
- 9. PROPER DUST CONTROL SHALL BE MAINTAINED DURING CONSTRUCTION BY USE OF WATER TRUCKS AND/OR DUST PALLIATIVE AS REQUIRED.
- 10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING ALL TEMPORARY SOIL EROSION CONTROL MEASURES AND REMOVAL OF SOME MEASURES UPON AUTHORIZED COMPLETION OF THE PROJECT. FINAL COMPLETION OF PROJECT WILL NOT BE AUTHORIZED UNTIL ALL SITE WORK AND UTILITY CONSTRUCTION IS COMPLETE AND ALL SOILS ARE STABILIZED.
- 11. THE CONTRACTOR SHALL NOT GRADE INTO ADJACENT PROPERTIES. SILT AND PROTECTIVE FENCE SHALL BE INSTALLED AND MAINTAINED TO PREVENT GRADING, EROSION AND SEDIMENTATION INTO THE ADJACENT PROPERTIES.
- 12. TREE PROTECTION FENCING MUST REMAIN INTACT UNTIL RESTORATION OF THE SITE IS COMPLETE.



CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY	
STANDARD SOIL EROSION AND				

STANDARD SOIL EROSION AND SEDIMENTATION CONTROL NOTES

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-SESC-6

SEQUENCE OF EROSION CONTROL MEASURES:

1. THE CONTRACTOR IS TO SUBMIT TO THE ENGINEER, A SEQUENCE OF CONSTRUCTION WITH RESPECT TO THE SOIL EROSION CONTROL MEASURES FOR REVIEW, COMMENT AND APPROVAL. THIS SCHEDULE IS TO INCLUDE INSPECTION AND REPAIR OF ALL TEMPORARY EROSION CONTROL MEASURES DAILY AND WITHIN 24 HOURS OF A STORM EVENT.

SAMPLE SOIL EROSION AND SEDIMENTATION CONTROL INSTALLATION MINIMUM REQUIREMENTS:

- 1.1. INSTALL SILT FENCE, TREE PROTECTION FENCING, MUD MATS, INLET FILTERS ON EXISTING DRAINAGE FEATURES, AND ALL OTHER TEMPORARY SOIL EROSION CONTROLS, PRIOR TO ANY CLEARING OR EARTH MOVING OPERATION.
- 1.2. STRIP AND STOCKPILE TOPSOIL. STABILIZE STOCKPILE AS REQUIRED.
- 1.3. INSTALL WATER MAINS, STORM AND SANITARY SEWERS, AND OTHER ENCLOSED DRAINAGE FEATURES. NEW INLET FILTERS SHALL BE INSTALLED IMMEDIATELY FOLLOWING INSTALLATION OF NEW DRAINAGE INLETS.
- 1.4. PERFORM MACHINE GRADING OPERATIONS AND CONSTRUCT PAVEMENTS (MAINLINE, SIDEWALKS, DRIVES, ETC.).
- 1.5. CONTINUALLY MAINTAIN EROSION AND SEDIMENTATION CONTROL MEASURES, AS REQUIRED TO ALLOW DRAINAGE AND SEDIMENT REMOVAL. REMOVE ANY ACCUMULATED SEDIMENT IMMEDIATELY.
- 1.6. COMPLETE ALL FINE GRADING.
- 1.7. INSTALL TEMPORARY SEED DURING CONSTRUCTION IN ACCORDANCE WITH ARTICLE 8 OF THE CITY'S PUBLIC WORKS DESIGN AND CONSTRUCTION STANDARDS. DURING MONTHS UNFAVORABLE TO SEEDING, AN ANCHORED MULCH BLANKET SHALL BE INSTALLED PER SD—SESC—4.
- 1.8. REFER TO LANDSCAPE PLANTING PLANS FOR PERMANENT SITE STABILIZATION.
- 1.9. CLEAN OUT STORM SEWER SYSTEMS.
- 1.10. REMEDY ANY NOTED DEFECTS TO THE SATISFACTION OF THE CITY OF ANN ARBOR'S SOIL EROSION AND SEDIMENTATION CONTROL OFFICIAL.
- 1.11. ALL TEMP. SOIL EROSION CONTROL MEASURES MUST BE REMOVED, WITH ENGINEERS APPROVAL, PRIOR TO FINAL INSPECTION


NOTE: THIS SEQUENCE IS FOR INFORMATION ONLY. IT IS INTENDED TO SHOW THE SEQUENCE OF CONSTRUCTION WITH RESPECT TO THE SOIL EROSION AND SEDIMENTATION CONTROL MEASURES. THE CONTRACTOR IS RESPONSIBLE FOR SUBMITTING THEIR OWN DETAILED CONSTRUCTION SEQUENCE AND SCHEDULE TO THE ENGINEER FOR REVIEW, COMMENT, AND APPROVAL. THE APPROVED SEQUENCE OF SOIL EROSION MEASURES MUST BE INCLUDED ON THE APPROVED CONSTRUCTION PLANS.



CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY
SEQUENCE OF SOIL EROSION			

CONTROL MEASURES				
DR. ENG	CH. ENG	DRAWING NO.		
SCALE N.T.S.	DATE 12/8/2023	SD-SESC-7		

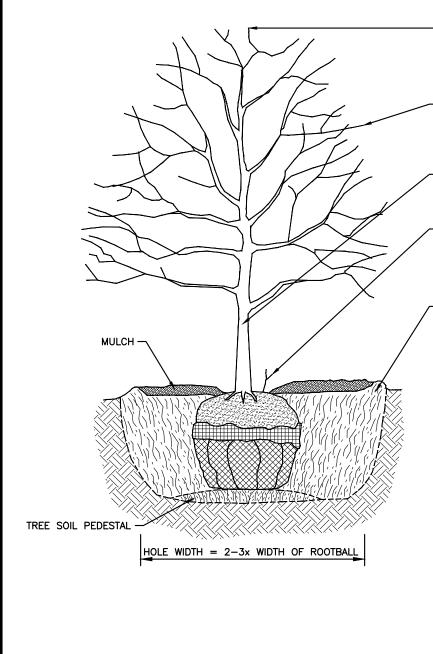

DO NOT PRUNE TERMINAL LEADER OR BRANCH TIPS.

PRUNE AWAY DEAD OR BROKEN BRANCHES ONLY.

REMOVE ALL LABELS, TAGS, TREE WRAP, TAPE OR STRING FROM TREE TRUNK AND CROWN.

PRUNE OFF SUCKERS.

- EXCAVATE HOLE TO TWO TO THREE TIMES THE WIDTH OF ROOTBALL.

BREAK UP (SCARIFY) SIDES OF PLANTING HOLE.

COMPACT SOIL AT BOTTOM OF HOLE TO CREATE A TREE PEDESTAL AS SHOWN.

BEFORE SETTING TREE IN HOLE, EXPOSE THE TRUNK FLARE BY REMOVING BURLAP AROUND TRUNK AND PULLING BACK SOIL.

SET AND CENTER ROOTBALL SO THAT TRUNK FLARE IS LEVEL TO GRADE OR VERY SLIGHTLY HIGHER IN CLAY SOIL.

WITHOUT DISTURBING DEVELOPED ROOTS, FOLD DOWN AND REMOVE ONE—THIRD TO ONE—HALF OF BURLAP TO EXPOSE ROOTBALL.

REMOVE AND DISPOSE OF ALL NON-BIODEGRADABLE MATERIALS, CUTTING AWAY WIRE BASKET TO 10" DEPTH.

BACKFILL HOLE WITH EXCAVATED SOIL, TAMP DOWN SOIL TO REMOVE AIR POCKETS, AND FIRMLY SET TREE. DO NOT AMEND SOIL UNLESS PLANTING IN SEVERELY DISTURBED SOIL.

PLACE DOUBLE—SHREDDED HARDWOOD MULCH 2"-3" DEEP LEAVING A 3" RADIUS CIRCLE OF BARE SOIL AROUND TRUNK OF TREE.

DO NOT STAKE TREE UNLESS PERMITTED PER DETAIL SD-L-2.

NO UTILITIES SHALL BE PERMITTED IN OR UNDER THE PLANTING HOLE EXCEPT WHERE TREE TUNNELING IS PERMITTED PER SD-L-4.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

TREE PLANTING

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-L-1

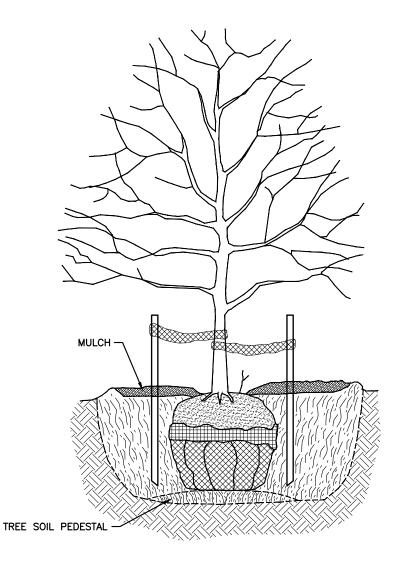

TREE STAKING IS ONLY PERMITTED UNDER ONE OR MORE OF THE FOLLOWING CIRCUMSTANCES:

- 1) IN HEAVY CLAY SOIL
- 2) IN WINDY CONDITIONS
- 3) 3" OR GREATER DIAMETER TREE TRUNK
- 4) TREE WITH LARGE CROWN

IF STAKING IS NEEDED DUE TO THESE CONDITIONS:

- \bullet STAKE WITH 2 x 2 HARDWOOD STAKES, OR APPROVED EQUAL, DRIVEN 6"-8" OUTSIDE OF ROOTBALL.
- LOOSELY STAKE TREE TRUNK TO ALLOW FOR TRUNK FLEXING.
- STAKE TREES JUST BELOW FIRST BRANCH WITH 2"-3" WIDE BELT-LIKE NYLON OR PLASTIC STRAPS (2 PER TREE ON OPPOSITE SIDES OF TREE).
- · CONNECT STRAPS FROM TREE TO STAKE HORIZONTALLY.
- DO NOT USE ROPE OR WIRE THROUGH A HOSE.
- REMOVE ALL STAKING MATERIALS AFTER 1 YEAR.





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

TREE STAKING

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-L-2

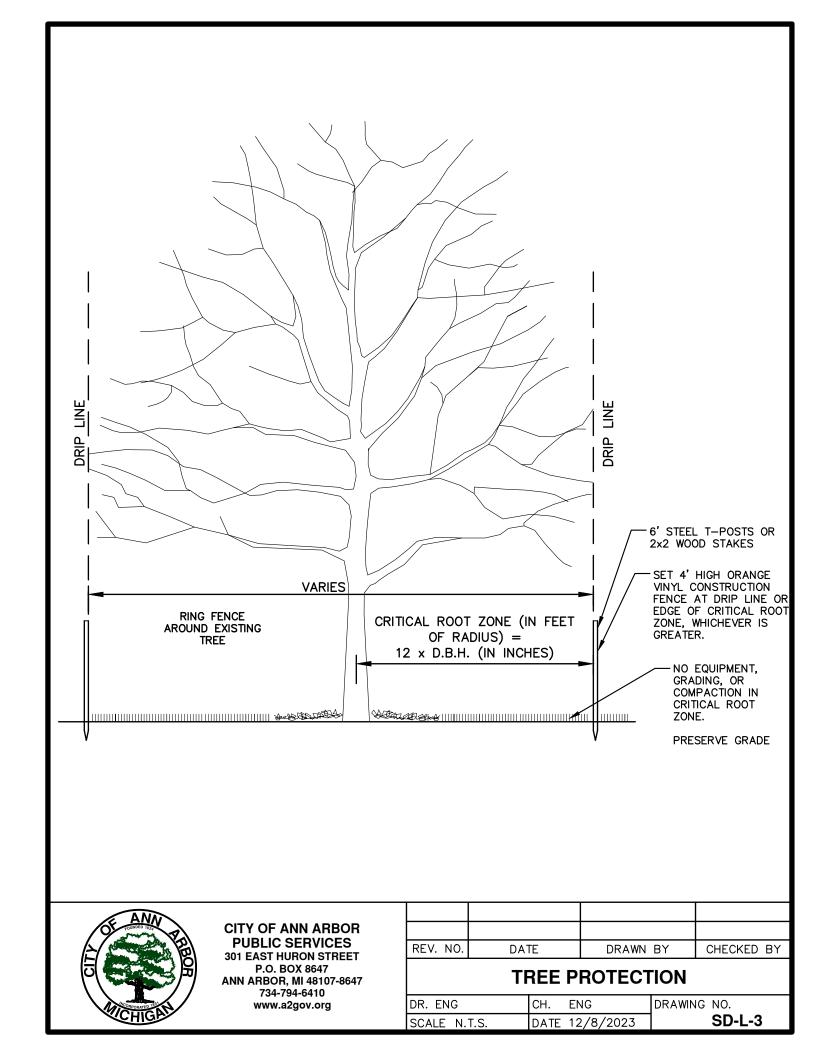

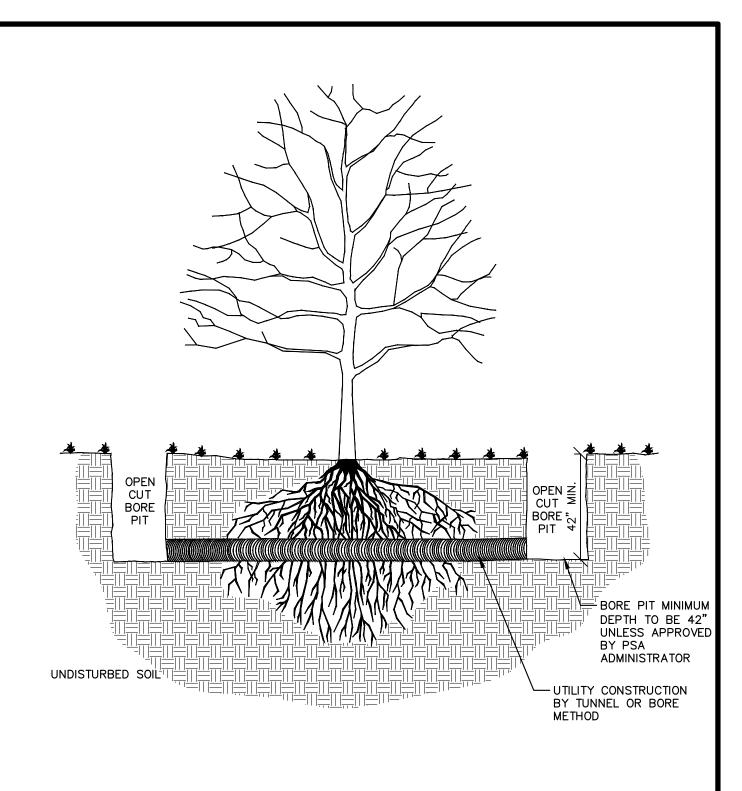

NOTE: IN ALL CASES, THE OPEN CUT BORE PIT SHALL BE LOCATED 1' BEYOND THE CRITICAL ROOT ZONE (SEE SD-L-3)




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

TREE TUNNELLING

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-L-4

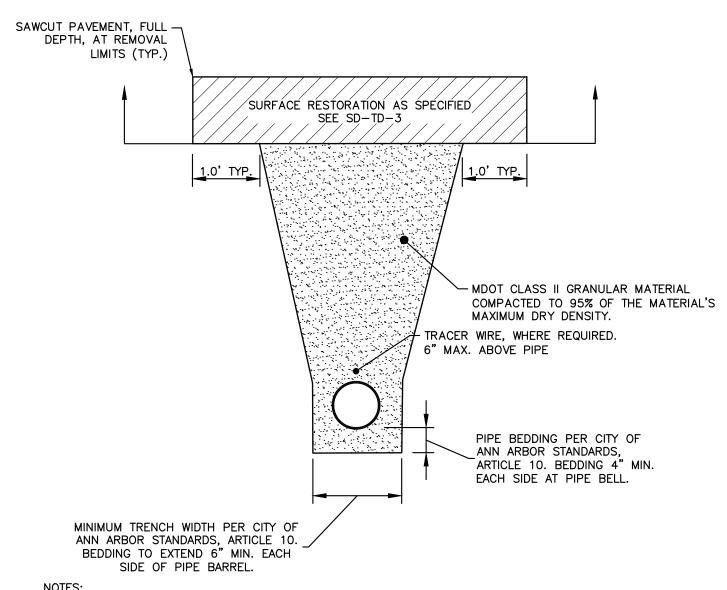

- 1. ALL TRENCH EXCAVATION, BEDDING, BACKFILLING, AND SURFACE RESTORATION SHALL COMPLY WITH CITY OF ANN ARBOR STANDARDS, ARTICLE 10.
- 2. TRENCH DETAILS SHOW TYPE OF BACKFILL AND TRENCHING REQUIREMENTS ONLY.
- 3. ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. AND CITY STANDARDS.
- 4. PIPE BEDDING THICKNESS UNDER CONCRETE PIPE 66" OR LARGER SHALL BE INCREASED TO 6".
- 5. SEE SD-TD-2 FOR SANITARY BEDDING AREA DETAIL. SEE SD-TD-4 FOR EDGE DRAIN BEDDING AND BACKFILL.
- 6. SURFACE RESTORATION SHALL NOT BE INCLUDED IN THE UNIT PRICE FOR PIPE AND WILL BE PAID FOR SEPARATELY.
- 7. NOT TO BE USED FOR SANITARY SEWER OR EDGE DRAIN.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

01	09/01/2025	A2D	SSORT
00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

UTILITY TRENCH - TYPE 1

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-TD-1

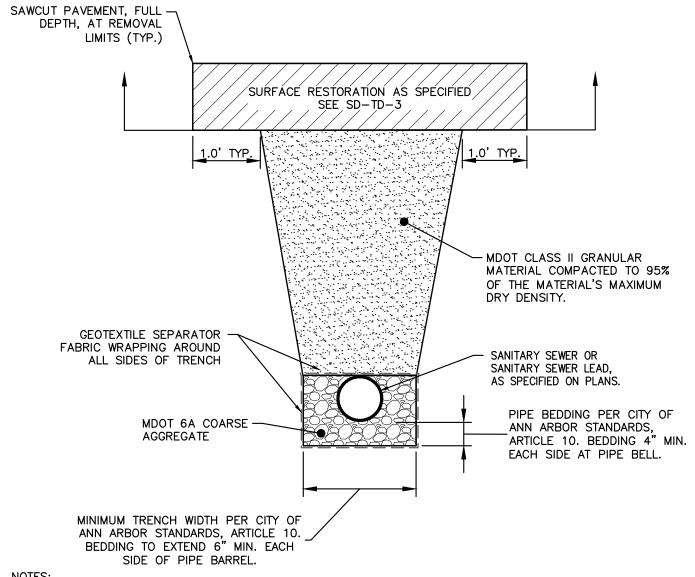

- 1. ALL TRENCH EXCAVATION, BEDDING, BACKFILLING, AND SURFACE RESTORATION SHALL COMPLY WITH CITY OF ANN ARBOR STANDARDS, ARTICLE 10.
- 2. TRENCH DETAILS SHOW TYPE OF BACKFILL AND TRENCHING REQUIREMENTS ONLY.
- 3. ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. AND CITY STANDARDS.
- 4. PIPE BEDDING THICKNESS UNDER CONCRETE PIPE 66" OR LARGER SHALL BE INCREASED TO 6".
- 5. SEE SD-TD-4 FOR EDGE DRAIN BEDDING AND BACKFILL DETAILS.
- 6. SURFACE RESTORATION SHALL NOT BE INCLUDED IN THE UNIT PRICE FOR PIPE AND WILL BE PAID FOR SEPARATELY.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

UTILITY TRENCH - TYPE 2

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-TD-2

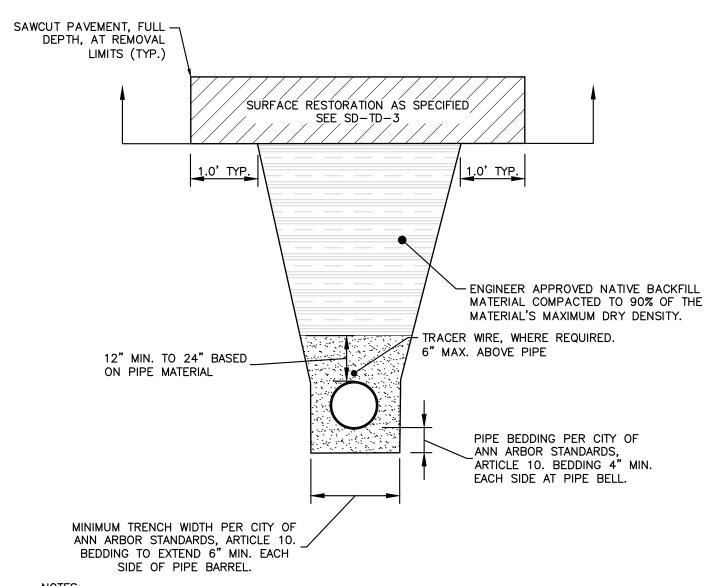

- 1. ALL TRENCH EXCAVATION, BEDDING, BACKFILLING, AND SURFACE RESTORATION SHALL COMPLY WITH CITY OF ANN ARBOR STANDARDS, ARTICLE 10.
- 2. TRENCH DETAILS SHOW TYPE OF BACKFILL AND TRENCHING REQUIREMENTS ONLY.
- 3. ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. AND CITY STANDARDS.
- 4. PIPE BEDDING THICKNESS UNDER CONCRETE PIPE 66" OR LARGER SHALL BE INCREASED TO 6".
- 5. SEE SD-TD-2 FOR SANITARY BEDDING AREA DETAIL. SEE SD-TD-4 FOR EDGE DRAIN BEDDING AND BACKFILL.
- 6. SURFACE RESTORATION SHALL NOT BE INCLUDED IN THE UNIT PRICE FOR PIPE AND WILL BE PAID FOR SEPARATELY.
- 7. NOT TO BE USED FOR SANITARY SEWER OR EDGE DRAIN.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


01	09/01/2025	A2D	SSORT
00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

UTILITY TRENCH - TYPE 3


DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-TD-3

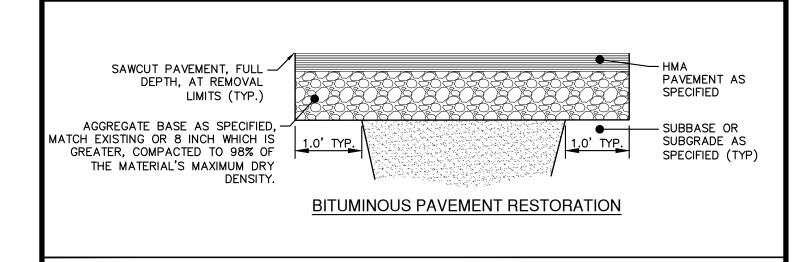

MDOT CLASS 23A DENSE GRADED -AGGREGATE (MIN. 8") COMPACTED TO 98% OF THE MATERIAL'S MAXIMUM DRY DENSITY.

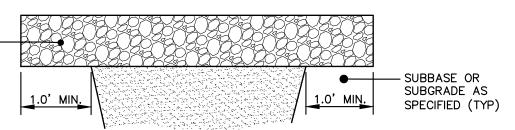

GRAVEL ROAD / PARKING

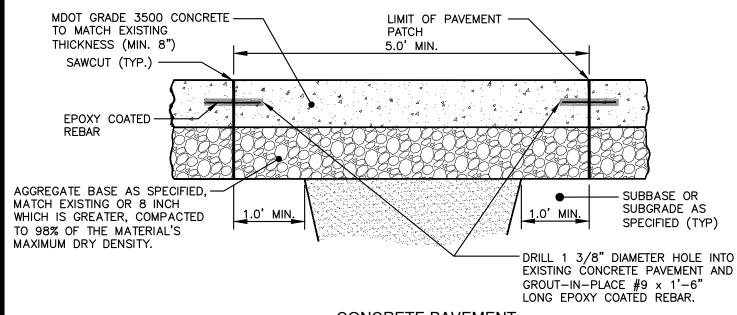

CONCRETE PAVEMENT





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY


UTILITY TRENCH SURFACE RESTORATION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-TD-4.1

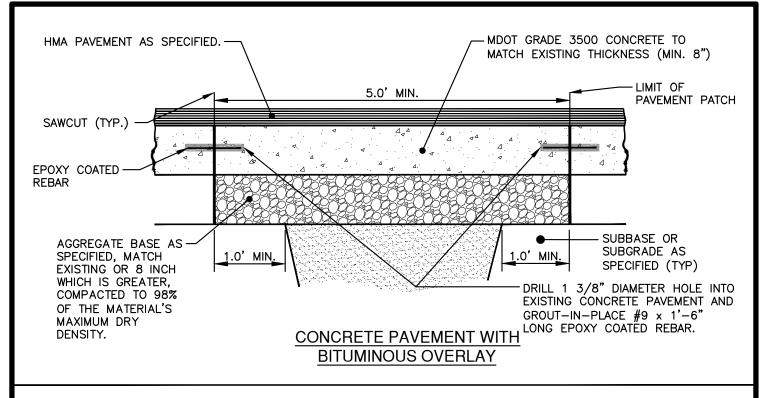

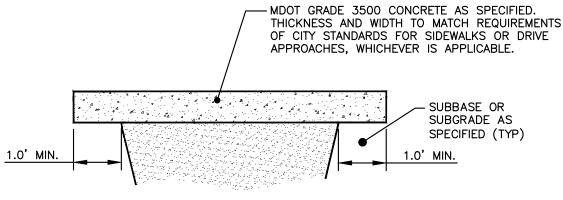

SIDEWALK OR DRIVE APPROACH



TURF

NOTE:

PIPE TO BE BEDDED AND BACKFILLED PER UTILITY TRENCH TYPE-1, TYPE-2, OR TYPE-3.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

UTILITY TRENCH SURFACE RESTORATION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-TD-4.2

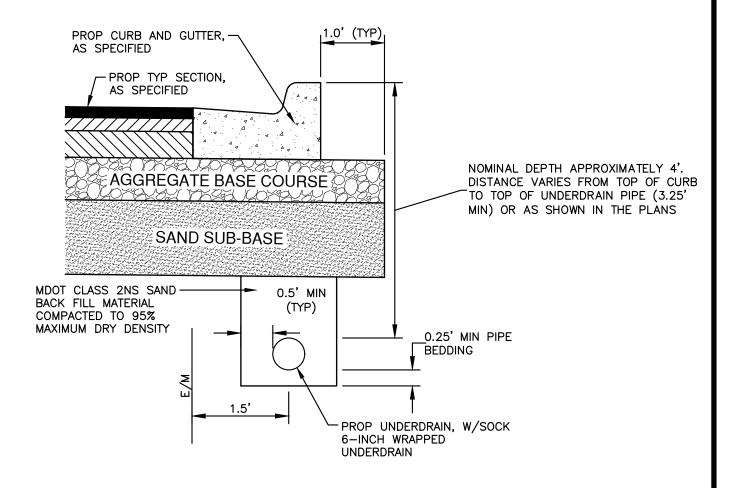

NOTES:

- 1. IN AREAS WHERE EDGE DRAIN CANNOT BE INSTALLED IN ACCORDANCE WITH THE DETAIL, THE EDGE DRAIN SHALL BE INSTALLED AT THE DEPTH AS INDICATED ON THE PLANS, OR AS DIRECTED BY ENGINEER. IN NO CASE SHALL THE EDGE DRAIN BE INSTALLED AT A GRADE LESS THAN 0.50% OR AT A DEPTH OF LESS THAN 3' BELOW TOP OF PROPOSED PAVEMENT.
- 2. FOR PAVEMENT BASE AND SUBBASE THICKNESS, SEE TYPICAL PAVEMENT CROSS-SECTION(S)
- 3. TRENCH DETAILS SHOW TYPE OF BACKFILL AND SURFACE RESTORATION ONLY
- 4. ALL TRENCHING TO CONFORM TO ALL APPLICABLE M.I.O.S.H.A. STANDARDS
- 5. EDGE DRAINS SHALL BE CONNECTED TO A DRAINAGE STRUCTURE AND WILL EXTEND A MINIMUM OF 100 FEET UPSLOPE FROM THE STRUCTURE.
- 6. ADDITIONAL LENGTHS OF EDGE DRAIN MAY BE REQUIRED BY THE ENGINEER BASED ON EXISTING SITE CONDITIONS, INCLUDING CONDITION OF THE SUBGRADE.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

TYPICAL EDGE DRAIN TRENCH

DR. ENG	сн.	ENG	DRAWING NO.	DRAWING
SCALE N.T.S.	DATE	12/8/2023	SD-TD-5	9

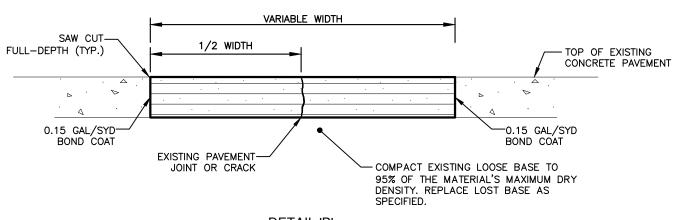

<u>DETAIL 'B'</u> FULL DEPTH HMA REPAIR OF CONCRETE PAVEMENT

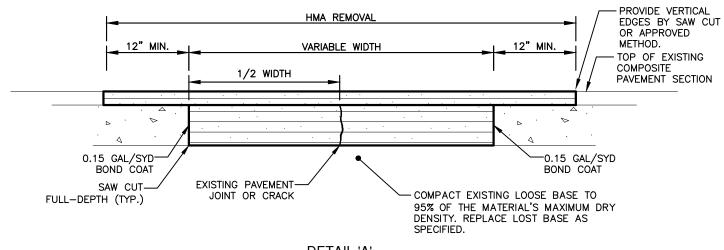

<u>DETAIL 'A'</u> <u>FULL DEPTH HMA REPAIR OF COMPOSITE PAVEMENT SECTION</u> (CONCRETE PAVEMENT WITH HMA SURFACE)

FOR DETAIL A & B:

- 1. REMOVE THE DETERIORATED CONCRETE FULL DEPTH.
- 2. THE REMOVED MATERIAL SHALL BE REPLACED WITH A HMA TOP COURSE MIXTURE.
- 3. THE HMA SHALL BE COMPACTED WITH A MACHINE VIBRATOR OR APPROVED ROLLER.
- 4. BASE LIFTS ARE NOT TO EXCEED 3 INCHES WITH THE TOP COURSE NOT TO EXCEED 2 INCHES.
- 5. THE FINAL SURFACE SHALL BE FLUSH WITH THE EXISTING PAVEMENT SURFACE.





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY


HMA REPAIR OF CONCRETE PAVEMENT

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	09/01/2025	SD-TD-6

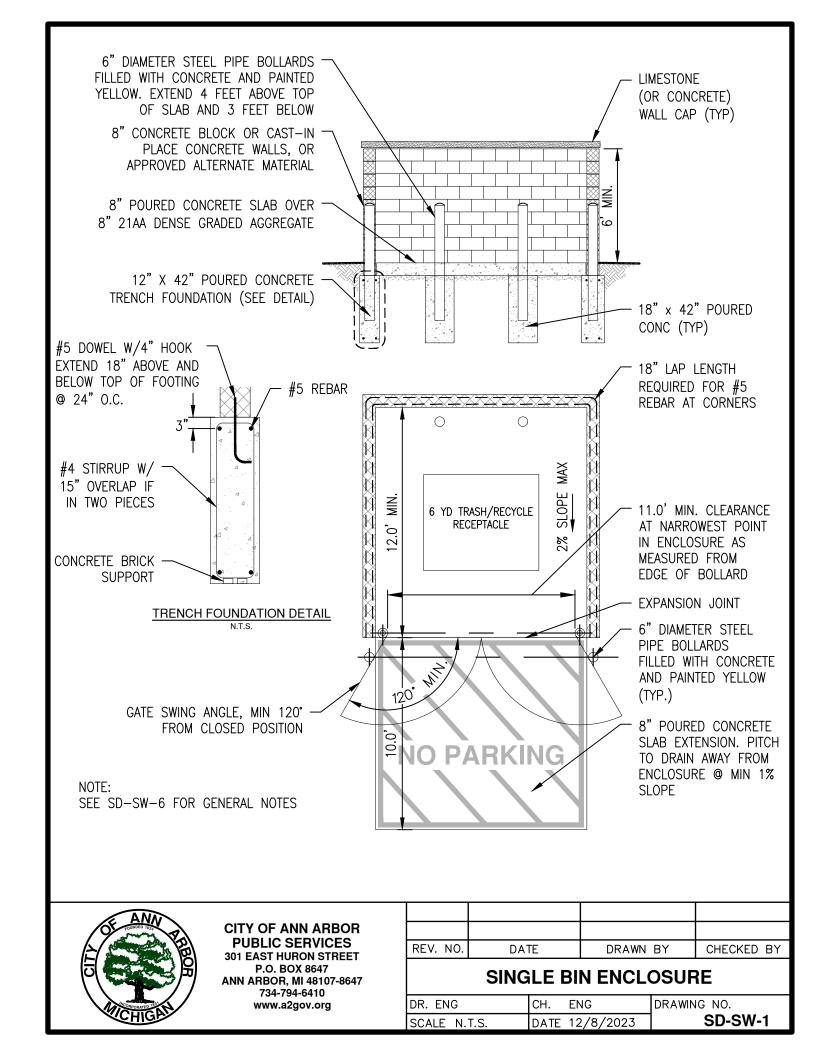


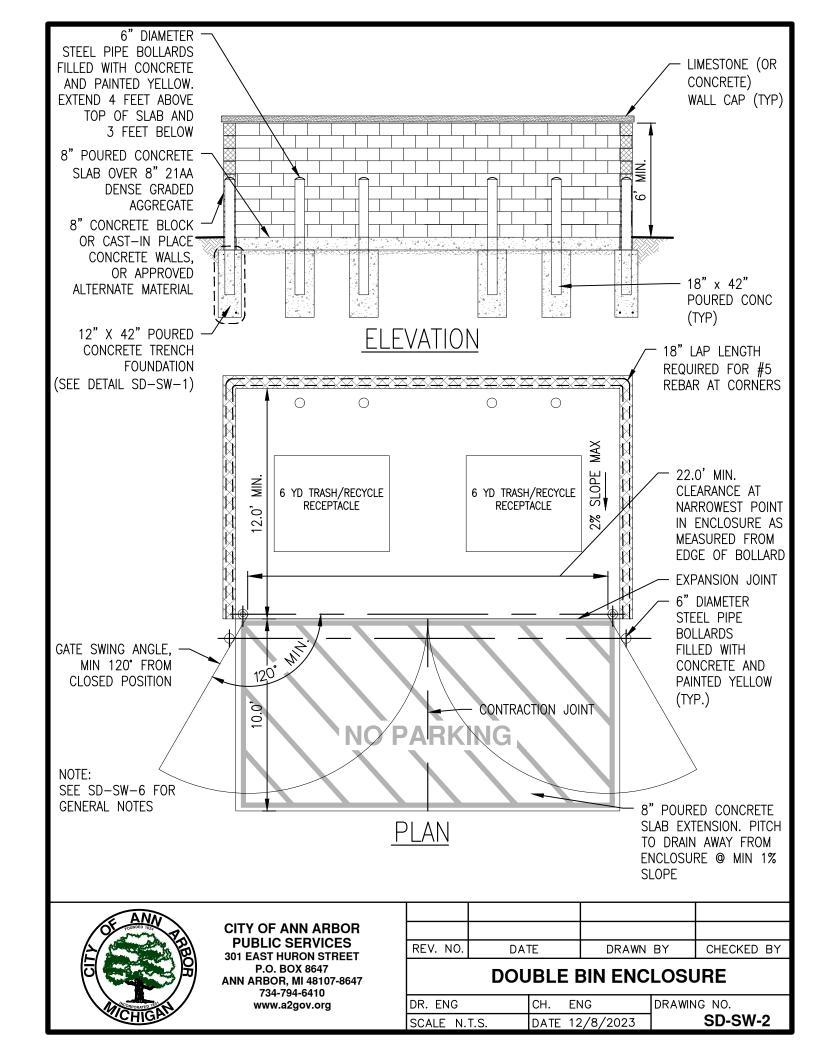

ACCEPTABLE

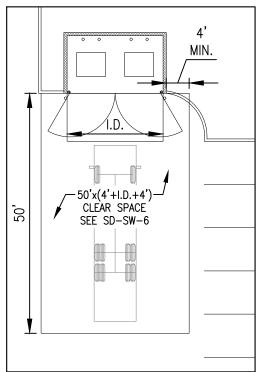


DIRECT ACCESS (PREFERRED)

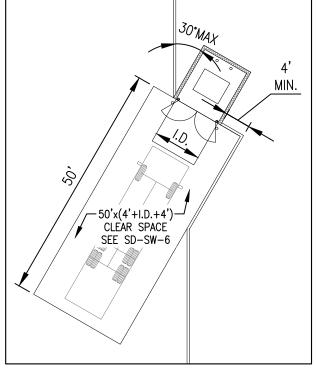


OPTIONAL ANGLED DIRECT ACCESS (ACCEPTABLE WITH APPROVAL)



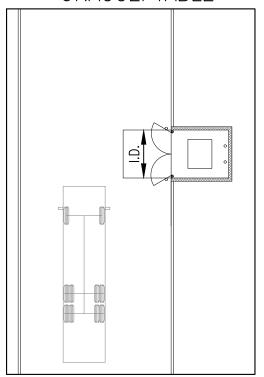

INDIRECT ACCESS

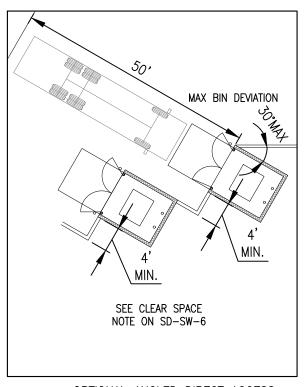

OPTIONAL ANGLED DIRECT ACCESS (ACCEPTABLE WITH APPROVAL)





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

STANDARD BIN ENCLOSURE **LAYOUTS**

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SW-3

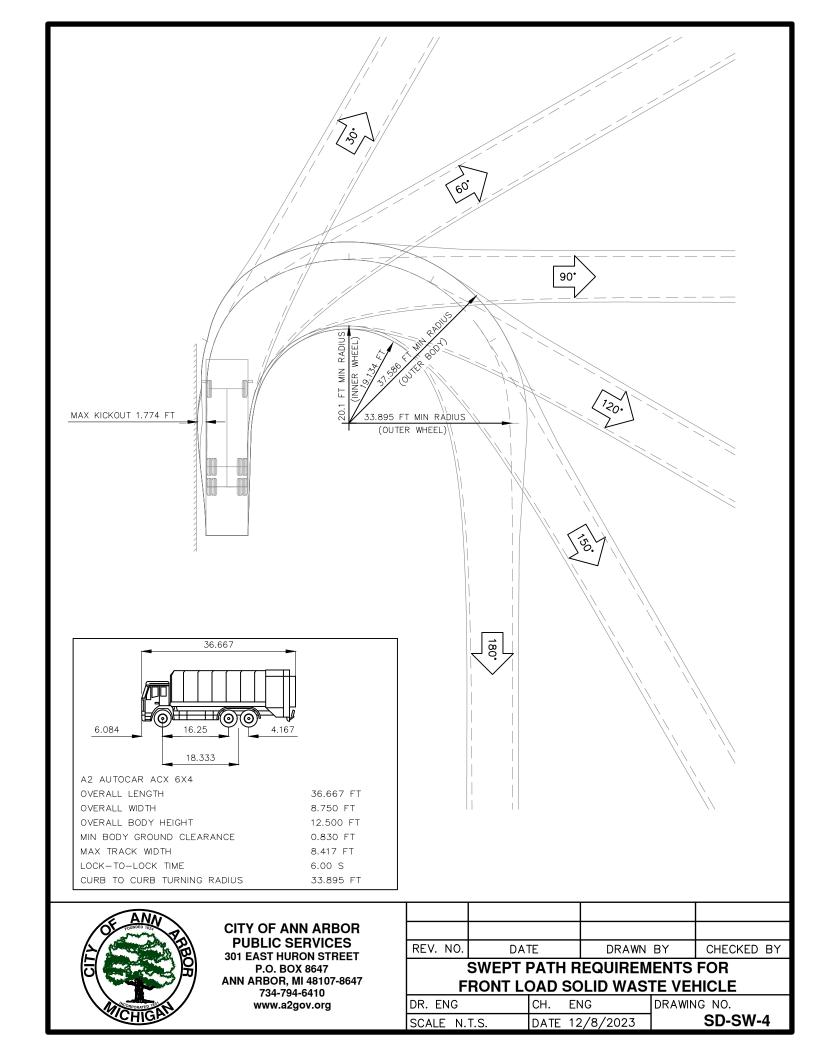

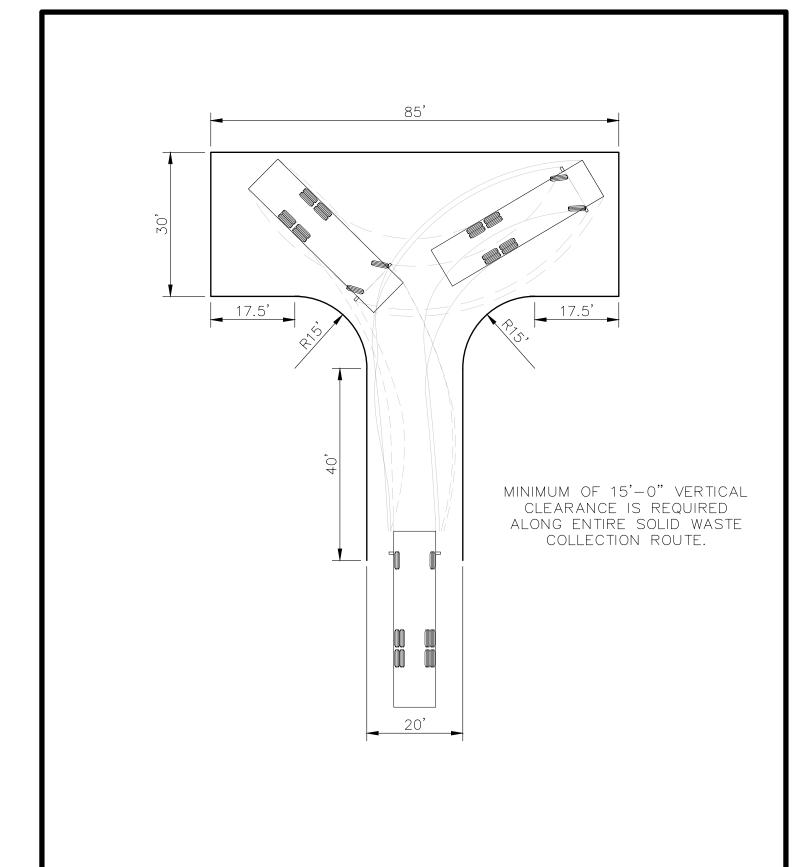



REV. NO.	DATE	DRAWN BY	CHECKED BY

SOLID WASTE VEHICLE TURN-AROUND

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SW-5

- 1. MAINTAIN A CLEAR SPACE DIRECTLY IN FRONT OF THE SOLID WASTE ENCLOSURE. THE CLEAR SPACE SHALL BE A MINIMUM OF FIFTY (50) FEET LONG BY THE WIDTH OF THE INSIDE DIMENSION (I.D.) OF THE ENCLOSURE WALLS PLUS FOUR (4) FEET ON EACH SIDE. A MINIMUM VERTICAL CLEARANCE OF AT LEAST TWENTY—FIVE (25) FEET MUST BE PROVIDED ABOVE THIS AREA.
- 2. INGRESS AND EGRESS ROUTES MUST BE DEVELOPED BASED ON SOLID WASTE SWEPT PATH REQUIREMENTS PER SD—SW—4. A MINIMUM HORIZONTAL CLEARANCE OF FOUR (4) FEET FROM THE EDGE OF THE SWEPT PATH AND A MINIMUM VERTICAL CLEARANCE OF AT LEAST FIFTEEN (15) FEET MUST BE PROVIDED ALONG THE ENTIRE SOLID WASTE COLLECTION ROUTE.
- PROVIDE TEN (10) FEET MINIMUM HORIZONTAL CLEARANCE FROM SOLID WASTE ENCLOSURE TO MAJOR ELECTRICAL EQUIPMENT, ABOVE GROUND UTILITY SERVICES, AND EDGE OF OVERHEAD OBSTRUCTIONS SUCH AS TREE BRANCHES, BALCONIES, AND OVERHANGS.
- 4. IF FORWARD ACCESS TO THE PUBLIC STREET IS NOT AVAILABLE FOR THE SOLID WASTE VEHICLE, THE SITE DEVELOPMENT LAYOUT MUST ACCOMMODATE A TURN—AROUND LOCATION MEETING REQUIREMENTS WITHIN SOLID WASTE REFERENCE SPECIFIC TURN—AROUND DETAIL (SD—SW—5) AND ACCEPTABLE TO THE PSAA.
- 5. FOR SITES THAT CANNOT ACCOMMODATE A TURN-AROUND, THE FOLLOWING ADDITIONAL REQUIREMENTS MUST BE MET:
 - 5.1. SOLID WASTE VEHICLES MUST BE ABLE TO SERVICE DUMPSTERS WITHOUT IMPEDING THE PUBLIC STREET OR SIDEWALK.
 - 5.2. THE COLLECTION LOCATION SHALL BE CLEARLY DELINEATED AND NOT HAVE A SLOPE GREATER THAN 2% IN ANY DIRECTION.
 - 5.3. BOLLARDS OR ADEQUATE CLEAR SPACE MUST BE PROVIDED BEHIND THE LIFT POINT SO THE DUMPSTERS ARE NOT PUSHED INTO ANY BUILDING OR ACCESS ROUTE.
 - 5.4. ALL SWEPT—PATH CLEARANCE AND VERTICAL CLEARANCE REQUIREMENTS PREVIOUSLY IDENTIFIED SHALL BE PROVIDED.
 - 5.5. SOLID WASTE VEHICLE BACK-UP DISTANCES MUST BE LESS THAN 30' ALONG SERVICING ROUTE.
- 6. GATES ON BIN ENCLOSURES SHALL OPEN A MINIMUM OF 120 DEGREES FROM THE CLOSED POSITION. THE GATES SHALL NOT IMPEDE ON THE REQUIRED BIN ENCLOSURE OPENING WIDTH, SHALL NOT BLOCK ADJACENT PARKING SPOTS, AND NOT BE IMPEDED BY ADJACENT CURBS OR LANDSCAPING.
- 7. GATES SHALL BE DESIGNED TO BE FREE STANDING WITHOUT CENTER POLE DESIGN. IF CENTER POLE DESIGN IS NECESSARY, 12 INCHES SHALL BE ADDED TO THE MINIMUM INTERIOR WIDTH OF THE ENCLOSURE.
- 8. GATE DESIGN SHALL INCLUDE A RELIABLE MEANS TO SECURE THE DOOR IN BOTH THE OPEN AND CLOSED POSITIONS.



00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

SOLID WASTE GENERAL NOTES

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-SW-6A


- 9. THE PROPERTY OWNER SHALL BE RESPONSIBLE FOR THE INSTALLATION AND MAINTENANCE OF NO PARKING SIGNS ALONG THE SOLID WASTE INGRESS/EGRESS ROUTE TO ENSURE THE ROUTE REMAINS FREE OF VEHICLES.
- 10. REFER TO ASSOCIATED STANDARD DETAILS SD-SW-1 AND SD-SW-2 FOR REQUIREMENTS ON SINGLE AND DOUBLE WIDE SOLID WASTE BIN ENCLOSURE LAYOUT AND DESIGN CRITERIA. THE CITY SHALL HAVE THE ABILITY TO MODIFY OR INTERPRET THESE DETAILS AS NECESSARY TO ACCOMMODATE THE CITY OR CITY CONTRACTOR'S NEEDS FOR SOLID WASTE PICK-UP.
- 11. SOLID WASTE EQUIPMENT ACCESS ROADS AND SERVICE AREA SURFACES SHALL BE DESIGNED AND MAINTAINED TO SUPPORT THE IMPOSED LOADS OF COLLECTION VEHICLES WEIGHING UP TO 79,500 LBS GROSS VEHICLE WEIGHT (GVW) AND SHALL BE PROVIDED WITH AN APPROVED SURFACE SO AS TO PROVIDE ALL WEATHER DRIVING CAPABILITIES. PROPERTY OWNER SHALL BE RESPONSIBLE FOR ALL SNOW AND ICE REMOVAL REQUIRED FOR SAFE ACCESS.
- 12. FOR SITES THAT CANNOT ACCOMMODATE A STANDARD DUMPSTER ENCLOSURE, THE DUMPSTERS MAY BE ROLLED OUT OF A BUILDING OR ALTERNATE ENCLOSURE BY THE PROPERTY OWNER TO AN APPROVED COLLECTION LOCATION.
- 13. SOLID WASTE COLLECTION LOCATIONS MUST BE LOCATED WITHIN THE BOUNDARIES OF THE PROPERTY UNLESS AN APPROPRIATE EASEMENT IS OBTAINED.



00	10/17/2024	A2D	SSORT
REV. NO.	DATE	DRAWN BY	CHECKED BY

SOLID WASTE GENERAL NOTES

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-SW-6B

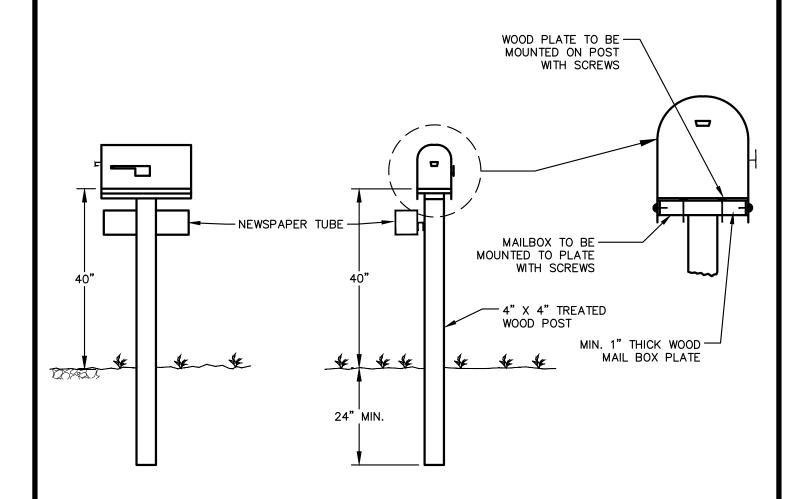

NOTES:

- 1. ALL WORK TO BE DONE UNDER CURRENT FEDERAL POSTAL SERVICE SPECIFICATIONS.
- 2. FOR PERMANENT MAILBOX RELOCATION, POST TO BE NEW 4" X 4" POST, OR RESTORE ORIGINAL POST TO AS GOOD OR BETTER THAN ORIGINAL CONDITION.
- 3. FOR TEMPORARY MAILBOX RELOCATION, THE USE OF EXISTING POST WILL BE PERMITTED.
- 4. FOR NEWS PAPER TUBE RELOCATION THE USE OF EXISTING POST WILL BE PERMITTED.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY		
MAIL DOY NEWODARED TURE					

MAILBOX NEWSPAPER TUBE INSTALLATION AND RELOCATION

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-M-1

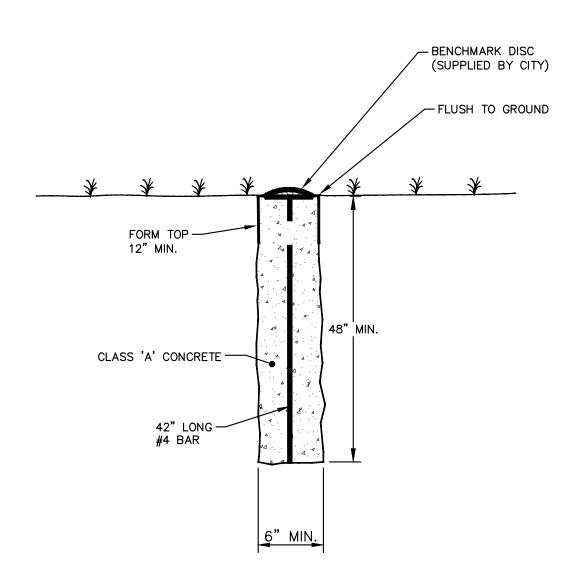

NOTE: ELEVATION TO BE ESTABLISHED FROM USGS DATUM, AND SHALL BE VERIFIED BY THE CITY OF ANN ARBOR.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO. DATE DRAWN BY	CHECKED BY

VERTICAL CONTROL MONUMENT

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-M-2

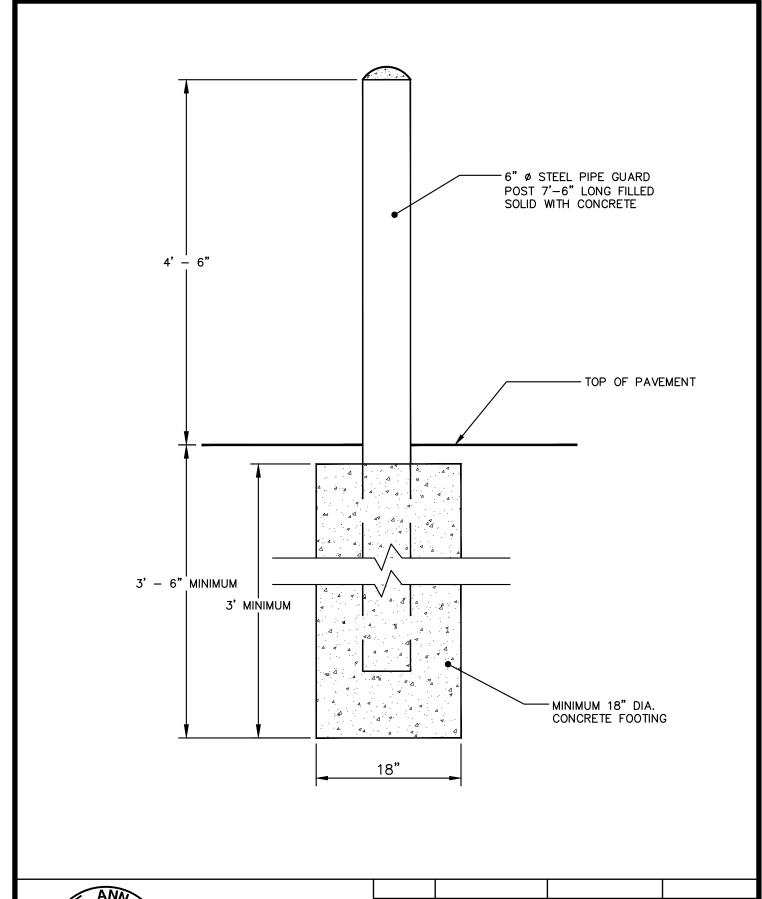




REV. NO. DATE DRAWN BY	CHECKED BY

STEEL PIPE BOLLARD

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-M-3

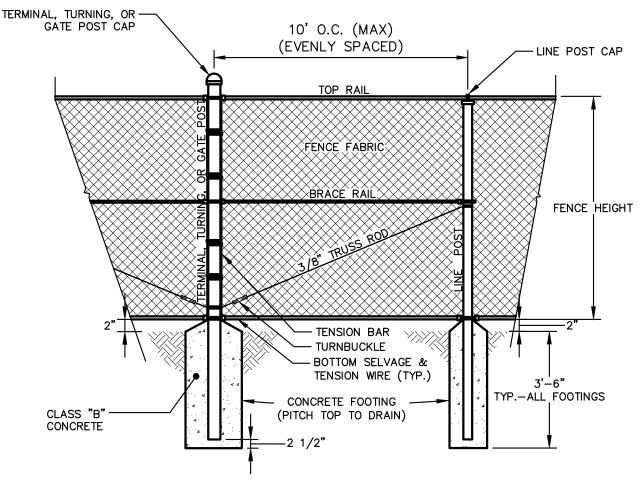

FENCE HEIGHT/SIZE REFERENCE CHART

	4' FENCE	6' FENCE	8' FENCE	12' FENCE
NOMINAL PIPE SIZES (WEIGHT)				
TERMINAL, TURNING, OR GATE POST	1 1/2" (2.72#/L.F.)	2 1/2" (5.79#/L.F.)	3 1/2" (9.11#/L.F.)	3 1/2" (9.11#/L.F.)
LINE POST	1 1/4" (2.27#/L.F.)	2" (3.65#/L.F.)	2" (3.65#/L.F.)	2" (3.65#/L.F.)
TOP RAIL	1" (1.68#/L.F.)	1 1/4" (2.27#/L.F.)	1 1/4" (2.27#/L.F.)	1 1/4" (2.27#/L.F.)
MIDDLE RAIL	NONE	NONE	1 1/4" (2.27#/L.F.)	1 1/4" (2.27#/L.F.)
BOTTOM RAIL	NONE	NONE	1 1/4" (2.27#/L.F.)	1 1/4" (2.27#/L.F.)
BRACE RAIL	1" (1.68#/L.F.)	1 1/4" (2.27#/L.F.)	1 1/4" (2.27#/L.F.)	1 1/4" (2.27#/L.F.)
FOOTING DIAMETERS				
TERMINAL, TURNING, OR GATE POST	12"	18"	18"	18"
LINE POST	9"	12"	12"	12"




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

CHAIN LINK FENCE

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-M-4

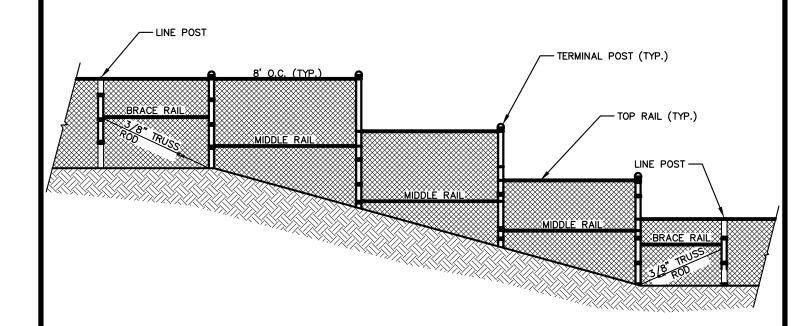

NOTE: DIMENSIONS MAY VARY.

WORK THIS DRAWING WITH THE NOTES AND REFERENCE CHART ON THE CHAIN LINK FENCE DETAIL, $\underline{SD-M-4}$




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY
	REV. NO.	REV. NO. DATE	REV. NO. DATE DRAWN BY

STEP CHAIN LINK FENCE

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-M-5

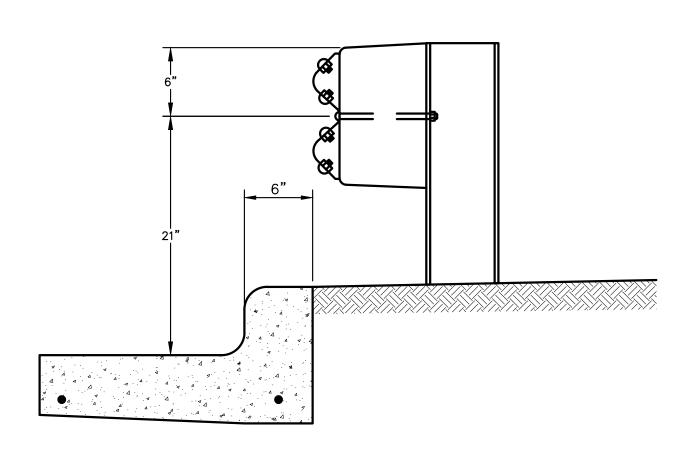

NOTE: STANDARD GUARDRAIL CONSTRUCTION TO BE IN ACCORDANCE WITH MDOT BEAM GUARDRAIL TYPE B REQUIREMENTS




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

URBAN GUARDRAIL LOCATION

DR. ENG	CH.	ENG	DRAWING	NO.
SCALE N.T.S.	DATE	12/8/2023		SD-M-6

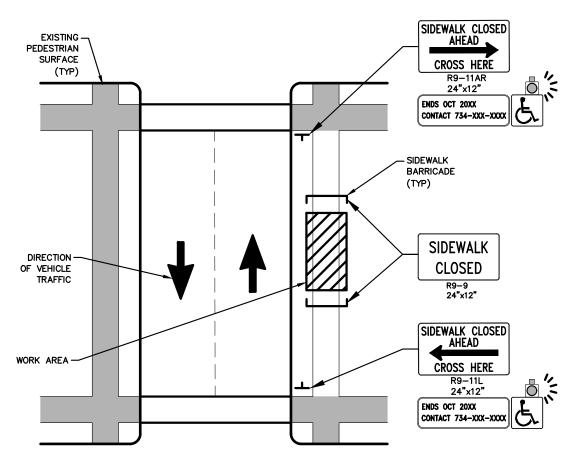

WHERE REQUIRED, AN APPROVED AUDIBLE MESSAGE DEVICE OR TACTILE MESSAGE SHOULD BE PROVIDED FOR SIGHT—IMPAIRED PEDESTRIANS. IF MESSAGE DEVICE OR TACTILE MESSAGE IS NOT USED, SIGHT—IMPAIRED PEDESTRIANS ARE TO BE DIRECTED THOUGH TEMPORARY PEDESTRIAN DETOUR BY MEANS OF DETECTABLE DIRECTIONAL TILES AND DETECTABLE WARNING SURFACES.

THE INTERNATIONAL SYMBOL OF ACCESSIBILITY MAY BE DISPLAYED WHEN ANY WALKWAY THROUGH A WORK ZONE HAS BEEN DETERMINED TO BE TPAR COMPLIANT. THE SYMBOL OF ACCESSIBILITY SHALL NOT BE DISPLAYED IF PERSONS WITH DISABILITIES SHOULD NOT USE THE PRIMARY TEMPORARY PEDESTRIAN DETOUR.

TYPICAL SIGN MESSAGE FOR A TEMPORARY PEDESTRIAN DETOUR SHOULD INCLUDE INFORMATION SUCH AS THE DURATION OF THE WALKWAY RESTRICTIONS (BEGINNING AND/OR END DATES) AND A PROJECT CONTACT NUMBER FOR 24/7 QUESTIONS OR REPORTING HAZARDS.

TEMPORARY PEDESTRIAN FACILITES PEDESTRIAN DETOUR USING OPPOSITE SIDE OF STREET





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DETOUR 1

DR. DR.	CH. CH.	DRAWING NO.
SCALE N.T.S.	DATE 09/01/2025	SD-TPR-1

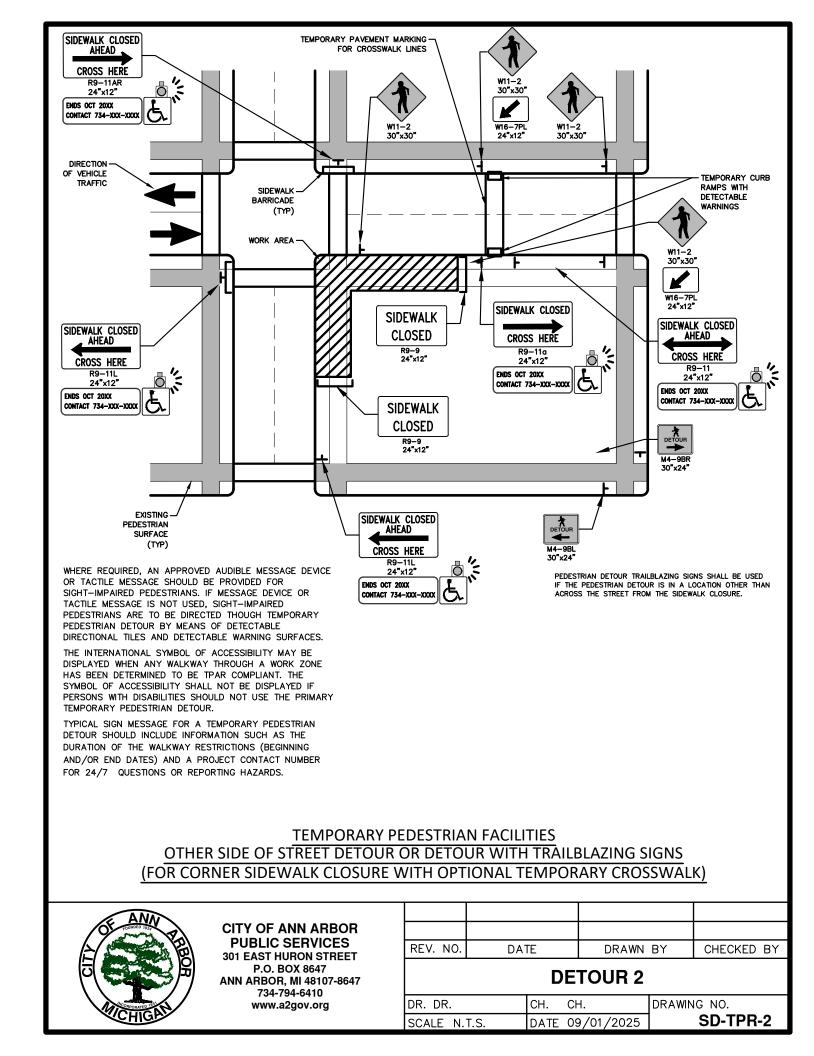

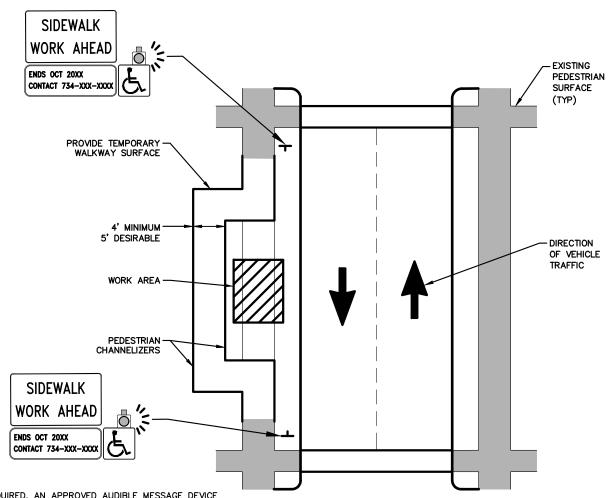

WHERE REQUIRED, AN APPROVED AUDIBLE MESSAGE DEVICE OR TACTILE MESSAGE SHOULD BE PROVIDED FOR SIGHT—IMPAIRED PEDESTRIANS. IF MESSAGE DEVICE OR TACTILE MESSAGE IS NOT USED, SIGHT—IMPAIRED PEDESTRIANS ARE TO BE DIRECTED THOUGH TEMPORARY PEDESTRIAN DETOUR BY MEANS OF DETECTABLE DIRECTIONAL TILES AND DETECTABLE WARNING SURFACES.

THE INTERNATIONAL SYMBOL OF ACCESSIBILITY MAY BE DISPLAYED WHEN ANY WALKWAY THROUGH A WORK ZONE HAS BEEN DETERMINED TO BE TPAR COMPLIANT. THE SYMBOL OF ACCESSIBILITY SHALL NOT BE DISPLAYED IF PERSONS WITH DISABILITIES SHOULD NOT USE THE PRIMARY TEMPORARY PEDESTRIAN DETOUR.

TYPICAL SIGN MESSAGE FOR A TEMPORARY PEDESTRIAN DETOUR SHOULD INCLUDE INFORMATION SUCH AS THE DURATION OF THE WALKWAY RESTRICTIONS (BEGINNING AND/OR END DATES) AND A PROJECT CONTACT NUMBER FOR 24/7 QUESTIONS OR REPORTING HAZARDS.

TEMPORARY PEDESTRIAN FACILITIES BYPASS ON ADJACENT AVAILABLE RIGHT-OF-WAY BYPASS TYPE A




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

BYPASS A

DR. DR.	CH. CH.	DRAWING NO.
SCALE N.T.S.	DATE 09/01/2025	SD-TPR-3

NOTE: MAY ONLY BE USED ON ROADWAY WITH POSTED SPEED OF 45 MPH OR LESS.

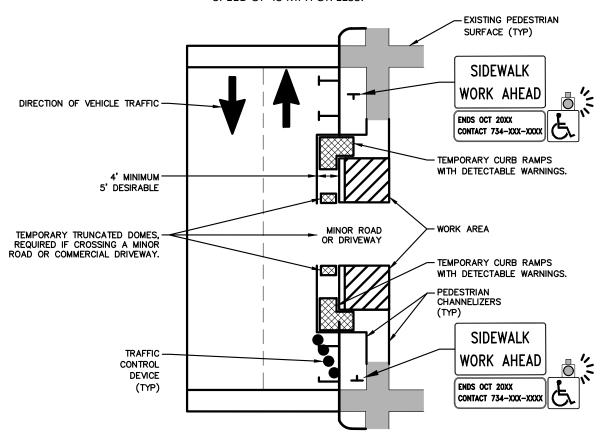

WHERE REQUIRED, AN APPROVED AUDIBLE MESSAGE DEVICE OR TACTILE MESSAGE SHOULD BE PROVIDED FOR SIGHT—IMPAIRED PEDESTRIANS. IF MESSAGE DEVICE OR TACTILE MESSAGE IS NOT USED, SIGHT—IMPAIRED PEDESTRIANS ARE TO BE DIRECTED THOUGH TEMPORARY PEDESTRIAN DETOUR BY MEANS OF DETECTABLE DIRECTIONAL TILES AND DETECTABLE WARNING SURFACES.

THE INTERNATIONAL SYMBOL OF ACCESSIBILITY MAY BE DISPLAYED WHEN ANY WALKWAY THROUGH A WORK ZONE HAS BEEN DETERMINED TO BE TPAR COMPLIANT. THE SYMBOL OF ACCESSIBILITY SHALL NOT BE DISPLAYED IF PERSONS WITH DISABILITIES SHOULD NOT USE THE PRIMARY TEMPORARY PEDESTRIAN DETOUR.

TYPICAL SIGN MESSAGE FOR A TEMPORARY PEDESTRIAN DETOUR SHOULD INCLUDE INFORMATION SUCH AS THE DURATION OF THE WALKWAY RESTRICTIONS (BEGINNING AND/OR END DATES) AND A PROJECT CONTACT NUMBER FOR 24/7 QUESTIONS OR REPORTING HAZARDS.

TEMPORARY PEDESTRIAN FACILITIES SIDEWALK BYPASS USING PARKING OR SHOULDER ON LOW SPEED ROADWAY BYPASS TYPE B




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

BYPASS B

DR. DR.	CH. CH.	DRAWING NO.
SCALE N.T.S.	DATE 09/01/2025	SD-TPR-4

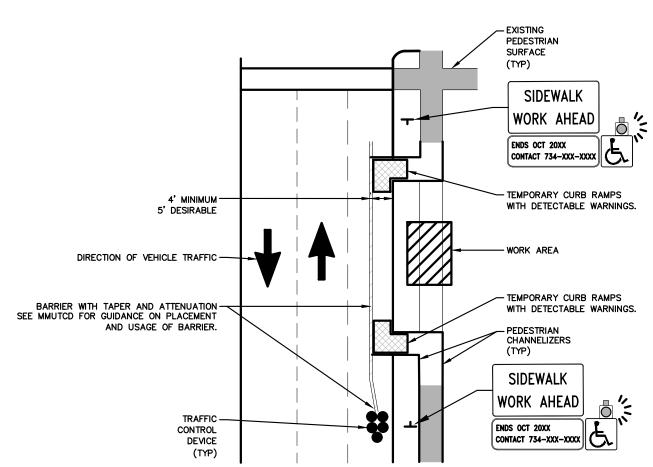

WHERE REQUIRED, AN APPROVED AUDIBLE MESSAGE DEVICE OR TACTILE MESSAGE SHOULD BE PROVIDED FOR SIGHT—IMPAIRED PEDESTRIANS. IF MESSAGE DEVICE OR TACTILE MESSAGE IS NOT USED, SIGHT—IMPAIRED PEDESTRIANS ARE TO BE DIRECTED THOUGH TEMPORARY PEDESTRIAN DETOUR BY MEANS OF DETECTABLE DIRECTIONAL TILES AND DETECTABLE WARNING SURFACES.

THE INTERNATIONAL SYMBOL OF ACCESSIBILITY MAY BE DISPLAYED WHEN ANY WALKWAY THROUGH A WORK ZONE HAS BEEN DETERMINED TO BE TPAR COMPLIANT. THE SYMBOL OF ACCESSIBILITY SHALL NOT BE DISPLAYED IF PERSONS WITH DISABILITIES SHOULD NOT USE THE PRIMARY TEMPORARY PEDESTRIAN DETOUR.

TYPICAL SIGN MESSAGE FOR A TEMPORARY PEDESTRIAN DETOUR SHOULD INCLUDE INFORMATION SUCH AS THE DURATION OF THE WALKWAY RESTRICTIONS (BEGINNING AND/OR END DATES) AND A PROJECT CONTACT NUMBER FOR 24/7 QUESTIONS OR REPORTING HAZARDS.

TEMPORARY PEDESTRIAN FACILITIES SIDEWALK BYPASS USING SHOULDER OR PARKING LANE ON HIGH SPEED ROADWAY BYPASS TYPE C





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

BYPASS C

DR. DR.	CH. CH.	DRAWING NO.
SCALE N.T.S.	DATE 09/01/2025	SD-TPR-5

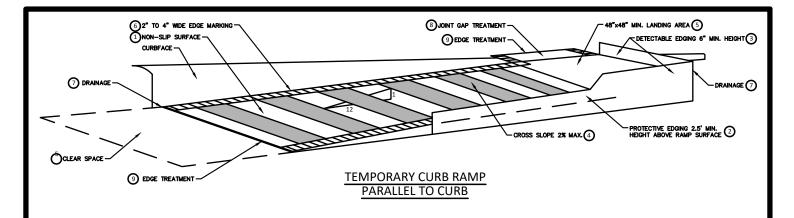

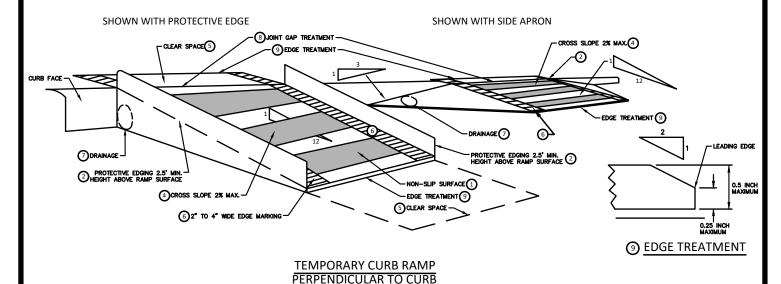

SPECIFIC NOTES

- (1) CURB RAMPS SHALL BE 48" MIN. WIDTH WITH A FIRM, STABLE AND SLIP RESISTANT SURFACE.
- PROTECTIVE EDGING WITH A 2.5" MIN. HEIGHT ABOVE THE RAMP SHALL BE PLACED WHEN A CURB RAMP OR

 LANDING PLATFORM HAS A VERTICAL DROP OF 6" OR GREATER OR HAS A SIDE APRON SLOPE STEEPER THAN 1:3.

 PROTECTIVE EDGING SHOULD BE CONSIDERED WHEN CURB RAMPS OR LANDING PLATFORMS HAVE A VERTICAL DROP OF 3" OR MORE.
- DETECTABLE EDGING ANYTIME A HANDRAIL IS REQUIRED, AND ANYTIME THE PATH CHANGES DIRECTION. THIS

 INCLUDES A TURN ONTO THE RAMP FROM THE PATH. DETECTABLE EDGING MUST BEGIN A MAXIMUM OF 2.5" ABOVE

 THE RAMP SURFACE, AND EXTEND AT LEAST 6" ABOVE THE RAMP SURFACE. CONTRASTING COLOR SHALL BE

 PLACED ON ALL CURB RAMP LANDINGS WHERE THE WALKWAY CHANGES DIRECTION (TURNS).
- ig(4ig) CURB RAMPS AND LANDINGS SHALL HAVE A 2% MAX. CROSS SLOPE.
- $\overline{5}$ CLEAR SPACE OF 48" x 48" MIN. SHALL BE PROVIDED ABOVE AND BELOW THE CURB RAMP.
- \bigcirc THE CURB RAMP WALKWAY EDGE SHALL BE MARKED WITH A CONTRASTING COLOR, 2" TO 4" WIDE MARKING. THE MARKING IS OPTIONAL WHERE COLOR CONTRASTING EDGING IS USED.
- (7) water flow in the gutter system shall not be impeded.
- $oxed{8}$ LATERAL JOINTS OR GAPS BETWEEN SURFACES SHALL BE LESS THAN 1/2" WIDTH.
- 9 CHANGES BETWEEN SURFACE HEIGHTS SHALL NOT EXCEED 1/2". LATERAL EDGES SHOULD BE VERTICAL UP TO 1/4" HIGH, AND BEVELED AT 1:2 BETWEEN 1/4" AND 1/2" HEIGHT.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


REV. NO.	DATE	DRAWN BY	CHECKED BY


TEMPORARY RAMPS

DR. DR.	CH. CH.	DRAWING NO.
SCALE N.T.S.	DATE 09/01/2025	SD-TPR-6

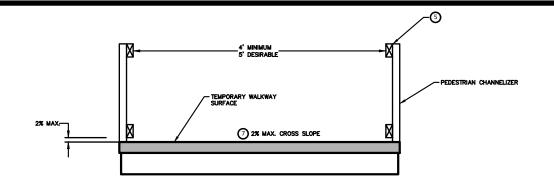

TEMPORARY PEDESTRIAN ACCESS

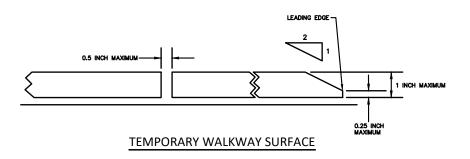

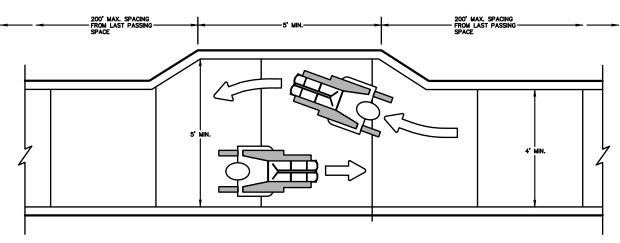

NARROW TEMPORARY PEDESTRIAN ACCESS ROUTE PASSING DETAIL




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


REV. NO.	DATE	DRAWN BY	CHECKED BY

WALKWAY DEVICES 1


DR. DR.	CH.	CH.	DRAWING NO.
SCALE N.T.S.	DATE	09/01/2025	SD-TPR-7

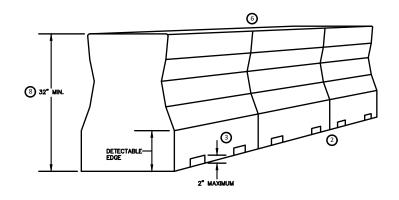

PEDESTRIAN CHANNELIZER USING A BARRIER (MINIMUM REQUIREMENTS)

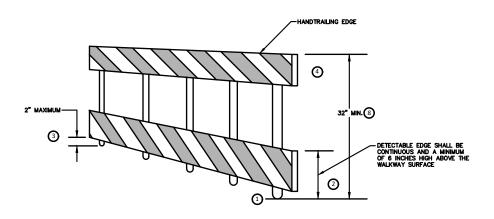

PEDESTRIAN CHANNELIZER (MINIMUM REQUIREMENTS)

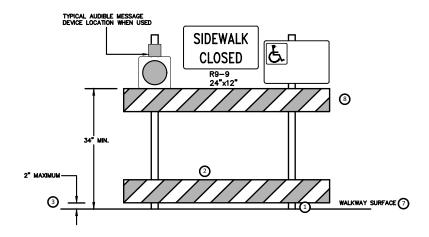

SIDEWALK BARRICADE





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


REV. NO.	DATE	DRAWN BY	CHECKED BY


WALKWAY DEVICES 2

DR. DR.	CH. CH.	DRAWING NO.
SCALE N.T.S.	DATE 09/01/2025	SD-TPR-8

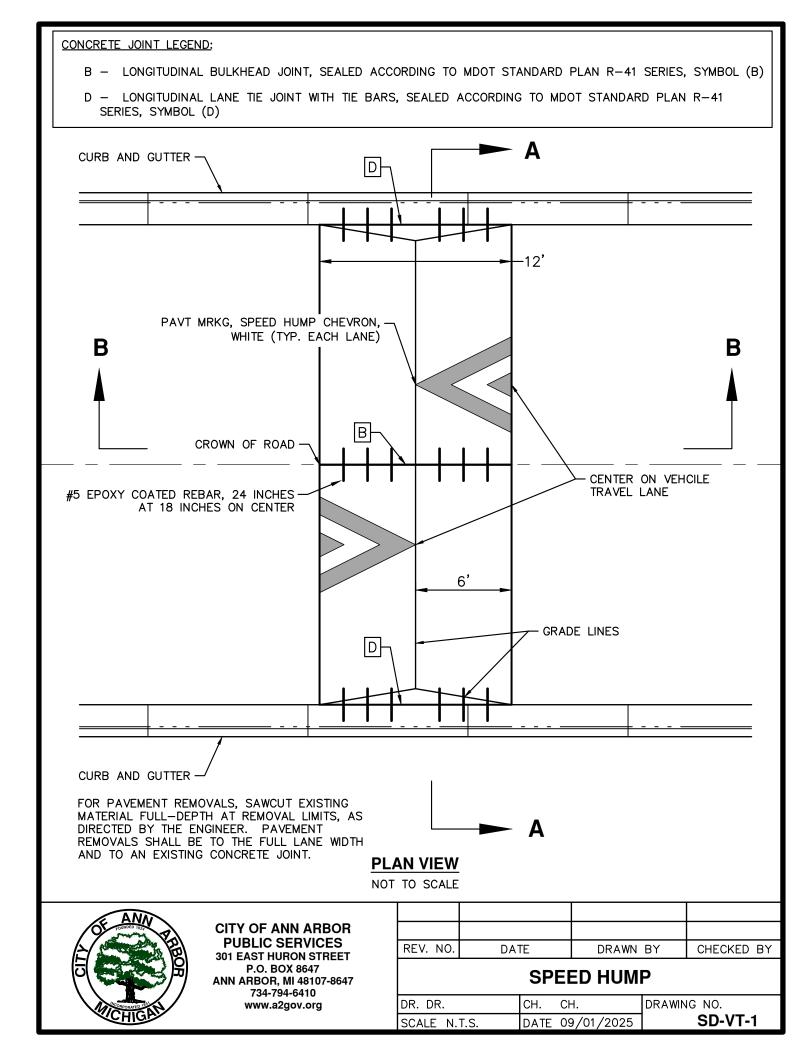

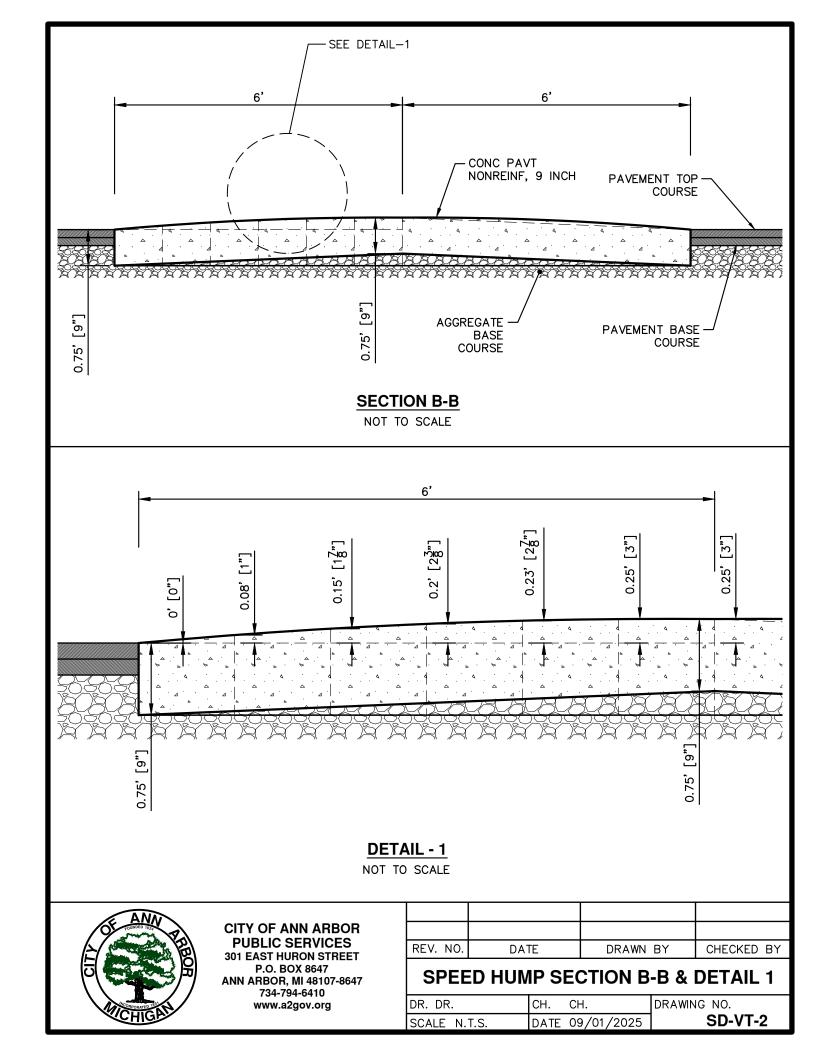

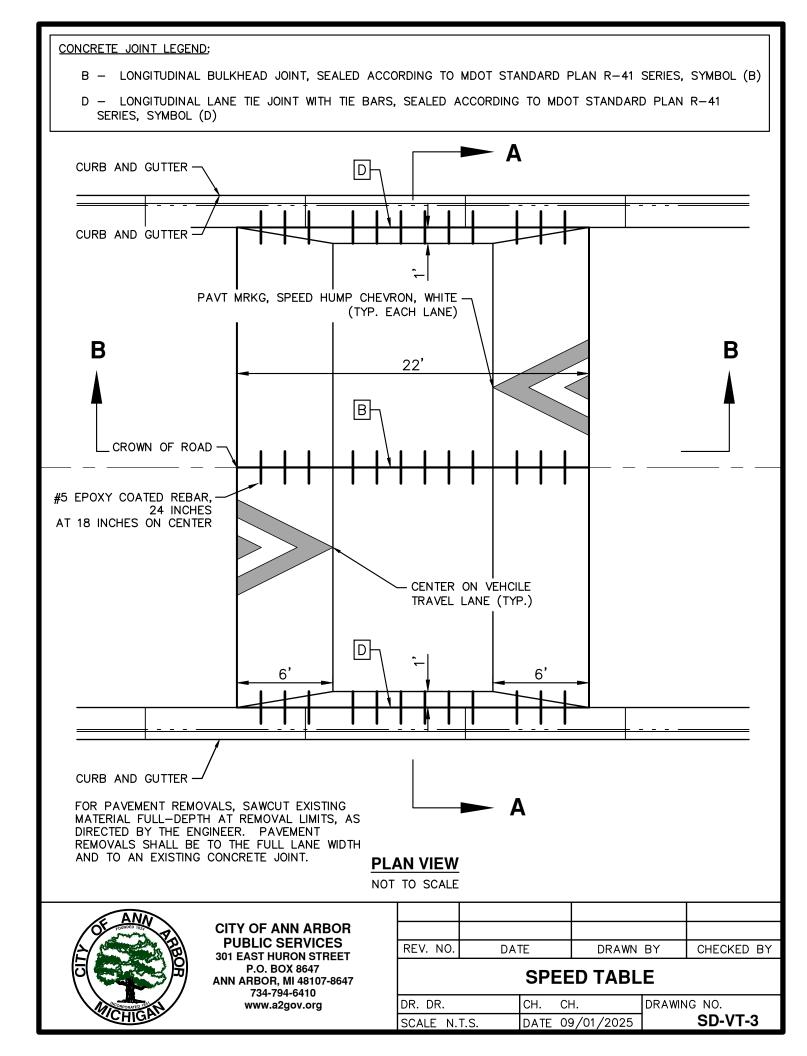

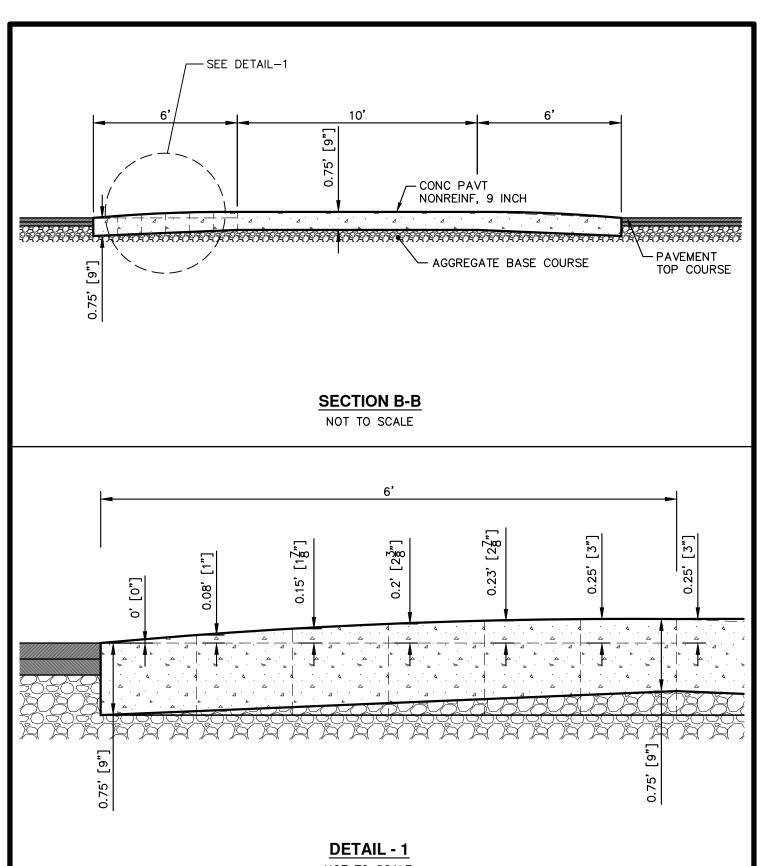

NOT TO SCALE




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

SPEED TABLE SECTION B-B & DETAIL 1

DR. DR.	CH.	CH.	DRAWING NO.
SCALE N.T.S.	DATE	09/01/2025	SD-VT-4

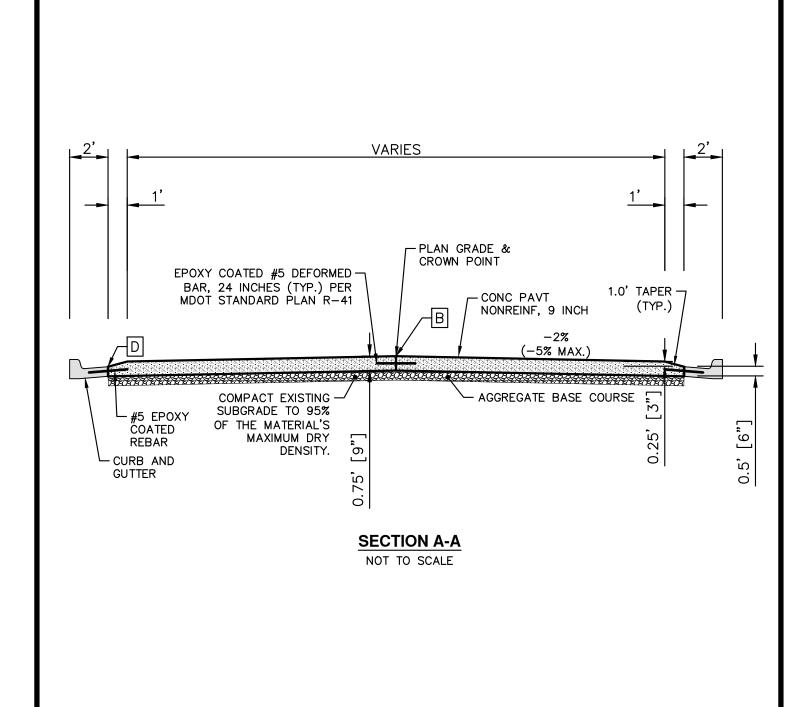




REV. NO.	DATE	DRAWN BY	CHECKED BY


SPEED HUMP & SPEED TABLE SECTION A-A

DR. DR.	CH.	CH.	DRAWING NO.
SCALE N.T.S.	DATE	09/01/2025	SD-VT-5

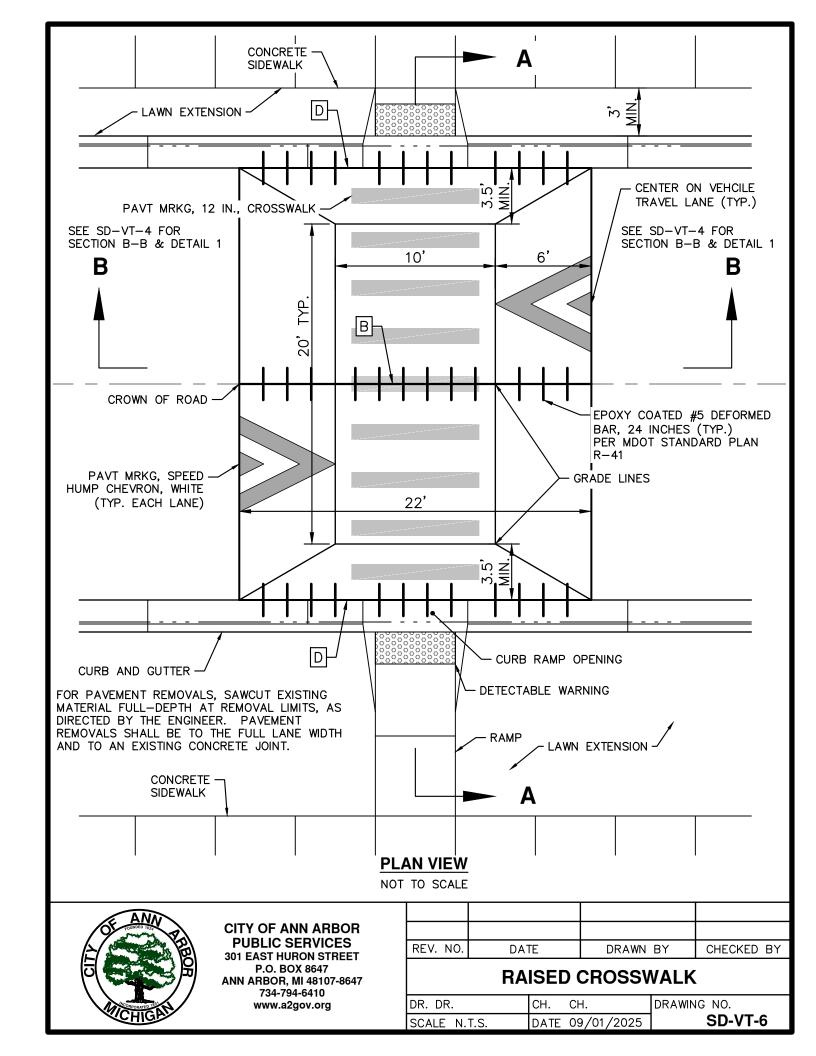

CONCRETE JOINT LEGEND:

- B LONGITUDINAL BULKHEAD JOINT, SEALED ACCORDING TO MDOT STANDARD PLAN R-41 SERIES, SYMBOL (B)
- D LONGITUDINAL LANE TIE JOINT WITH TIE BARS, SEALED ACCORDING TO MDOT STANDARD PLAN R-41 SERIES, SYMBOL (D)

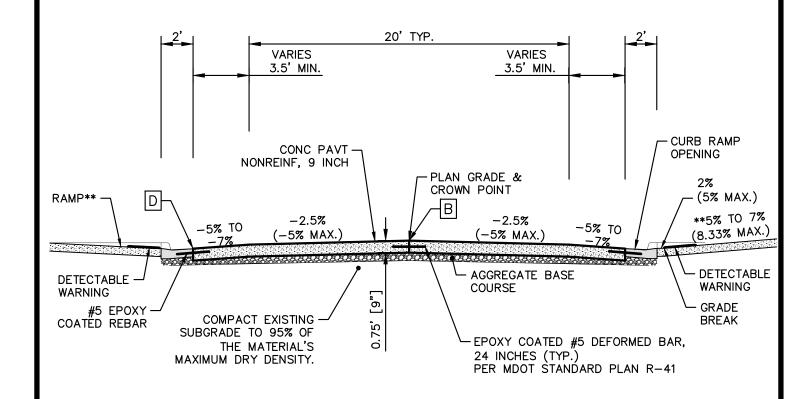

SECTION A-A

NOT TO SCALE



CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


REV. NO.	DATE	DRAWN BY	CHECKED BY
	DATE	BIGGIO BI	OFFICINED BY

RAISED CROSSWALK SECTION A-A

DR. DR.	сн. сн.	DRAWING NO.
SCALE N.T.S.	DATE 09/01/2025	SD-VT-7

NOTES:

1. REFER TO SITE PLAN FOR PROJECT SPECIFIC TYPES & LIMITS OF SURFACE MATERIALS.

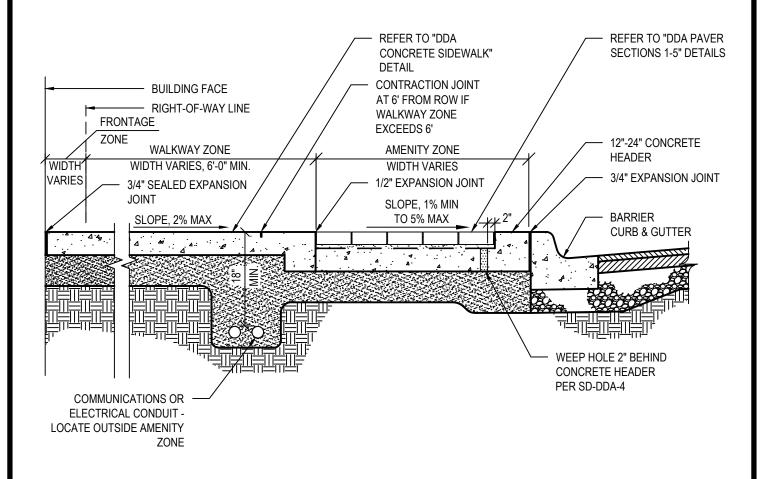





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA SIDEWALK CROSS SECTION

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-DDA-1

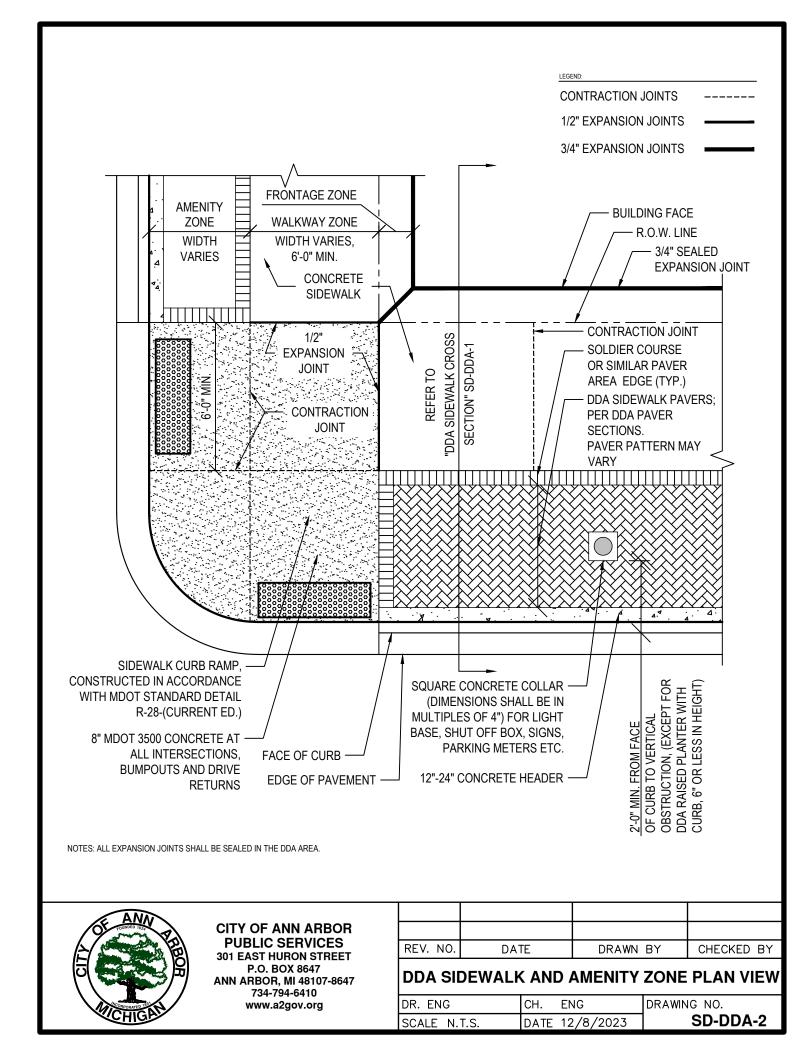

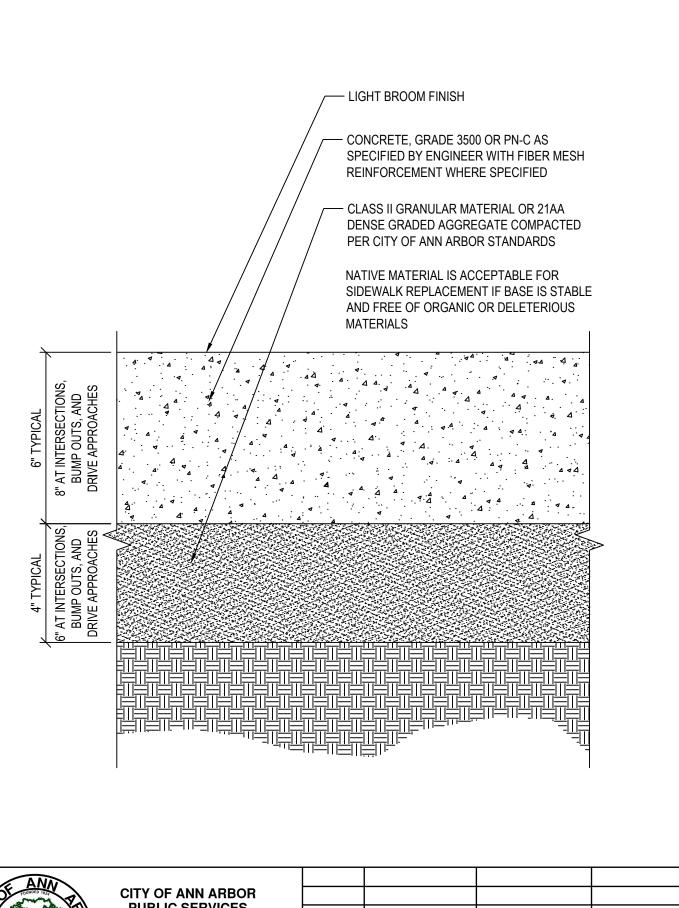





REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA CONCRETE SIDEWALK

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DDA-3

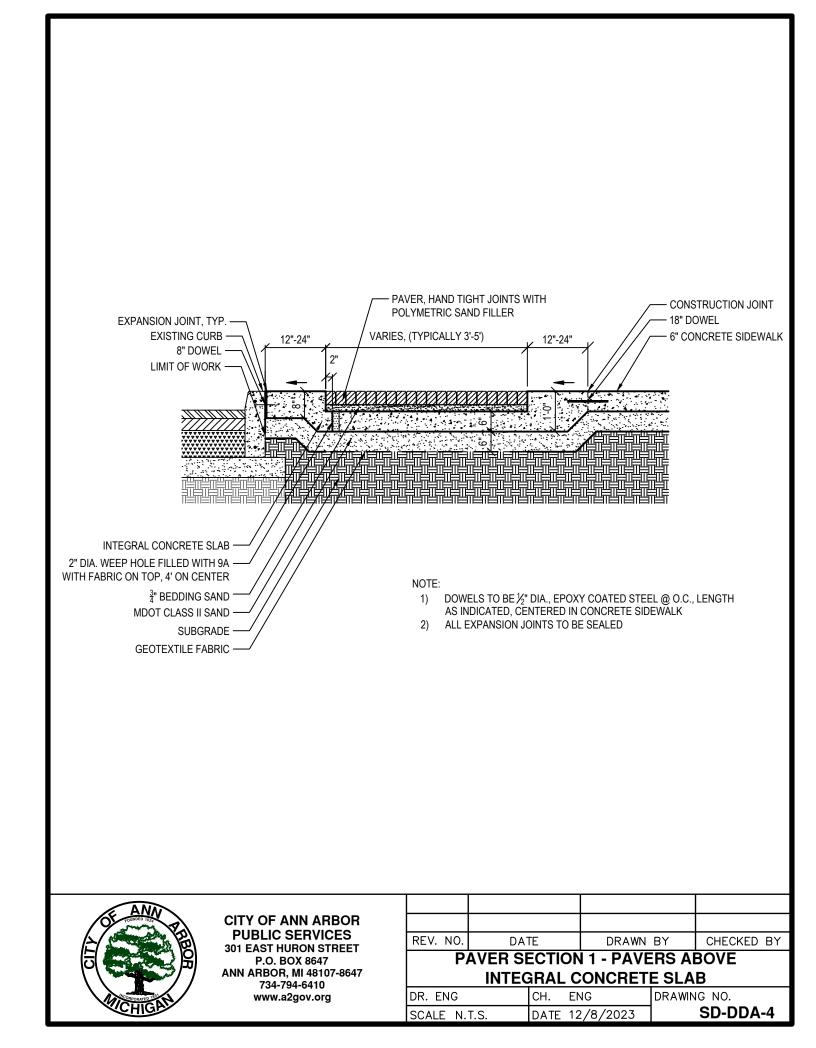

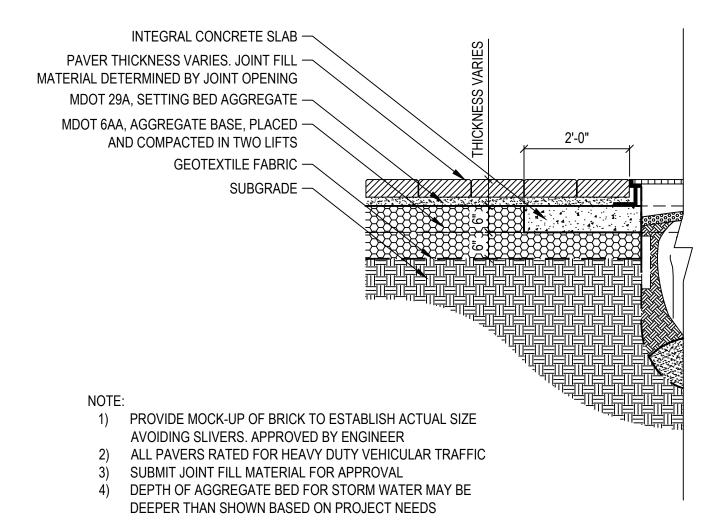





CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA PAVER SECTION 2 - POROUS PAVERS AT PLANTER AND TREE GRATE

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DDA-5

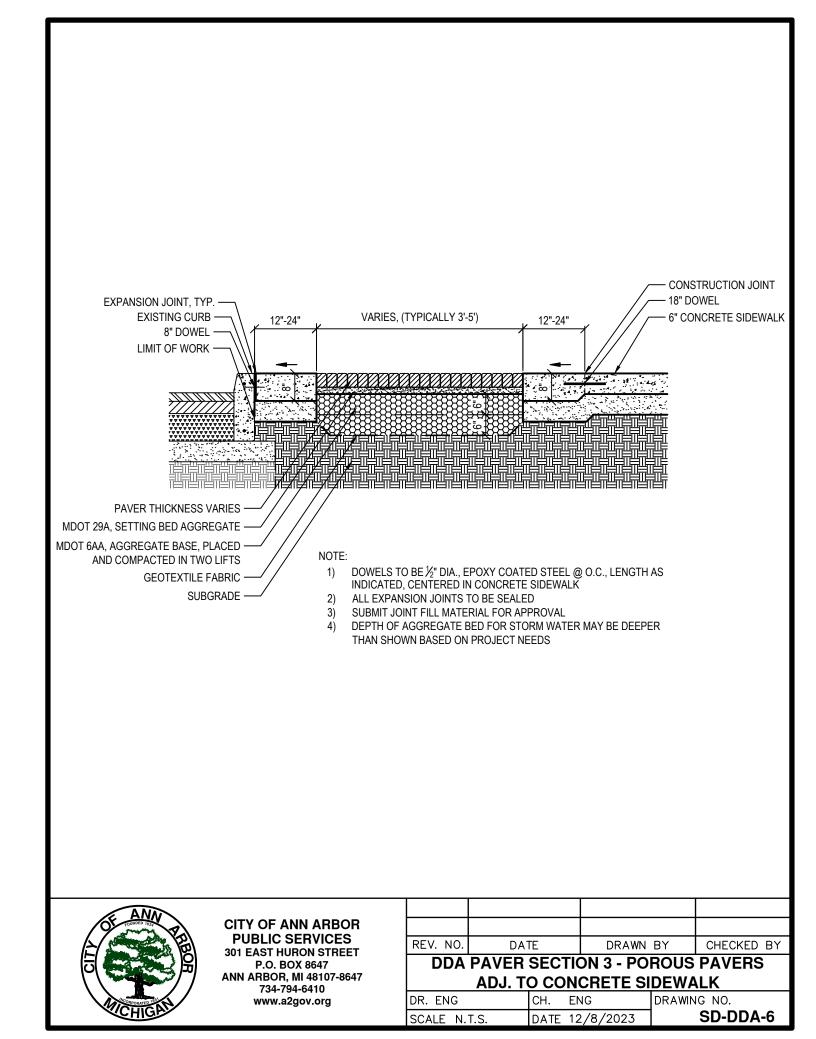

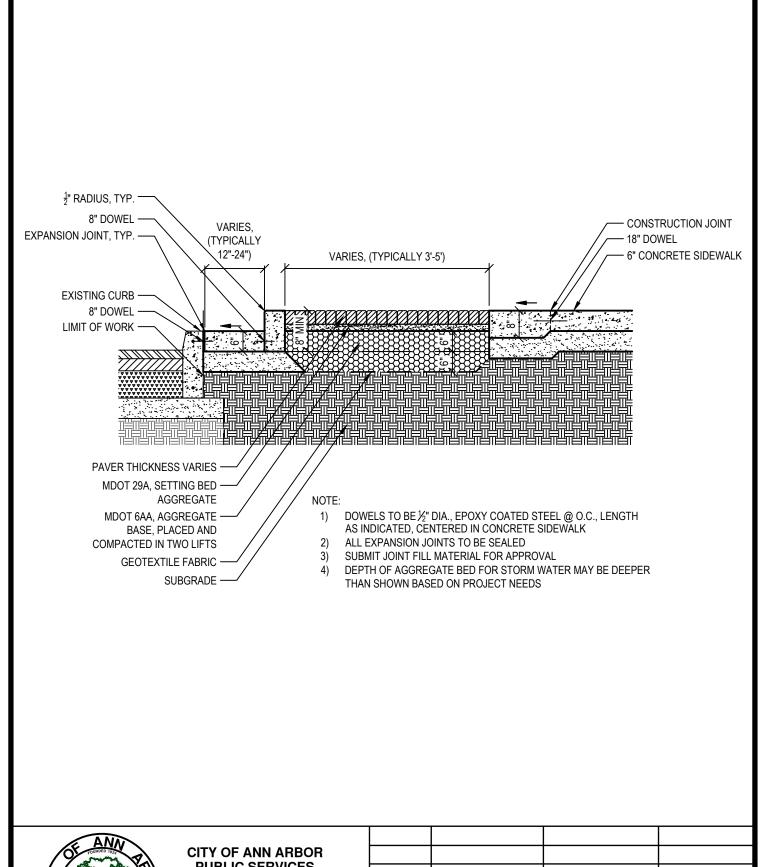





PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA PAVER SECTION 4 - POROUS PAVERS ADJ. TO CONCRETE CURB

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DDA-7

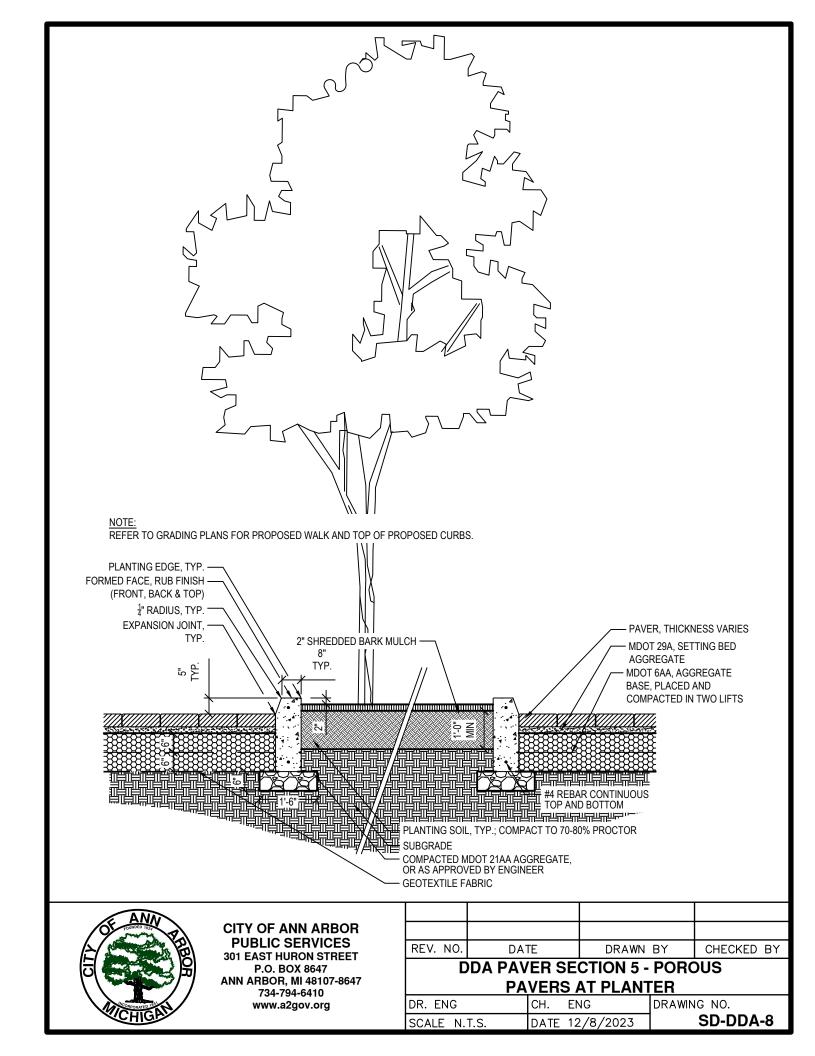

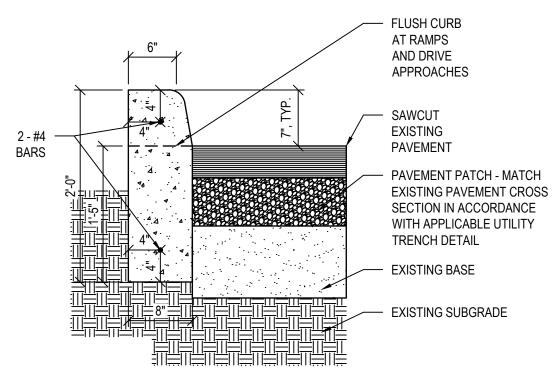

NOTE:
TO BE USED FOR REPLACEMENT OF EXISTING SLATE OR CONCRETE CURB WITH NO EXISTING GUTTER PAN



CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA CONCRETE CURB

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DDA-9

BICYCLE HOOP NOTES:

- 1. TO BE USED ONLY FOR DDA CONCRETE SIDEWALK SURFACES
- 2. LOCATE AND GROUP BICYCLE HOOPS IN THE AMENITY ZONE
- 3. BIKE HOOPS TO BE MINIMUM OF 2'-10" FROM FACE OF CURB WHEN PERPENDICULAR TO CURB, AND 2'-0" WHEN PARALLEL
- REFER TO ANN ARBOR DOWNTOWN STREET DESIGN MANUAL FOR ADDITIONAL LAYOUT GUIDELINES
- 5. POWDER-COATED GALVANIZED STEEL, BLACK

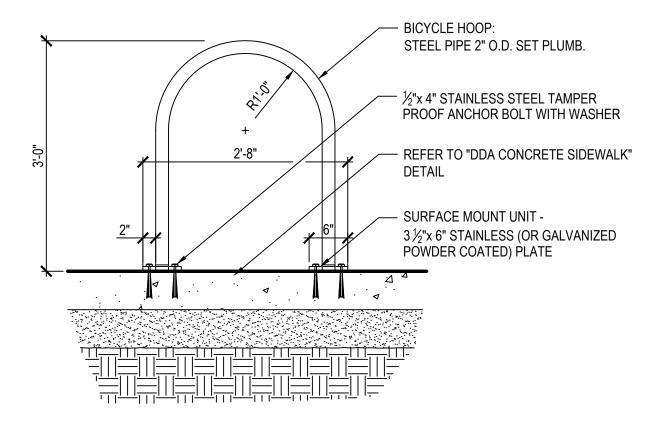



CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


REV. NO. DATE DRAWN BY	CHECKED BY

DDA BIKE HOOP SURFACE MOUNTED

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DDA-10

NOTES:

- 1. CONTRACTOR TO EXCAVATE ENTIRE PLANTING AREA. EXISTING SOIL MATERIAL TO BE DISPOSED OF OFF-SITE AT NO ADDITIONAL COST TO OWNER
- 2. RAISED PLANTER MAY INTEGRATE A PLANTER BOX WALL PER ANN ARBOR DOWNTOWN STREET DESIGN MANUAL, ON SIDEWALK SIDE. IN SUCH CASES, WALL WIDTH SHALL BE 12"-16" AND WALL HEIGHT SHALL BE 15"-22".
- 3. LENGTH OF PLANTER WITH CURB MAY VARY; MUST MEET SOIL VOLUME REQUIREMENTS IN ANN ARBOR DOWNTOWN STREET DESIGN MANUAL FOR TREE PLANTING.
- 4. NO UTILITIES SHALL BE PERMITTED IN THE RAISED PLANTER AMENITY ZONE. SEE DDA SIDEWALK CROSS SECTION FOR COMMUNICATIONS OR ELECTRICAL CONDUIT ALLOWABLE LOCATION.

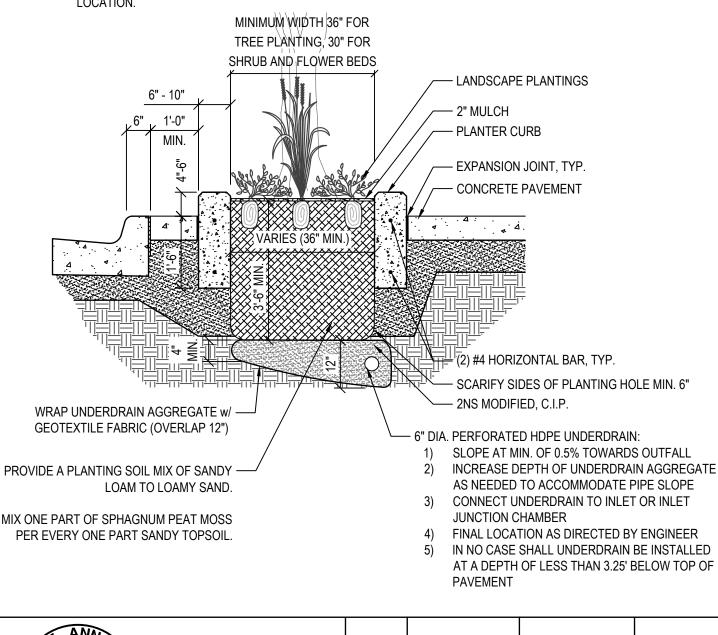




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA RAISED PLANTER WITH CURB

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-DDA-11

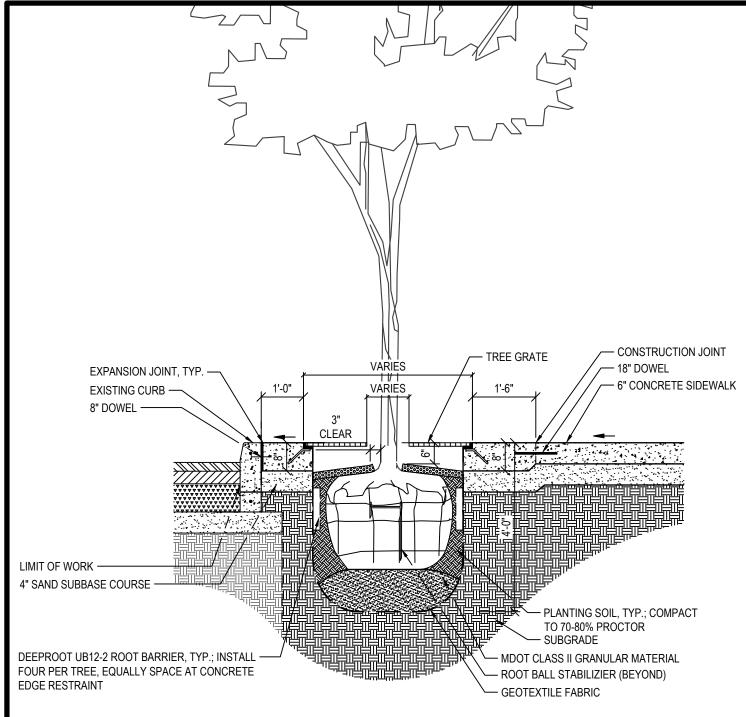

NOTE:

- CONTRACTOR TO EXCAVATE ENTIRE PLANTING AREA. EXISTING SOIL MATERIAL TO BE DISPOSED OF OFF-SITE AT NO ADDITIONAL COST TO OWNER
- DO NOT PRUNE TERMINAL LEADER OR BRANCH TIPS. PRUNE AWAY DEAD AND BROKEN BRANCHES ONLY
- REMOVE TOP ½ TO ½ BURLAP, TWINE, ROPE, OVAL WIRE BASKET. EXPOSE THE TRUCK FLARE BY PULLING BACK SOIL AND FOLDING BACK BURLAP
- 4. REMOVE TEMPORARY WATER BAGS FOLLOWING END OF WARRANTY PERIOD AND DURING WINTER
- DOWELS TO BE ½" DIA., EPOXY COATED STEEL @ O.C., LENGTH AS INDICATED, CENTERED IN CONCRETE SIDEWALK
- PLANTING SOIL TO EXTEND TO THE LIMITS OF THE TREE GRATE, FULL DEPTH
- 7. ALL EXPANSION JOINTS TO BE SEALED
- 2" OF MULCH ON TOP OF ROOT BALL. AVOID PLACING MULCH AGAINST TREE TRUNK




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA TREE PIT WITH GRATE

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-DDA-12

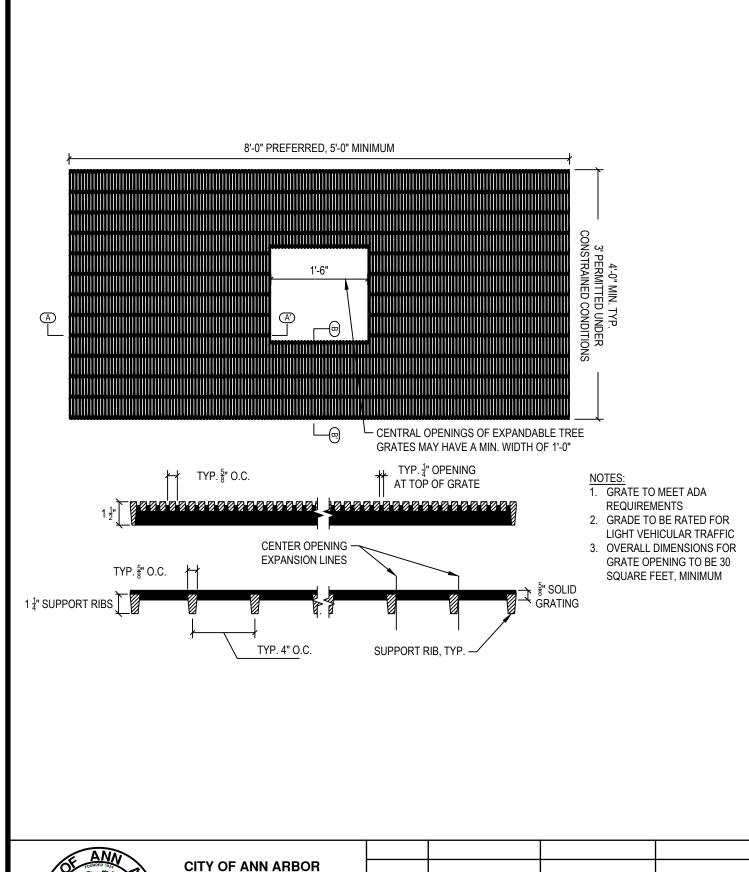




PUBLIC SERVICES
301 EAST HURON STREET
P.O. BOX 8647
ANN ARBOR, MI 48107-8647
734-794-6410
www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY


DDA TREE GRATE DETAIL

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DDA-13

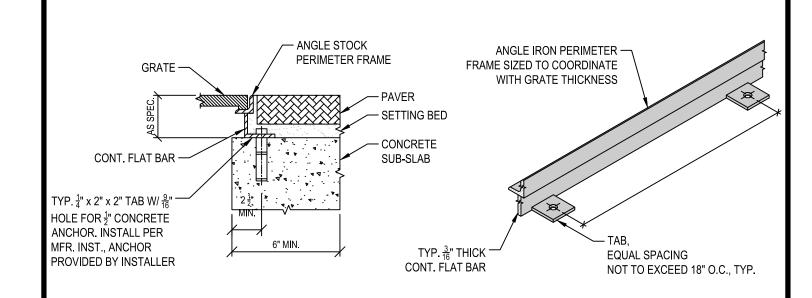

TREE GRATE AT PAVERS

SCALE: NTS

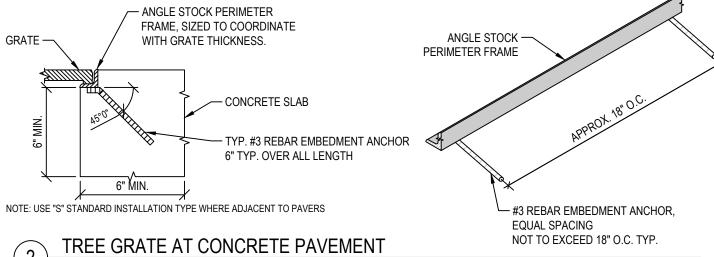

SCALE: NTS




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA TREE GRATE FRAME INSTALLATION

DR. ENG	CH. ENG	DRAWING NO.
SCALE N.T.S.	DATE 12/8/2023	SD-DDA-14

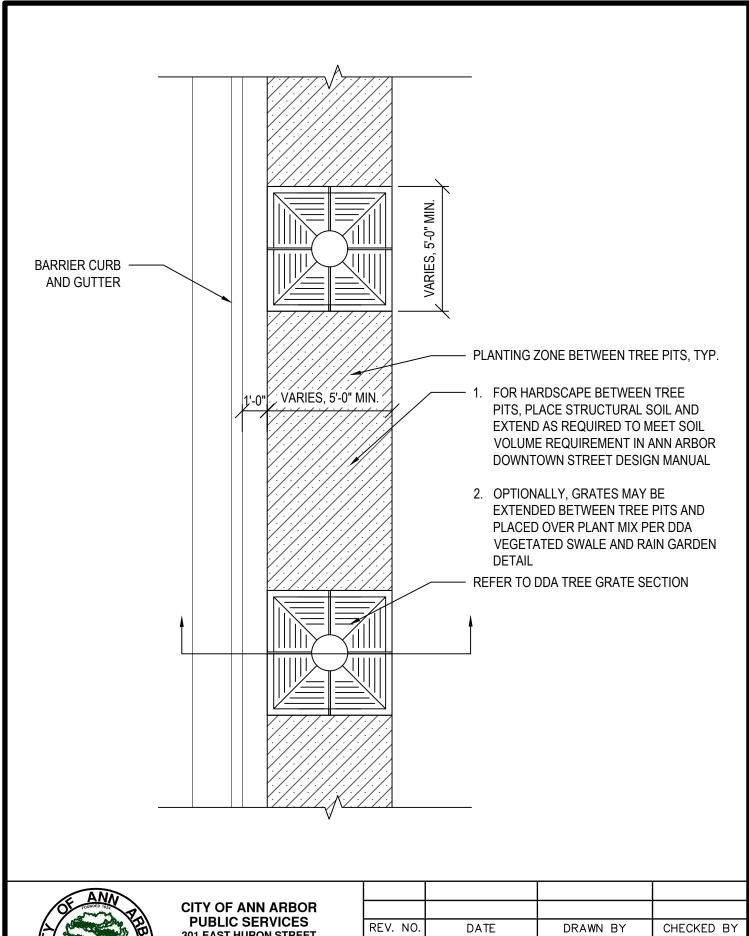




301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA PLANTING ZONE BETWEEN TREE PITS

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DDA-15

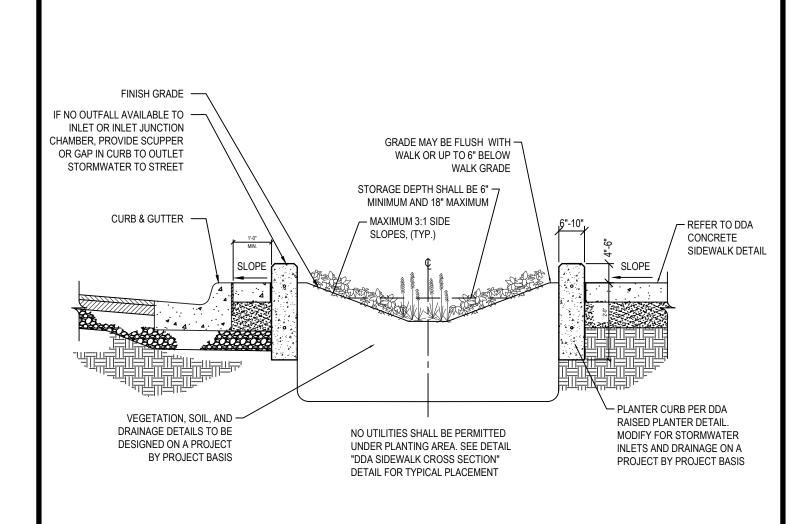




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA VEGETATED SWALE AND RAIN GARDEN

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DDA-16

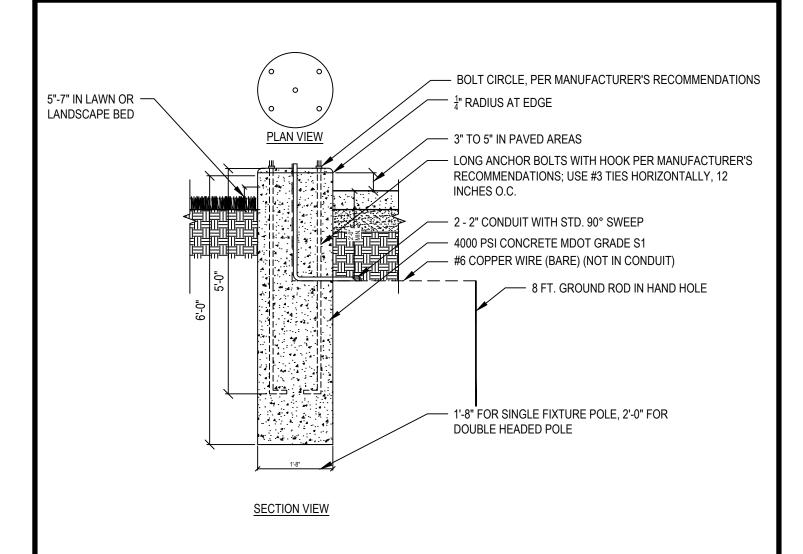

NOTES:

- 1. HOLE TO BE AUGERED. MINIMIZE DISTURBANCE OF IN-SITU SOILS DURING AUGERING
- 2. CONTRACTOR TO PROVIDE PREFABRICATED ANCHOR BOLT BUILD-UP
- 3. THE CITY WILL INSPECT THE AUGERED HOLE AND THE ANCHOR BOLT BUILD-UP AND PROVIDE WRITTEN APPROVAL PRIOR TO THE PLACEMENT OF CONCRETE
- 4. NO WATER IS TO BE IN HOLE AT TIME OF CONCRETE PLACEMENT
- 5. CONCRETE SHALL BE VIBRATED DURING PLACEMENT
- 6. EXCESSIVE HOLE SIZE CREATED DURING AUGERING OF FOUNDATION SHALL BE FLO-FILLED TO 3' FROM FINISH GRADE
- 7. CONTRACTOR WILL PROVIDE NECESSARY CONDUIT FOR ENTRY. PAID FOR AT THE CONTRACT UNIT PRICE FOR 2" CONDUIT
- 8. COPPER CLAD GROUND ROD (1 REQUIRED) TO BE 5/8" DIA. x 8'-0"
- 9. CONDUIT TO EXTEND 1-2" ABOVE BASE. CABLES TO EXTEND 6" OUTSIDE OF HANDHOLE
- 10. SHIMS TO BE 1/2" MIN. PER D.E. SPEC
- 11. GROUND CABLE SHALL BE #6 SOFT BARE COPPER WIRE WELDED TO GROUND ROD WITH 24" SLACK ABOVE FOUNDATION TOP; THE NEUTRAL AT THE POLE IS TO BE CONNECTED TO THIS GROUND CABLE

*UNLESS OTHERWISE NOTED ON THE PLANS OR CONTRACT DOCUMENT




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org


REV. NO.	DATE	DRAWN BY	CHECKED BY

DDA LIGHT POLE FOUNDATION

	1		
IDR. ENG	ICH.	ENG	IDRAWING NO.
SCALE N.T.S.	DATE	12/8/2023	SD-DDA-17
OO/ NEE 11. 1. O.		, 0, _0_0	

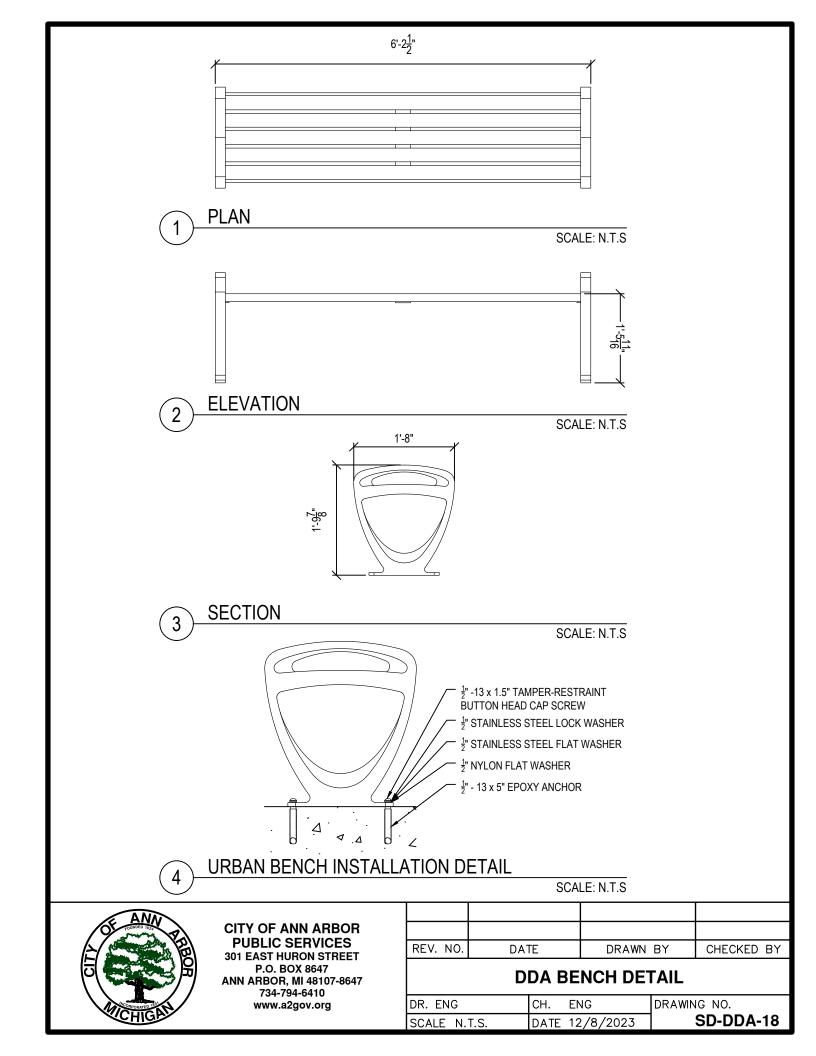

DDA VAULT ABANDONMENT

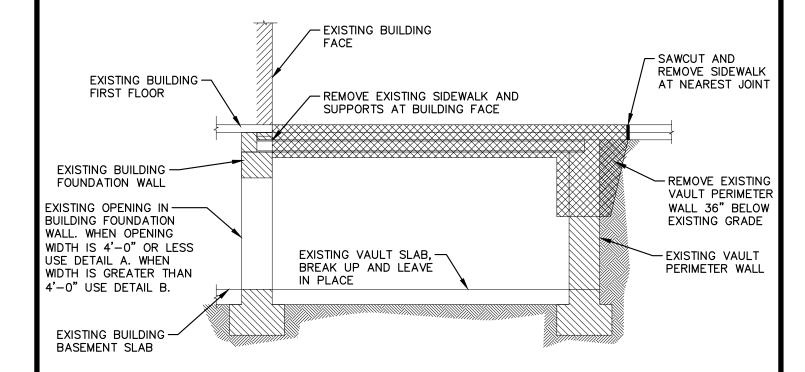

NOTES:

- 1. PROPERTY OWNER IS RESPONSIBLE FOR ALL WORK.
- 2. THE CONTRACTOR MUST OBTAIN ALL REQUIRED PERMITS, INCLUDING BUT NOT LIMITED TO: BUILDING, RIGHT-OF-WAY, LANE CLOSURE, METER BAGS AND MDOT PERMITS.
- 3. THESE ARE TYPICAL DETAILS FOR INFORMATION AND REFERENCE. A REGISTERED STRUCTURAL ENGINEER MUST CERTIFY PLANS FOR WORK ASSOCIATED WITH THE BUILDING STRUCTURE.




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

VAULT PREPARATION

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	09/01/2025	SD-DDA-19

DDA VAULT ABANDONMENT

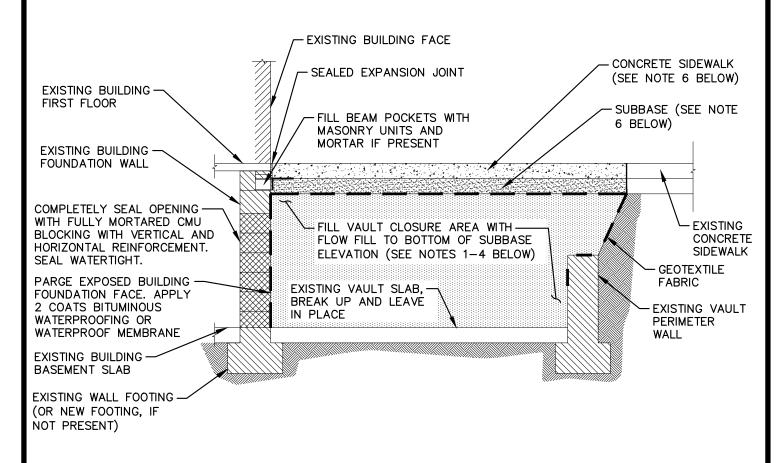

NOTES:

- 1. FLOW FILL SHALL PLACED IN LIFTS OF ONE THIRD $(\frac{1}{3})$ THE TOTAL HEIGHT AND ALLOW SUFFICIENT TIME FOR EACH LIFT TO SET BEFORE POURING SUBSEQUENT LIFTS.
- 2. PROTECT ANY EXISTING UTILITY PIPES WITHIN VAULT CLOSURE AREA.
- 3. ANY METERING OR OTHER UTILITY APPARATUSES ARE TO BE RELOCATED WITHIN BUILDING AS REQUIRED BY APPLICABLE UTILITIES.
- 4. PROPERLY ABANDON ANY FLOOR DRAINS LOCATED WITHIN VAULT CLOSURE AREA.
- 5. CONSTRUCT CONCRETE SIDEWALK AND SUBBASE PER CITY OF ANN ARBOR STANDARD DETAILS.

<u>DETAIL A</u> VAULT OPENING WIDTH 4'-0" OR LESS - CMU BLOCKING




CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

VAULT OPENING 4 OR LESS

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	09/01/2025	SD-DDA-20

DDA VAULT ABANDONMENT

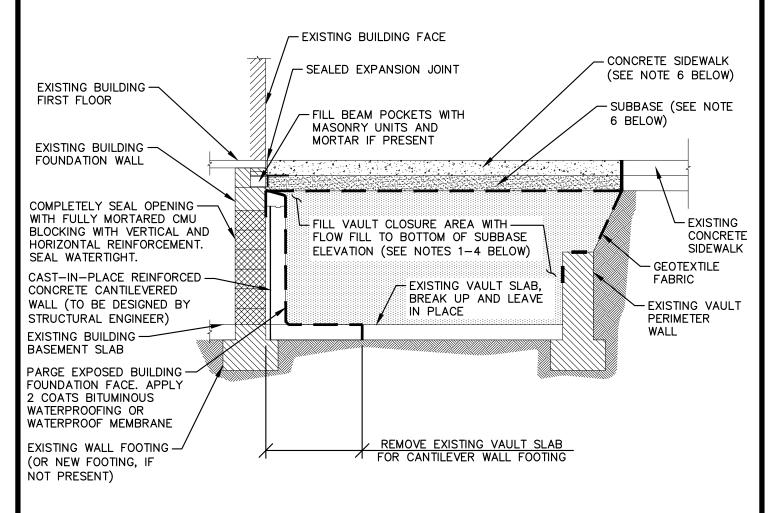

NOTES:

- 1. FLOW FILL SHALL PLACED IN LIFTS OF ONE THIRD $(\frac{1}{3})$ THE TOTAL HEIGHT AND ALLOW SUFFICIENT TIME FOR EACH LIFT TO SET BEFORE POURING SUBSEQUENT LIFTS.
- 2. PROTECT ANY EXISTING UTILITY PIPES WITHIN VAULT CLOSURE AREA.
- 3. ANY METERING OR OTHER UTILITY APPARATUSES ARE TO BE RELOCATED WITHIN BUILDING AS REQUIRED BY APPLICABLE UTILITIES.
- 4. PROPERLY ABANDON ANY FLOOR DRAINS LOCATED WITHIN VAULT CLOSURE AREA.
- 5. CONSTRUCT CONCRETE SIDEWALK AND SUBBASE PER CITY OF ANN ARBOR STANDARD DETAILS.

<u>DETAIL B</u> <u>VAULT OPENING WIDTH GREATER THAN 4'-0"</u> - CANTILEVER WALL SUPPORT



CITY OF ANN ARBOR PUBLIC SERVICES 301 EAST HURON STREET P.O. BOX 8647 ANN ARBOR, MI 48107-8647 734-794-6410 www.a2gov.org

REV. NO.	DATE	DRAWN BY	CHECKED BY

VAULT OPENING GREATER THAN 4

DR. ENG	CH.	ENG	DRAWING NO.
SCALE N.T.S.	DATE	09/01/2025	SD-DDA-21