


- 1) DETECTOR DOUBLE CHECK OR RPZ DEPENDING ON HAZARD LEVEL – AS DETERMINED BY THE CITY
- 2) GATE VALVE
- 3) BALL VALVE
- 4) DOUBLE CHECK VALVE OR RPZ DEPENDING ON HAZARD LEVEL – AS DETERMINED BY THE CITY
- 5) 3/4" METER

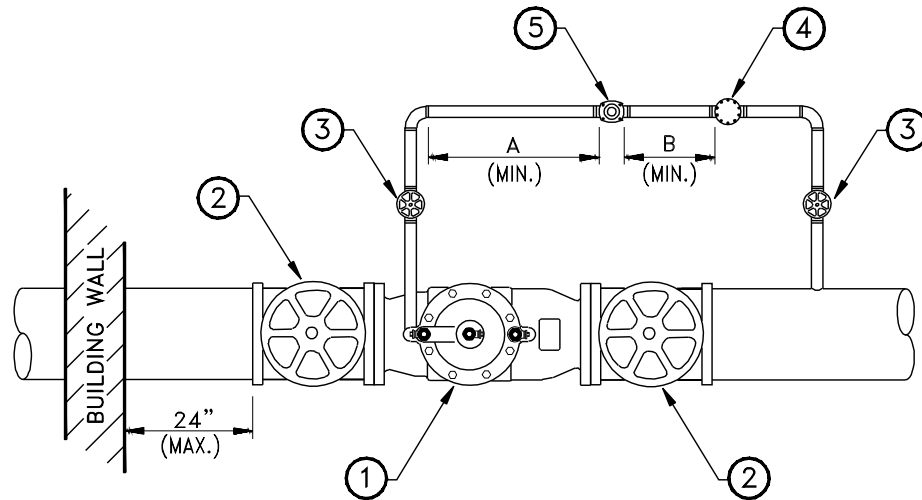

A = PIPE DIAMETER MULTIPLIED BY A, A=5  
 B = PIPE DIAMETER MULTIPLIED BY B, B=2

REVISIONS					REV. NO.	DR. BY	CH. BY	DATE
PROJECT MANAGEMENT – PUBLIC SERVICES AREA CITY OF ANN ARBOR								
<b>FIRE SERVICE METERING</b>								
DR. BY	DPF	CH. BY	BS/CSS	DRAWING NO.				
SCALE	N.T.S.	DATE	1-4-10	<b>SD-W-10</b>				
INCH				0		1		
SHEET NO. <u>1</u> OF <u>1</u>								